



ONE AAC PANEL

AAC FIRE & ACOUSTIC SOLUTIONS



50mm & 75mm AAC PANEL EXTERNAL WALL SYSTEM

DESIGN & INSTALLATION MANUAL

MAY 2025 Edition

Preface

The ONE AAC PANEL External Wall System Design & Installation Manual has been developed to provide design, installation and technical information to 'end users' ranging from the owner builder, licensed builders, building consultants, designers, architects and engineers.

Although the details provided in this Design & Installation Manual have been developed by ONE AAC and are intended to represent good building practice, the registered professionals involved in the project (such as the licensed builder, architectural designer and engineering consultant) must ensure that the information provided in this Design & Installation Manual is appropriate and suitable for the project.

Contents

Introduction To ONE AAC 3-6

- ❖ What is AAC
- ❖ ONE AAC PANEL - Features and Benefits
- ❖ Material Properties

BCA & Australian Standards Compliance 7

- ❖ Compliance with Required Standards

System Overview & Performance 8-12

- ❖ Structure – (Mass, Wind Zone, Impact)
- ❖ Durability
- ❖ External Moisture – Damp and Weather Proofing
- ❖ Fire Resistance / Bush Fire Zone Compliance
- ❖ Energy Efficiency (R-Values)
- ❖ Acoustic Performance

Design & Construction 13-14

- ❖ Design Principals
- ❖ Frame Design
- ❖ Design Detail Considerations

System Components 15-17

- ❖ Cavity Battens and Fasteners
- ❖ Panels and Panel Fasteners
- ❖ Adhesive, Corrosion Protection Paint
- ❖ Flashing, Sarking, Adhesive and Sealants

Installation of ONE AAC Panels 18-20

- ❖ System Installation Sequence
- ❖ Installation Summary
- ❖ Services – Plumbing and Electrical
- ❖ Tools & Equipment

Approved Coating System 21-22

- ❖ Components
- ❖ Specification

Delivery Storage & Handling 23

- ❖ Delivery
- ❖ Storage and Handling

Occupational Health and Safety 23

Warranty & Guarantee 24

Drawings & Details Pages

■ Vermin Control Cavity Closer	25,31,32,42,43&45
■ Batten Specification	25 & 26
■ Batten and Panel Layout	27
■ Batten & Panel Screw Spacing	28
■ General Arrangement	29
❖ Timber or Metal Wall Framing	
■ Eave Options	30
■ Base Detail	31&32
❖ Rebated Step-Down	
❖ Brick Course Step-Down	
❖ Overhanging-Rebate Foundation	
■ Inter-Floor Detail	32&34
❖ Timber or Steel Frame	
❖ Concrete Frame (Slab to Slab)	
➤ Exposed & Concealed Edge Beam	
■ Internal & External Corner Junction	35
■ Cladding Change Junctions	36&37
■ Bracket / Wall Junction	38
■ Window and Door Details	39
■ Threshold Options	40
■ Soffit/Wall/Roof Junctions	41-44
■ Parapet / Roof Detail	45&46
■ Column / Post Details	47
■ Garage Door / Opening Details	48&49
■ Meter Box Detail	50
■ Penetration Details	50
■ Control Joint Detail	51
■ Boundary Wall Details	52

CodeMark Certificate Of Conformity 53

Gallery 60

Introduction

ONE AAC Panel is known as a market leader in AS5146 compliant Aerated Autoclaved Concrete (AAC) Panel Solutions for residential and commercial construction.

ONE AAC combines 30 years of construction experience, product and systems development knowledge and material distribution expertise, to ensure its customers receive the best construction solutions for their projects, at the best possible price, with the fastest possible turnaround.


ONE AAC provides the construction industry with specialised **Fire** and **Acoustic** Solutions for **wall** and **floor** systems, in both **commercial** and **residential** applications.

Solutions include, but are not limited to:

- Internal Wall Systems (Indoor Walls / Intertenancy Walls / Party Walls / Corridor Walls. / Shaft Walls) – in both Low Rise and High Rise Residential markets
- External Wall Systems – Rendered Low Rise and High Rise Façades
- Boundary Walls - Single and Torrens Title Dual Wall Options
- Floor and Ceiling Systems
- Fence Systems - Boundary and Estate Fencing Solutions

Contact us on **1300 010 222** or www.oneaac.com.au for more information on how these solutions can work for you.

**Solutions Can Be Resolved in 50mm or 75mm Thick
ONE AAC PANEL - The Choice is Yours.**

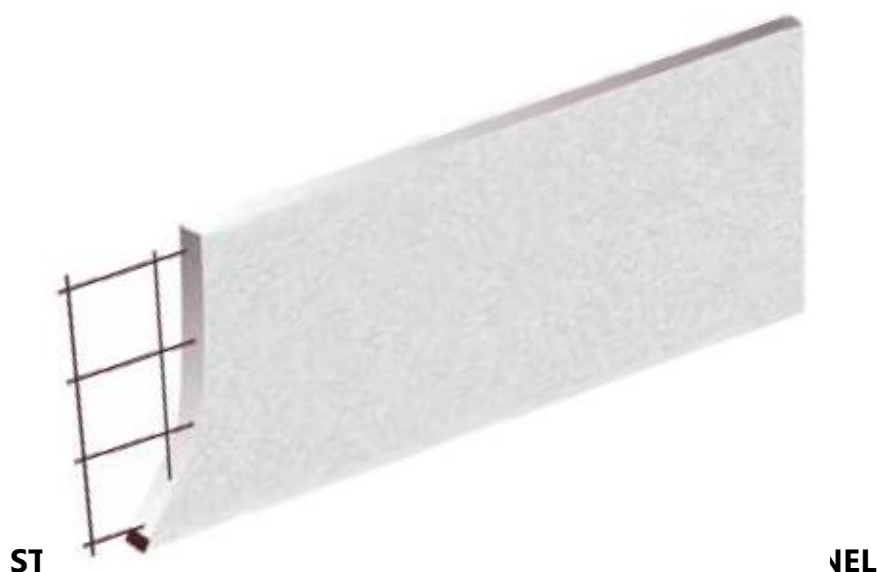


What Is AAC? (Lightweight Concrete)

Autoclaved Aerated Concrete (AAC) is manufactured from cement, sand (silica), lime and water, it is aerated by adding an expanding agent to the mix (small amounts of aluminium paste). The mix is poured into a mould (a very large cake tin), to approximately 2/3 of the height of the mould, almost instantly the expanding agent reacts with the other elements, and the mix begins to rise in the mould. (A chemical reaction expands the mixture to form small, finely dispersed air bubbles).

The moulds are pre-cured in a heated room for several hours. Then the semi-solid material (still in a green state) is transported to the cutting machine. The soft but semi-solid block is sliced into the required panel size using steel wires. Once sliced, the block is steam pressure cured in autoclaves for up to 12 hours. The expanding chemical reaction combined with the Autoclave process is what gives AAC it's unique properties. AAC has excellent thermal insulation and acoustic absorption properties, it has superior fire resistance qualities and is also termite resistant.

Its properties and specification satisfy all relevant building codes. Working with AAC is easy and efficient. AAC is both versatile and economical. AAC meets the diverse demands better than any other material due to the numerous advantages of its physical and mechanical properties.

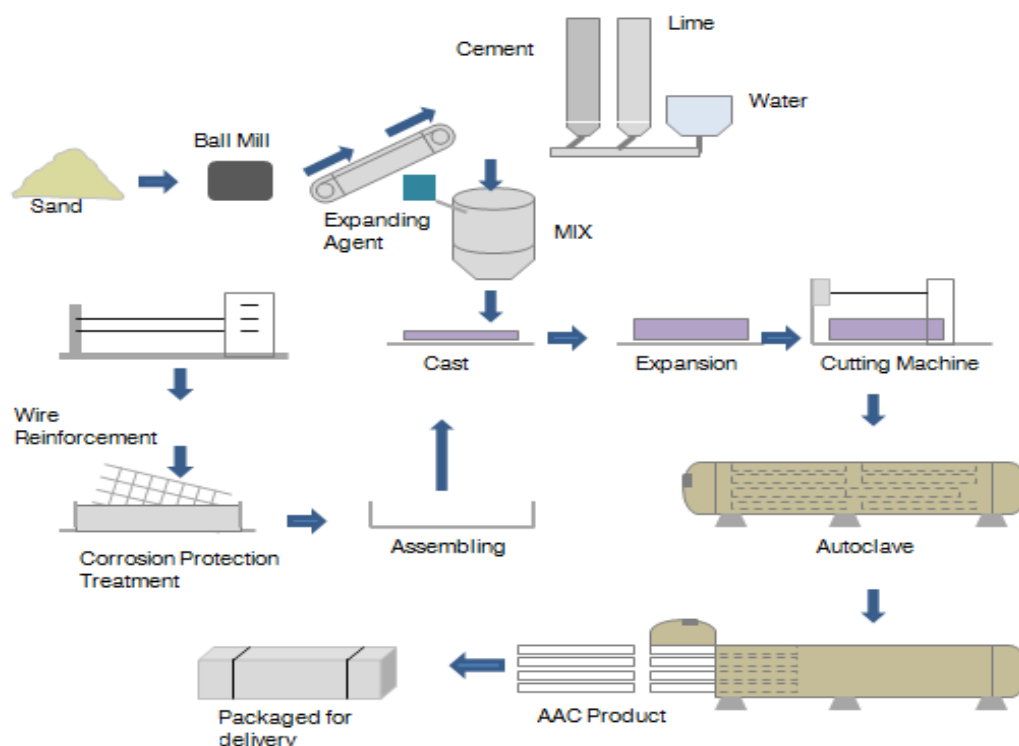


THE ONE AAC PANEL MANUFACTURING PROCESS

ONE AAC PANEL – Why You Should Use It

The ONE AAC Panel System is an exterior wall cladding system compliant with AS5146, that provides a lightweight, high-quality, and highly durable cladding solution perfectly suited to both residential and commercial applications.

The ONE AAC Panel System comprises steel reinforced panels manufactured from autoclaved aerated concrete (AAC). AAC lightweight reinforced panels are a trusted building material; they have been used in the building industry for several decades in Europe and for the last few decades in Australia and New Zealand.

With exterior coating solutions provided by ONE AAC approved Coating Partners, the ONE AAC Panel system is one of the most attractive and robust cladding systems on the market today.



Solid and as durable as masonry yet lightweight

ONE AAC Panels pass the 'knock test' by consumers because they are a masonry product. Further to that, ONE AAC panels are steel reinforced with corrosion protected steel adding to greater strength and security. The average mass of the 50/75mm thick panels are less than 40/62kg respectively, making it a convenient lightweight product, easily installed by a two-man installation process.



Living in a comfortable environment

The ONE AAC Panel System is able to achieve very good R-Values as a result of the combination of Thermal Mass and Thermal Resistance. The R-Value can be related to the comfort levels within a dwelling. The greater the R-Value, the more comfortable the temperature will be within that dwelling. The ONE AAC Panel System easily achieves the Thermal requirements as set out in the BCA.



High fire resistance adds to the security.

AAC Material is known for its high fire resistance. It will not combust in the event of fire and will not emit toxic gases. The ONE AAC Panel External Wall Systems provide a Load Bearing FRL up to 120/120/120. The ONE AAC Panel Wall System also complies with all six (Bush Fire Attack Level Categories (BAL) for external wall cladding.




Sound acoustic qualities

The ONE AAC Panel System provides acoustic performance levels equivalent to other masonry products that are twice as thick. Although the acoustic performance of residential external walls is not a requirement of the BCA, it is reassuring to know that acoustic performance is achieved when you use the ONE AAC Panel System.



Design flexibility and aesthetic appeal

ONE AAC provides building designers the flexibility of utilising a masonry product in areas previously restricted to non-masonry cladding products. ONE AAC allows designers and consumers the ability to create that inspirational and contemporary look, with a large range of finishes and colours provided by our coating partners. With ONE AAC the only limitation to your design is your imagination.



Reduce your Building Cost

The ONE AAC cladding system is simple and flexible insofar as it only requires semi-skilled trades and allows you the choice to self-install using existing lower cost trades or have it supplied and installed by approved installers. Either way this saves you time and money compared to traditional rendered masonry.



Speed of Construction

50mm ONE AAC panels are delivered flat packed for ease of workability, less labour and with considerable site cost savings. The speed of construction reaches key stages quickly. ONE AAC means a safe and clean worksite with less clean-up at the completion of the project. Two men can easily install an average of 50m² of panel per day.

Material Properties

ONE AAC Panel Properties (AS 5146.2)			50MM PANELS		75MM XL PANELS	
Property	Value	Units	Value	Units	Value	Units
Ambient ¹ Density, ρ_{amb} (10% Moisture Content)	561	kg/m ³	440	kg/m ³		
Dry ² Density, ρ_{dry}	510	kg/m ³	400	kg/m ³		
Working ³ Density, ρ_{design} (35% Moisture Content)	689	kg/m ³	540	kg/m ³		
Characteristic Compressive Strength of AAC $f'm$	2.8	MPa	2.38	MPa		
Average Compressive Strength of AAC	3.2	MPa	2.8	MPa		
Characteristic Modulus of Rupture, f'_{ut}	0.6	MPa	0.4	MPa		
Design Ultimate Limit State Bending Capacity, ϕM	0.12	kNm	0.25	kNm		
Design Serviceability Limit State Deflection Limit, δ_{max}	SPAN/240		SPAN/240			
Coefficient of contraction	0.4	mm/m	0.4	mm/m		
Coefficient of thermal expansion	10	x10 ⁻⁶ /°C	10	x10 ⁻⁶ /°C		

Notes:

1. Ambient density is that achieved by the product when it has reached equilibrium at 23°C, 50% RH. The moisture content by mass in this state is typically between 10% and 15%.
2. Dry density is the manufacturer's reported density, the typical frame of reference for grading AAC material. It is achieved by oven drying specimens so that the moisture content is 0%.
3. Working density is to be used for calculation of effects due to permanent actions.
4. Moment capacity quoted is for 600mm wide panels.

Quality from start to finish

It is highly recommended that ONE AAC panels are erected by approved Installers and coated by approved applicators.

With these measures in place plus strict system protocol ONE AAC offers a warranty of 15 years on materials and 7 years on workmanship adding peace of mind to all owners. ONE AAC and associated manufacturers both adhere to the ISO 9001 international standards for management of quality.



The ONE AAC Panel System – BCA / NCC Compliance

The BCA is part of the Australian National Construction Code system and defines minimum standards for buildings. The BCA consists of two volumes:

Volume One - provides requirements for commercial, residential and public building defined as Class 2 to 9 in the BCA. Typical examples include offices, commercial, health buildings, flats and boarding houses.

Volume Two – Housing Provisions, considers domestic construction defined as Class 1 and 10. Typical examples include houses, garages, swimming pools, carports and the like. The BCA is a performance-based building code and contains requirements for Structures, Fire Resistance, Damp & Weatherproofing, Sound Transmissions & Insulation and Energy Efficiency.

The ONE AAC Panel System has been assessed to meet and comply with all the necessary performance requirements of the BCA. This design & Installation Manual contains the information necessary to assist in the design of a project.

The designer should ensure the proposed use of the system satisfies the Performance Requirements and provides sufficient design information (including ONE AAC appraisal and installation manuals) to satisfy the requirements of the appropriate authority.

ONE AAC Panel has achieved the CODEMARK CERTIFICATE OF CONFORMITY issued by Global-Mark in Australia (Certificate Number GM_CM30031 Rev 4) to meet all the required provisions of the Building Code of Australia **for Volume One and Volume Two** and has been appraised as an **Alternative Solution** in terms of compliance with the Building Code of Australia as listed below:



CATEGORY	BCA VOLUME 1	BCA VOLUME 2	ABCB HOUSING PROVISIONS
Structural Reliability & Resistance	B1P1, B1P2, B1D4	H1P1, H1D7	N/A
Fire Safety	C2D2, C2D10 Specification 1 Specification 5	H3D3, H3D4, H3D5 Specification 1	9.2.3 9.3.1 & 9.3.4 9.4.1
Weatherproofing Damp Proofing	F1D6, F3D5	H2D6	N/A
Sound Insulation	F7D3, F7D4, F7D5, F7D6	H4D8	10.7.1, 10.7.2 & 10.7.3
Bushfire Construction	G5D3, G5D4	H7D4	N/A
Energy Efficiency – External Walls	J4D6	H6D2	13.2.5

The Code Mark Certificate is attached in the Appendix of this Design and Installation Manual or visit www.oneaac.com.au to download a copy.

Australian Standard Compliance

All works shall be carried out in accordance with the BCA and where necessary nominated reference standards.

AS 5146 (Parts 1, 2 & 3) - Reinforced Autoclaved Aerated Concrete

- Horizontally oriented ONE AAC panels -refer to tables 3.3G, 3.3H & 3.3I in AS5146.3
- Vertically oriented ONE AAC panels - refer to Tables 3.3A, 3.3B, 3.3C, 3.3D, 3.3E & 3.3F in AS5146.3.

AS 1720 Timber Framing Code and AS 1684-2006 National Timber Framing Code

AS 2870-1996 Residential Slabs and Footing Construction and AS 3600-2001 Concrete Structures

AS 3959-2009 Construction of Buildings in Bushfire-Prone Zone Areas

AS 2904-1995 Damp-proof course and flashings

AS 1170 Part 1 Loading Code and AS 1170 Part 2 Wind Code

AS 3660.1-2001 Protection of Buildings against subterranean Termite – Part 1 New Buildings

AS 4055-2006 Wind Loading for Housing


AS 3623 and AS/NZ 4600 – Steel Framing and NASH Standard 2005, Part 1 – Steel Framing

Where standards have been revised, the most current version shall apply

ONE AAC Construction Overview

The ONE AAC Panel System is designed to be used in new residential construction, extensions or re-cladding for houses & Multi-Residential External Walls using timber or steel frames as well as infill walls in high rise construction. The system consists of either 50mm or 75mm thick ONE AAC Panels, reinforced with corrosion protected steel in both directions, installed horizontally in a "stretcher-bond" pattern over continuous vertical battens attached to the load bearing frame. For fast, clean construction.

ONE AAC Panels are available in standard size of 2200mm in length and 600mm for easy of handling. Longer lengths are available, but the handling and weight of the panels must be considered when selecting longer panels.

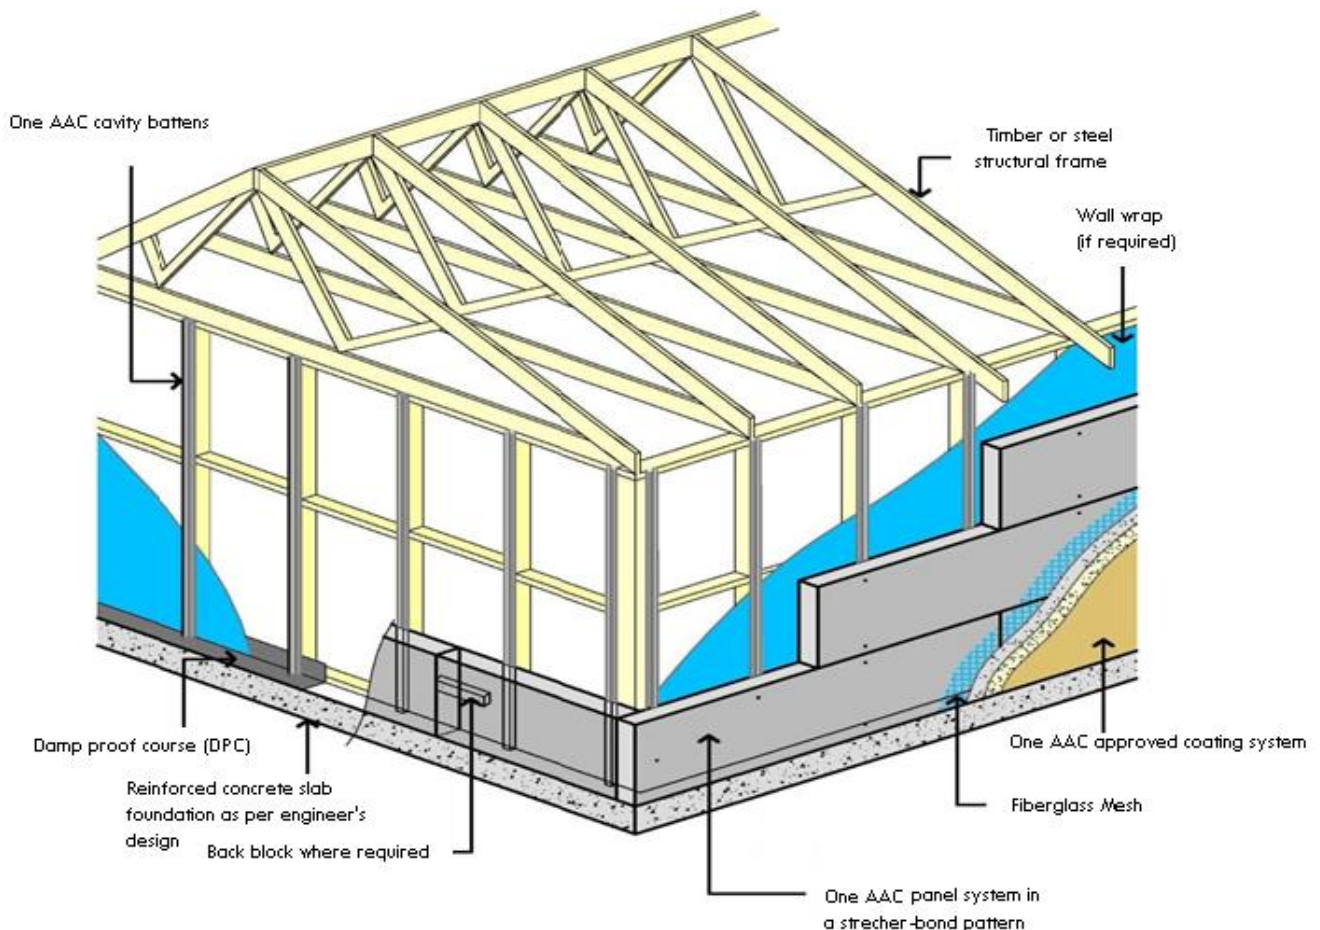

CONSTRUCTION OVERVIEW – Horizontal 50mm and 75mm ONE AAC Panel

Structure

Wind loads on the building are transferred from the panels to the frame through the fixing and batten system. The frame is the structural component of the wall system, therefore the structural loads including bracing and hold-down requirement for the frames should be designed in accordance with the BCA and the relevant Australian Standards.

Mass

The 50mm ONE AAC Panel has an average mass of 30.5kg/m² (40kg per panel) and the 75mm ONE AAC Panel has an average mass of 44kg/m² without coatings. In most cases the panel weight is supported at the base. In the event that the panels are suspended, the designer/engineer's must allow for the weight of the panel being fixed to the frame in the design and computation process. Within the computations, 4kg/m² should be allowed for external coatings.

Note: Suspended Horizontal Panel Installation is not permitted with polystyrene battens or when using 75mm panel with metal cavity battens greater than 40mm in depth.

Wind Zone

When installed in accordance with this Design & Installation Manual, The ONE AAC Panel is able to be designed to perform in wind zones up to and including N5, C3. The ONE AAC Panel Systems have been appraised for being suitable for use in buildings subjected to design wind speed as defined in AS 4055. The systems have been designed to meet the Australian Standards performance requirements in AS5146.3.

In other wind speed areas, the system can be used up to the ultimate limit state (ULS) wind pressure of 2500Pa when designed specifically in accordance with the BCA/ NCC.

Note: Although the ONE AAC Panel System is considered a drainable non-ventilated cavity system, it is beneficial to seal the doors and window frame junctions, particularly in high wind zone areas and coastal areas.

HORIZONTAL PANEL LAYOUT:


The following Table 2 identifies the required batten spacing and panel fastener spacing for the wind zones as described in the BCA: (Ref to drawing on page 28 for batten and panel screw spacing's)

TABLE	Max Horizontal Spacing For Battens and Panel Screws		Max Panel Screw Spacing Vertically	
Wind Zone	Corner Zone	Typical Zone	Corner Zone	Typical Zone
N2, N3, C1	600	900	500 (2 screws/600mm)	500 (2 screws/600mm)
N4, C2	600	600	250 (3 screws/600mm)	500 (2 screws/600mm)
N5, C3	450	450	250 (3 screws/600mm)	250 (3 screws/600mm)

For additional construction options for Horizontally oriented ONE AAC panels (including where panels are suspended from first floor or gable framing), please refer to tables 3.3G, 3.3H & 3.3I in AS5146.3.

VERTICAL PANEL LAYOUT:

For load capacity, panel spans and fixing guidance for vertically oriented ONE AAC panels, please refer to Tables 3.3A, 3.3B, 3.3C, 3.3D, 3.3E & 3.3F in AS5146.3.

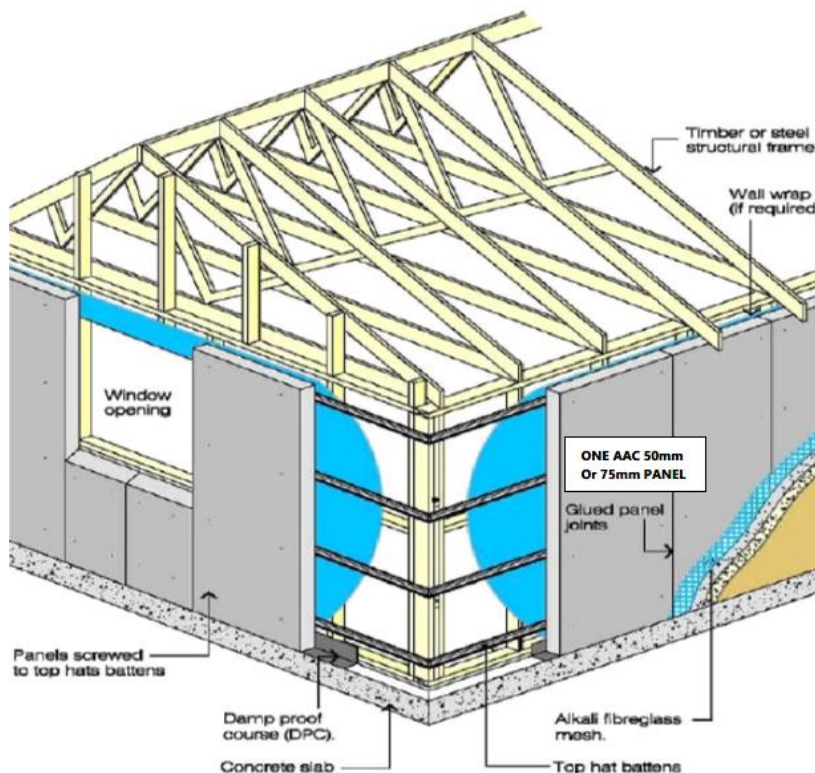

CONSTRUCTION OVERVIEW – Vertical 50mm and 75mm ONE AAC Panel

Impact Resistance

The system has adequate resistance to impact loads that the cladding system is likely to be subjected to when used in a residential situation.

Durability

The durability of a product or system refers to the ability of that product or system to be used in its intended application for a defined period of time. AAC products have been used in the building industry worldwide for several decades, and continue to be recognized for their performance, particularly durability. The ONE AAC Panel System subjected to normal conditions of environment and use will meet the durability requirements of S1.2.1 of the BCA.

External Moisture

The ONE AAC Panel System is designed to prevent the penetration of water that could cause undue dampness and/or damage to building elements, but in the event that water is able to penetrate into the cavity, the system is also designed to allow excess moisture present to be dissipated without causing permanent damage to the building elements, and therefore complies with Performance requirements of the BCA P2.2.2

The technical details provided for weather proofing are based on the design principle of employing both a 1st and 2nd line of defence against moisture entry. Firstly, moisture ingress must be prevented by detailing any joinery or wall junctions as shown in this Design & Installation Manual. Secondly, in the event that water does penetrate the wall system, a drainable cavity ensures and maintains weather proofing.

Any weather proofing details developed by a designer that are outside the scope of this Design & Installation Manual are the responsibility of the designer.

For all external wall applications, (other than a boundary wall with no penetrations), the presence of a drained cavity does not reduce the requirement to ensure the ONE AAC Panel System and all the relevant junctions, penetrations etc. remain weather proof in order to comply with Clause P2.2.2 of the BC A. In the event that a wall is built on a boundary (with no penetrations) and is abutting the walls of the adjoining property and cannot be coated, the uncoated ONE AAC Panel System will act as a drained cavity system and will therefore comply with Performance requirement of the BCA for drained cavity systems.



Fire Resistance

AAC materials have exceptional fire resistance and are non-combustible. In the event of fire ONE AAC Panels will not emit any toxic gases or vapours. The ONE AAC Panel System meets the performance requirements of P2.3.1 of the BCA for use as a Load Bearing External Wall, providing an FRL of 120/120/90 using 10mm plasterboard internal lining or 120/120/120 using 13mm fire rated plasterboard internal lining– (All tests and opinions were conducted by CSIRO, for Copies of Fire Reports or Opinions, contact ONE AAC on 1300 010 222).



SPECIFICATION FOR WALLS REQUIRING FIRE RATING IN BOTH DIRECTIONS FOR STEEL OR TIMBER FRAME

EXTERNAL PANEL	INTERNAL PLASTERBOARD LINING	FRL OUTSIDE	FRL INSIDE	IMAGE
50mm Or 75mm	10mm – 13mm Standard Plasterboard	120/120/90	-/-/-	
50mm Or 75mm	1 X 13mm Fire Rated Plasterboard	120/120/120	-/60/60	
50mm Or 75mm	1 X 16mm Fire Rated Plasterboard	120/120/120	60/60/60	
50mm Or 75mm	2 X 13mm Fire Rated Plasterboard	120/120/120	90/90/90	
50mm Or 75mm	2 X 16mm Fire Rated Plasterboard	120/120/120	120/120/120	

Compliance with the Bush Fire Zone Requirements

The ONE AAC Panel System complies with all six Bush Fire Attack Level categories and is therefore rated as **BAL-FZ (Flame Zone)** for external cladding. ONE AAC is a non-combustible material and exceeds an FRL of 30/30/30 when tested from the outside, as per AS3959-2009 Construction of Buildings in Bush Fire-Prone Areas.

There are Six (6) Bushfire Attack Levels, ranging from Low to Flame Zone; these are as per table below

BAL	DESCRIPTION	REQUIREMENTS FOR EXTERNAL WALLS	ONE AAC PANEL
Low	Minim attack from radiant heat and flame. Some attack by burning debris is possible.	No special construction requirements.	✓
12.5	Attack by burning debris is significant with radiant heat not greater than 12.5kW/m ² . Specific construction requirements for ember protection and accumulation of debris are warranted.	Non-combustible material required to base of external walls up to 400mm above ground or decks.	✓
19	Attack by burning debris is significant with radiant heat not greater than 19kW/m ² . Specific construction requirements for ember protection and accumulation of debris are warranted.	Non-combustible material required to base of external walls up to 400mm above ground or decks.	✓
29	Attack by burning debris is significant with radiant heat not greater than 29kW/m ² . Specific construction requirements for ember radiant heat are warranted. Some flame contact is possible.	Non-combustible material	✓
40	Radiant heat levels and flame contact is likely to significantly threaten building integrity.	Non-combustible material or tested for bushfire resistance to AS 1530. 8.1	✓
FZ (Flame Zone)	Significant radiant heat and significant higher likelihood of flame contact from the fire front will threaten building integrity.	Non-combustible material with a minimum thickness of 90mm or an FRL of -/30/30 when tested from outside or to be tested for bushfire resistance to AS 1530.8.2	✓

The standard defines the construction requirements for external walls as:

9.4.1 Walls

Walls shall be one of the following:

- Walls made of non-combustible material (e.g. masonry, brick veneer, mud brick, aerated concrete and concrete) with a minimum of 90mm in thicken ss. or
- A system complying with AS1530.8.2 when tested from the outside or
- A system with an FRL of 30/30/30 or -/30/30 when tested from the outsider or
- A combination of any of Items (a), (b) or (c) above

“Reproduced with permission from SAI Global Ltd under Licenses 1204-c05 6”, to purchase the Standard online visit www.saiglobal.com

For a copy of the Fire Test Certificate, contact us on 1300 010 222

Energy Efficiency

The ONE AAC Panel System is able to achieve very good thermal performance (R-Values) as Thermal Mass and Thermal Resistance. The R-Value can be related to the comfort levels within a dwelling, the greater the R- Value the more comfortable the temperature will be within that dwelling. The ONE AAC Panel System easily achieves the Thermal requirements as set out in P2.6.1 of the BCA.

For a copy of the reports for the stated R-Values, contact us on 1300 010

ONE AAC SYSTEM	System details – 70mm Frames The following Systems are all based on 50mm/75mm ONE AAC Panel, 20-40mm Cavity, 70mm Frame Thickness, and 10mm Plasterboard internal linings	Total R Value m2K/W	
		Summer 50mm/75mm	Winter 50mm/75mm
NS-1-70	Panel + Cavity + No Sarking + Frame + No Insulation + Plasterboard	0.72/0.89	0.74/0.91
SS-1-70	Panel + Cavity + SS Sarking + Frame + No Insulation + Plasterboard	1.33/1.50	1.46/1.63
NS-2-70	Panel + Cavity + No Sarking + Frame + R2.0 Insulation + Plasterboard	2.63/2.80	2.84/3.01
SS-2-70	Panel + Cavity + SS Sarking + Frame + R2.0 Insulation + Plasterboard	2.63/2.80	2.84/3.01

ONE AAC SYSTEM	System details – 90mm Frames The following Systems are all based on 50mm/75mm ONE AAC Panel, 20-40mm Cavity, 90mm Frame Thickness, and 10mm Plasterboard internal linings	Total R Value m2K/W	
		Summer 50mm/75mm	Winter 50mm/75mm
NS-1-90	Panel + Cavity + No Sarking + Frame + No Insulation + Plasterboard	0.72/0.89	0.74/0.91
SS-1-90	Panel + Cavity + SS Sarking + Frame + No Insulation + Plasterboard	1.34/1.51	1.50/1.67
NS-2-90	Panel + Cavity + No Sarking + Frame + R2.0 Insulation + Plasterboard	2.63/2.80(min)	2.84/3.01(min)
NS-3-90	Panel + Cavity + No Sarking + Frame + R2.5 Insulation + Plasterboard	3.11/3.28(min)	3.24/3.41(min)
SS-2-90	Panel + Cavity + No Sarking + Frame + R2.5 Insulation + Plasterboard	3.11/3.28(min)	3.24/3.41(min)
DS-1-90	Panel + 40mm Cavity + DS Sarking + Frame + R2.5 Insulation + Plasterboard	3.49/3.66	3.83/4.00
FS-1-90	Panel + Cavity + FS Sarking + Frame + R2.0 Insulation + Plasterboard	5.00/5.17	5.20/5.37

Notes: SS = Single Sided Sarking; NS = No Sarking; DS= Double Sided Anti-Glare Foil Sarking; Higher Values can be achieved using foil or air bubble type sarking and or alternative insulation (contact ONE AAC for more information).



Air Tightness

The prevention of airflow and drafts within the cavity significantly assist in the thermal performance of a wall system. The ONE AAC Panel System is non-ventilated, therefore reducing drafts that could occur within the activity, hence significantly improving Thermal Performance.

Insulation

To increase the R-Value and therefore comfort level, the use of insulation materials is recommended. The insulation should be installed to form a continuous barrier in accordance with the BCA.

Sarking Wall Wrap

The use of sarking, although not mandatory with the ONE AAC Panel System, is considered good building practice.

Sarking is mainly used to control Condensation & create a drainage plane if a leak occurs, additionally it creates an additional pocket of air within the wall, improving Thermal Insulation and Energy Efficiency.

For effective Condensation Management as per ABCB Housing Provisions 2022 Part 10.8.1 and BCA 2022 Volume 1 F8D3:

1. When sarking is NOT installed, the ONE AAC external wall must have a drained cavity to separate any moisture from insulation, framing and plasterboard.
2. When sarking is installed in the ONE AAC external wall, the Sarking wall wrap / membrane:
 - must comply with AS 4200.1 & be installed in accordance with AS 4200.2, and
 - must be installed external to the insulation,

Additionally;

- If the building is in Climate Zones 4 & 5 – the membrane must have AS4200.1 Vapour Control Classification of minimum Class 3 (Vapour Permeable), or
- If the building is in Climate Zones 6, 7 & 8 – the membrane must have AS4200.1 Vapour Control Classification of Class 4 (Vapour Permeable),
- Perforated (breather) membranes are not recommended.



Acoustic Performance

The ONE AAC Panel System offers good acoustic performance. To significantly increase the acoustic performance against outside noise, the use of sound insulation materials is recommended.

- The Bare 50mm ONE AAC Panel has an $R_w = 33$
- The Bare 75mm ONE AAC Panel has an $R_w = 35$

ONE AAC SYSTEM	The following Systems are based on 50mm/75mm ONE AAC Panel , no sarking, one layer of R1.5 insulation batts, and 10mm Plasterboard internal linings	Acoustic Rating	
		R_w 50mm / 75mm	$R_w + C_{tr}$ 50mm / 75mm
70-20	70mm Timber Frame + 20mm Cavity Battens	45 / 47	41 / 41
70-40	70mm Timber Frame + 40mm Cavity Battens	45 / 47	42 / 42
90-20	90mm Timber Frame + 20mm Cavity Battens	45 / 47	42 / 42
90-40	90mm Timber Frame + 40mm Cavity Battens	45 / 47	42 / 42
76-20	76mm Steel Frame + 20m Cavity Battens	53 / 55	46 / 46
76-40	76mm Steel Frame + 40m Cavity Battens	53 / 55	47 / 47
92-20	92mm Steel Frame + 20m Cavity Battens	53 / 55	47 / 47
92-40	92mm Steel Frame + 40m Cavity Battens	54 / 56	48 / 48

Stated Acoustic Values have been provided by Acoustic Engineers. For a copy of the acoustic reports, contact us on 1300 010 222



Design Principles for the ONE AAC Panel System

The design principles for the ONE AAC Panel System are based on those used for framed construction. The following are predominantly related to the Horizontal Panel System but can also apply to the Vertical Panel System.

Frame Design

The support structure (stud frame) shall be designed by the frame manufacturer or the relevant design engineer, and should be designed in accordance with the specific framing codes for timber or steel frames.

Timber Frames

The timber framing must comply with the relevant Parts of AS1684 for both buildings, and parts of buildings. Studs should be sized as normal to suit the wind loadings, vertical loading and stud height in accordance with the BCA. Timber studs should be spaced at nominal 600mm centre's. Noggins must be flush fitted at a maximum of 1350mm centre's.

Steel Frames

The steel framing must comply with NASH Standard 2005, Part 1 Residential and low-rise steel framing. For steel framing the minimum framing specification is 'C' section studs and noggins of overall section size 76mm web and 32mm flange. Minimum Steel thickness must be 0.75mm in accordance with AS 3623 and AS/NZ4600

Bracing

The timber or steel framed walls must be braced for a medium weight wall cladding in accordance with AS 1684 for timber framing and AS3623 and AS/NZS4600 for steel framing.

Design Detail Considerations

Wall Lengths (Horizontal Panel)

Using the ONE AAC Panels System is fast and economical, with reduced waste being a significant advantage of the system. Knowing that the ONE AAC panels are 2200mm long and installed in a "stretcher- bond" pattern, designing a building in 275mm modules will assist in ensuring project efficiency.

Wall Heights (Horizontal Panel)

Knowing that the ONE AAC panels are 600mm in width and are installed in rows up the wall, the wall height (from the base of the panel to 30mm above the eave) should be designed (as close as possible) in 300 mm modules which will also assist in ensuring project efficiency.

Footings

ONE AAC panels can be a direct substitute for a thin sheet cladding material e.g. fibre cement sheeting or polystyrene cladding and fixed over 16-48mm cavity battens on timber or steel frames. The panels can be supported on a rebated step down, or alternatively they can be fixed overhanging the concrete slab or timber base. (Refer. The ONE AAC Panel System Drawings; on pages 31 and 32). The footings should comply with AS 2870 1996 Residential Slabs and Footing construction.

Termites

Although termites do not eat or nest in AAC, termite protection is still a mandatory requirement. The simplest method of termite protection is the 75mm exposed slab edge perimeter method. Due to the variation in requirements from state to state in Australia it is the builder's responsibility to ensure that all council and BCA requirements are met with regards to termite attacks. Refer to BCA 2011 Vol. 2 Part 3.1.3 and reference code AS3660, requirements for the management and termite risk.

Vertical Control Joints (Horizontal Panel)

Vertical control joints (articulated Joints) are located at internal corners and as per geotechnical engineer's design report (Soil Report). If the distance between corners exceeds 6m, control joints should be located in line with window and door openings. These joints require 5-10mm gaps between panels which are injected with expandable foam or backing rod and sealed with approved moisture compatible external grade flexible sealant. (Refer. The ONE AAC Panel System Drawings on page 51)

Multi Storey Construction



ONE AAC Panels can be used for multi-storey construction when fixed in accordance with the ONE AAC Panel System details. (Refer. The ONE AAC Panel System Drawings on pages. 33 and 34)

Horizontal Joints (Horizontal Panel)

Horizontal control joints are required:

- When the wall height exceeds 8 meters;
- When timber joists are not seasoned (greater than 1% shrinkage of the floor joist depth as confirmed by the timber manufacture), these Joints require a minimum gap of 20mm;
- If the horizontal joint is within the FLOOR JOIST ZONE.

(Refer. The ONE AAC Panel System Drawings on pages 32, 33, 34 and 51)

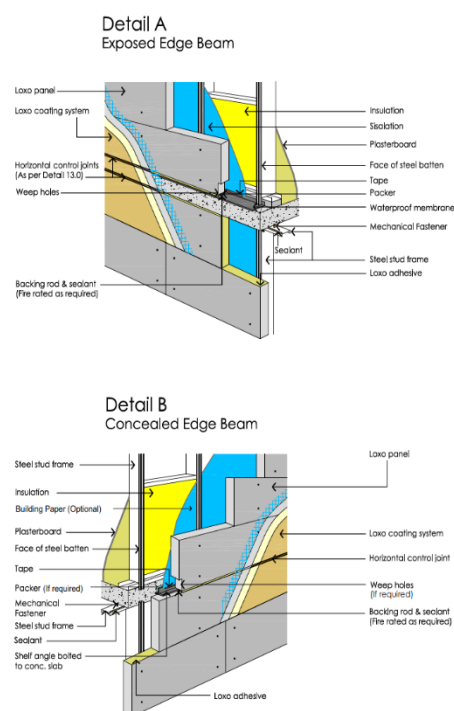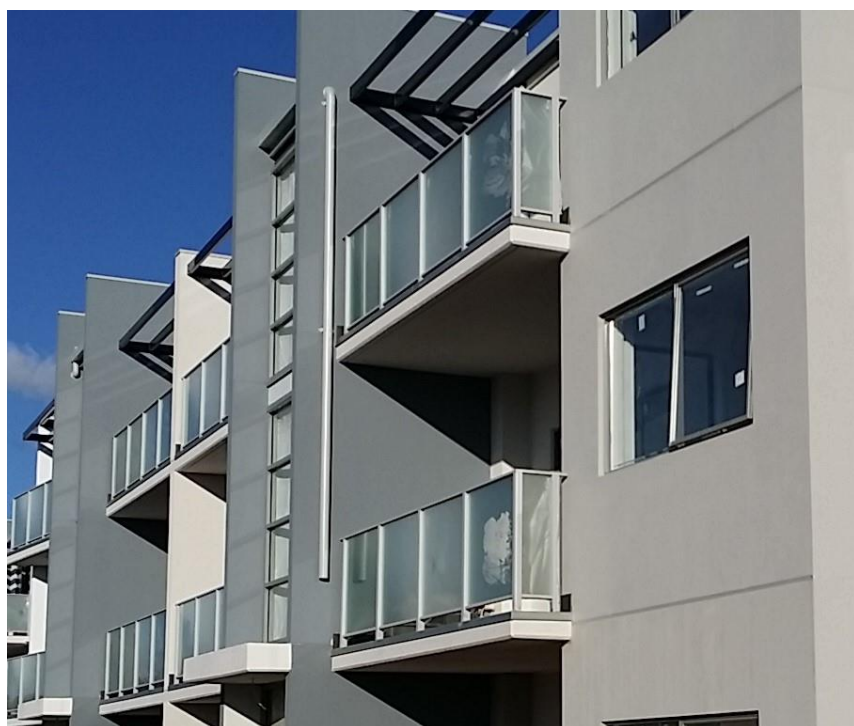

ONE AAC Horizontal Panel System Components

The following components are predominantly related to the Horizontal Panel System but may also apply to the Vertical Panel System.

ONE AAC Cavity Battens

(Refer. The ONE AAC Panel System Drawings on pages 25 and 26)

Cavity battens are manufactured from either:

- 0.42 BMT, G300 Galvanized Metal
- H3 treated pine timber, or
- Very High Density (Class VH) EPS with a density of no less than 28kg/m³

16mm to 48mm Cavity Battens supplied in 3000mm continuous lengths

ONE AAC Cavity Batten Fixing Requirements

- 2.87mm x 50mm (glue coated, plain shank galvanized nails) used to fix the 20mm timber battens to timber frames. (fix battens at 300mm centers);
- 3.05mm x 75mm (glue coated, plain shank galvanized framing nails) used to fix the 40mm timber battens to timber frames. (fix battens at 300mm centers);
- 12 x 40mm galvanized drill point countersunk screws used to fix the 20mm timber battens to steel frames. (fix battens at 300mm centers);
- 12 x 60mm galvanized drill point countersunk screws used to fix the 40mm timber battens to steel frames. (fix battens at 300mm centers);
- Construction Adhesive such as Max bond, Liquid Nails or similar may be used to temporarily fix the EPS battens to the frame or building wrap;
- 12-11 x 25mm Hex Head Type 17 screws used to temporarily fix the metal battens to timber frames; (fix battens at 600mm centers);
- 10-16 x 16mm Hex Head Takes screws used to fix temporarily the metal battens to metal frames; (fix battens at 600mm centers);

Note: A minimum of Class 3 fasteners must be used with the ONE AAC Panel System. A S3566 corrosion class 3 fasteners must be used in BCA defined corrosion zones 1, 2, 3, and 4. Class 4 or Grade 304 stainless steel in the sea spray zone.

ONE AAC Vermin Control /Cavity Closure Strips

(Refer. The ONE AAC Panel System Drawings on page 25)

Metal Vermin Control Strips; or Cavity Closer Strips are continuous metal battens used to close the gap between the bottom plate and the back of the panel. Mitre cut battens at corners to maintain vermin proofing. The battens are fixed to the bottom plate at 900mm centre's using:

- 12-11 x 25mm Hex Head Type 17 screws for timber frames;
- 10-16 x 16mm Hex Head Teak screws for steel frames;

Timber Vermin Control Strips; or Cavity Closer Strips are continuous timber Cavity Battens used to close the gap between the bottom plate and the back of the panel. Mitre cut or butt timber battens at corners to maintain vermin proofing. The battens are fixed to the bottom plate at 900mm centre's using hot dipped galvanized steel flat head nails.

ONE AAC Panels

The ONE AAC Panels are steel reinforced and are manufactured from autoclaved aerated concrete with a dry density of 520kg/m³-560kg/m³ for 50mm panel and a dry density of 400kg/m³-440kg/m³ for 75mm panel. ONE AAC Panels are supplied in a width of 600mm and lengths ranging from 2200mm to 3000mm for 50mm panel and lengths ranging from 2400mm to 3300mm for 75mm panel.

ONE AAC Panel Fasteners

Panels Fixed to Battens Only (Timber Battens)

- For wind zones up to and including N3, C1, the panel fasteners may be fixed into the timber battens without having to be fixed into the frame, provided the timber battens have been fixed to the frames using screws at a minimum of 600mm centers or as per the ONE AAC Cavity Battens Requirements.
- For wind zone greater than N3, C1, the panel fasteners must penetrate into the wall frame a minimum of 25mm for timber frames.

Panels Fixed Through Battens in to Frame (Polystyrene or Metal Battens)

- For all wind zones when using Polystyrene or Metal Battens, the panel fasteners must penetrate the wall frame a minimum of 25mm for timber frames and a minimum of 5 screw threads for metal frames.

For 50mm One AAC Panels

- 14-10 x 75mm MP Bugle Head Type 17 screws must be used to fix the panels into the timber battens or into steel frames (up to 0.75 BMT) with battens up to a maximum cavity thickness of 16mm
- 14-10 x 100mm MP Bugle Head Type 17 screws must be used to fix the panels through the 16mm cavity battens into the timber frames or to fix panels to steel frames (up to 0.75 BMT) with battens up to a maximum cavity thickness of 40mm
- 14-10 x 125mm MP Bugle Head Type 17 screws must be used to fix the panels through the 35mm cavity battens into the timber frames

For 75mm One AAC Panels

- 14-10 x 100mm MP Bugle Head Type 17 screws must be used to fix the panels into the timber battens or into steel frames (up to 0.75 BMT) with battens up to a maximum cavity thickness of 16mm
- 14-10 x 125mm MP Bugle Head Type 17 screws must be used to fix the panels through the 16mm cavity battens into the timber frames or to fix panels to steel frames (up to 0.75 BMT) with battens up to a maximum cavity thickness of 35mm
- 14-10 x 150mm MP Bugle Head Type 17 screws must be used to fix the panels through cavity battens greater than 35mm, with the Bugle Head screw embedding a minimum of 25mm into the timber frames once embedded in the ONE AAC Panel.

Notes:

- A minimum of Class 3 fasteners must be used with the ONE AAC Panel System. AS3566 corrosion class 3 fasteners must be used in BCA defined corrosion zones 1, 2, 3, and 4. Class 4 or Grade 304 stainless steel in the sea spray zone.
- Bugle Head Fasteners fixed through the face of the panels must be embedded a minimum of 5mm into the panel to comply with the corrosion requirements.

ONE AAC Panel Adhesive

The ONE AAC Panel Adhesive is a polymer modified cement-based adhesive supplied in 20kg bags. It is supplied by ONE AAC, mixed on-site with clean water (see instructions printed ONE AAC bag), and is applied to all edges of the panels (except control joint). ONE AAC Panel Adhesive is also used for bonding Decorative Trims and banding, along with minor patching, repairs and stopping of screw heads on the ONE AAC panels.

ONE AAC Corrosion Protection Touch Up Paint

When the ONE AAC Panels are cut to size, ensure that no reinforcing steel is exposed to openings or corners. When reinforcing steel is exposed it must be treated with the ONE AAC Corrosion Protection Touch Up Paint. It is supplied in 200ml containers. The instructions for use are on the container.

Damp Proof Course (DPC) & Flashing

- DPC is used to prevent rising damp from concrete footings, slabs or paths wetting the base of the panels.
- All flashings should be specifically designed for the wall frames and be compatible with the ONE AAC Panel System.
- Damp-proof courses should comply with the BCA, including AS 2904-1995 Damp-proof course and flashings.
- The designer should detail any specific requirements for special back-flashings required where the ONE AAC Panel joins another substrate/cladding

Sarking

Although the use of sarking is not mandatory with the ONE AAC Panel System, it is good building practice to do so.

However, sarking is required between:

- EPS battens and the frame to prevent condensation
- Metal battens and CCA treated timber frames to prevent corrosion of the metal batten.
- Metal battens and some LOSP treated frames to prevent corrosion of the metal batten. In the event that LOSP frames are to be used with metal battens, it is the responsibility of the project manager to confirm with the timber frame supplier if sarking is required to prevent corrosion of the metal battens.

Construction Adhesive

Construction Adhesive such as Max bond, Liquid Nails or similar should be used for adhering accessories such as Aluminum External Corner angles to ONE AAC Panels, or temporarily fixing EPS Cavity Battens prior to the installation of the panel fasteners.

Flexible Sealant

An external grade flexible sealant such as Bostik Seal'N'Flex or equivalent should be used at control joints, around windows, doors and penetrations through the ONE AAC Panels, to prevent or reduce the amount of water ingress into the cavity. Before sealant application, check with sealant manufacturer to confirm if a primer is required when using over ONE AAC Panels.

Fire Rated Sealant

An external grade fire rated sealant such as Knauf BINDEX, Fullers FIRESOUND Fire Rated Acoustic Sealant or Bostik FIREBAN ONE Low Modulus Fire Rated Polyurethane Sealant or equivalent must be used in control joints in all fire rated wall applications such as boundary walls.

Horizontal System Installation Process

1. Ensure builder has completed the frame ready for the ONE AAC Panel System. A pre-cladding check list is available on our website: www.oneaac.com.au
2. DPC must be applied to foundation and up-stand as per the ONE AAC Panel System Details.
3. Check to ensure framing is straight and plumb with a straight edge, especially corner studs.
4. If specified, install the required wall wrap in accordance with the BCA and manufacturer's instructions.
5. For suspended applications (as per the ONE AAC Panel System Details) install ONE AAC vermin control cavity closers as required.
6. Batten Installation:
 - a. firstly, start by fixing continuous horizontal battens approx. 75mm below & above openings to the extent and including the jamb studs prior to fixing vertical battens.
 - b. then, fix the battens vertically as per specifications from the bottom plate in line with the studs.
 - c. Repeat the process for 6a and 6b above. The horizontal distance between battens must comply with the structural requirements for the Wind Zone of the project; refer to Table 2 on page 9. Extra battens can be placed to allow for irregularities in framing or in anticipated extra support for the ONE AAC Panels.
7. Starting from a corner, place the first ONE AAC Panel horizontally onto the rebate. Use a spirit level to ensure the ONE AAC Panel is level and is either flush or overhanging the rebate as required. Push the ONE AAC Panel hard against the battens and screw fix through the exterior face, through or into the batten as specified to a minimum of 50mm in from the edges of the ONE AAC Panel. A minimum of 6 screws are required per standard ONE AAC Panel and each screw must be wound into the ONE AAC Panel until the head is embedded by a minimum of 5mm. ONE AAC Panels can be cantilevered a maximum of 500mm beyond the stud and to ensure that the panels are aligned, back blocking is required.
8. Apply ONE AAC Panel Adhesive approximately 2–3mm thick along the vertical edge of the ONE AAC Panel. Abut the next ONE AAC Panel hard against the fixed ONE AAC Panel. Ensure this ONE AAC Panel is level and screw throughout or into the battens as specified to a minimum of 50mm in from the edges of the ONE AAC Panel. Repeat this procedure around the perimeter of the building.
9. Apply ONE AAC Panel Adhesive approximately 2–3mm thick along the top edge of the first row of ONE AAC Panels for approximately one panel length. Lay the next row of ONE AAC Panels with a minimum of 275mm stretcher-bond overlap of the ONE AAC Panel below, then screw ONE AAC Panel as outlined above. For panel layout guidelines, refer to the ONE AAC Panel System Drawings on page 27
10. ONE AAC Panels may be cut to size and whenever possible no reinforcing steel should be exposed to openings or corners. All exposed steel reinforcement must be treated with ONE AAC Corrosion Protection Touch Up Paint.
11. Apply ONE AAC approved sealant to window and door jambs surrounds as per specification.

The ONE AAC Panel System installation must be performed or supervised by approved installers to ensure quality of workmanship.

ONE AAC Horizontal Panel Installation Summary

1. Wall Frame is completed and ready for panel installation.

- Plumbing and electrical should be installed within the frame, and it is preferred if the services are installed after panel installation



2. Install Flashing.

- Ensure that DPC or flashing is installed correctly
- If sarking is being installed, it should be lapped over the flashing, prior to batten installation.




3. Batten Installation

- Select cavity batten size and type, i.e. Metal/Timber/EPS
- Install horizontal battens below and above openings
- Install Vermin Control Battens if required.



4. Install ONE AAC Panel

- Install in a stretcher bond pattern
- Minimum of 6 screws per standard panel
- Back Block all off stud panel joints
- Adhesive to be applied to vertical and horizontal joints
- Cut panels to suit
- Exposed reinforcement to be coated with ACP
- Minimum panel stagger of 275mm
- Glue and screw external corners

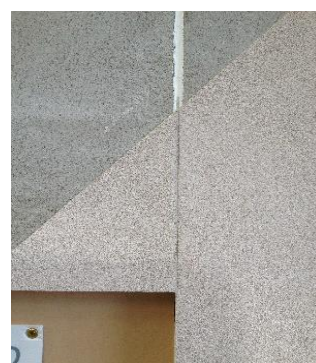

5. Ensure approved coating system is applied. (Fully Meshed)

Plumbing and Electrical Services

Services are preferred to be installed through the frame but they can be fixed to the outside of the frame in a horizontal direction between the battens typically 300mm up from the bottom of the first row of panels, or as agreed between the builder and the Panel Installer. Service penetrations through the ONE AAC Panel should be neatly cut, and allowing a 5 to 10mm clearance gap around the penetration, which must be sealed with an approved external grade sealant. PVC sheathed electrical cables must be prevented from direct contact with the EPS Battens and must be placed in a conduit.

Basic Tools Required When Working With AAC

The basic tools required when working with AAC are typically used by the carpentry and rendering trades and are readily available and relatively inexpensive when it comes to the complete set up for working with AAC.

Some of the tools required to make the job easy are identified below:

- ◆ Personal Protective Equipment
 - ✓ High Visibility Work Wear, Steel Cap Boots
 - ✓ Gloves, Dust Mask, Goggles, Hearing Protection
- ◆ Standard Contractor Tools
 - ✓ Hammer, Nail Bag, Tape, Pencil, Level
 - ✓ Tin Snips, Chisels, Knife
 - ✓ Electric Leads and Power Box
- ◆ Power Saw
 - ✓ Preferably Dustless
 - ✓ Fitted with a Diamond Blade
- ◆ Vacuum
- ◆ Power drill / Mixing Drill / Mixing Buckets
- ◆ Cordless Drills and Drive Bits
- ◆ Grinder / Reciprocator Saw
- ◆ Adhesive Trowel
- ◆ Hawk and Steel Trowel
- ◆ Nail or Staple Gun
- ◆ Sanding Float / Rasp



ONE AAC Approved Coating System

Only ONE AAC Approved Coating Systems are to be applied over ONE AAC Panels. For a complete list of ONE AAC Approved Coating Systems, visit our website: www.oneaac.com.au

Components

An Approved ONE AAC Coating System typically comprises:

- ◆ A specially formulated cement based, polymer modified Base Coat Render System;
- ◆ A fiberglass reinforcing mesh troweled and embedded into the Base Coat Render;
- ◆ A Wet or Dry Texture, typically applied directly over the Base Coat Render;
- ◆ A Top Coat Membrane Paint System (typically, two coats of membrane applied over the Texture)

Notes:

- ✓ A Primer between the Base and the Texture or between the Texture and the Top Coat may be required? (please check with the coating manufacturers specific requirements).
- ✓ The ONE AAC Panel System demands the use of External Corner Angle for that true perfect finish.

Specification

Pre-Coating Requirement

Before commencing application of the coating system, the coating applicator must ensure that all required penetrations have been carried out and that the ONE AAC Panels are suitably dry and ready for the coating application.

Coating System Application

All Coating Components used for the coating of the ONE AAC Cladding Panels are to be supplied by the ONE AAC approved coating manufacturer and or sub-contractors. The Coating System should be applied by contractors aligned and approved by the ONE AAC Approved Coating Partners. For a list of the approved Coating Partners, visit our website: www.oneaac.com.au

Meshed Base Coat Render

The Meshed Base Coat Render must be a polymer-modified, Portland cement-based render; it is mixed on site with clean drinking water. It is applied as a base coat, either over or encapsulating the fiberglass mesh reinforcement. Ensure there is a minimum of 2mm thickness over the mesh. The total meshed base coat should have a minimum thickness of 3mm.

The Reinforcing Mesh must be a high quality, alkali resistant fiberglass mesh with a nominal size of approximately 5mm square and a weight of 165g/m² for use in domestic and light commercial situations.

Primer Coat (Optional)

A water based primer/sealer to enhance adhesion can be applied if necessary. (Refer to coating manufacturer's specification for suitable primer coats that are compatible with this system)

Texture Coat: Two specifications for the Texture Coat material are available.

1. Dry Texture:

A cement based polymer modified coating applied with a trowel or float over the basecoat. The texture must have a minimum thickness of 1.0mm. It is mandatory to overcoat dry textures with an approved membrane paint system (Membrane Coating).

2. Wet Texture:

A pre-mixed, full acrylic coating, with a minimum thickness of 1mm, which is applied over the basecoat with a trowel or float. The Wet Textures may be coloured through (tinted) and may not require the application of a paint system (dependent on coating manufacturers recommendations and warranty). In the case were a paint system is not required, the application of the wet texture forms the primary means of weather resistance.

Paint System (Membrane Coating)

The paint system (membrane coating) must comprise a minimum of two coats of a 100% acrylic-based exterior membrane paint. The paint / membrane must be applied to a minimum dry film thickness of 150um per coat and must have a crack bridging capability of five (5) times the total dry film thickness. The application of the paint system forms the primary means of weather resistance.

Coating System Approval

Proprietary coating systems must be approved by ONE AAC prior to their use. The coating manufacturer must confirm that they comply with the ONE AAC Approved Coating System specifications and that they will provide a minimum 7 year manufacturer's warranty when used with the ONE AAC Panel.

Coating System Maintenance

Regular checks and cleaning, at least annually, of the Coating Systems must be carried out, and any routine maintenance performed as and when required to maintain weather tightness. Any damage to the Coating System must be promptly repaired by an approved coating applicator to ensure the integrity of the Coating System is maintained.



Delivery Storage & Handling

Delivery

One AAC Panels are flat-packed delivered to site (20 in a pack for 50mm Panel and 13 in a pack for 75mm Panel) and shall be unloaded or moved with approved lifting devices. For transport and lifting purposes the wet mass of the panels should be used. Each pack has a wet mass of approximately 900kg including the packaging. To minimise double handling and save time the packs should be unloaded as close as possible to the installation area. ONE AAC Panel packs should only be stacked one pack high (on site) and properly supported on level ground. Always consult the project engineer as to the adequacy of the structure to support the packs if they are to be placed on any part of the structure.

Storage

All ONE AAC material should be kept dry and preferably under cover, all care should be taken to avoid damage to the face, ends and edges of the panels. When ONE AAC Panels are stored outside they must be off the ground and protected from the weather.

Manual Handling

Physical manual handling of ONE AAC Panels around the work site should be kept to a minimum, always carry the panels on edge, and support the weight by a two man lift procedure. Where the manual handling becomes excessive with respect to distance from the installation area, ONE AAC recommends the use of trolleys and/or other mechanical devices.

Occupational Health & Safety (OH&S)

ONE AAC Panels, along with all clay, concrete and quarry products contain Crystal line Silica, or Silica Dust. Prolonged exposure to Silica dust without the correct Personal Protection Equipment can be harmful and potentially cause life threatening health hazards such as bronchitis, silicosis and lung cancer.

The ONE AAC Panel itself does not cause health problems, however when cutting, drilling, chasing, sanding, etc., the exposure to high volumes of dust is increased, which increases the potential for health problems to occur, unless standard precautionary measures are taken. Repeatedly breathing in high volumes of dust over many years, may lead to health problems.

It is most unlikely to breath in high volumes of fine silica dust when stacking, loading or laying panels, however when cutting, drilling, chasing, sanding, etc., it is imperative that safety masks, hearing and eye protection is worn. Ensure the mask fits properly and is approved for use with dust. Protective clothing should also be worn e.g. high visibility long sleeve shirt and long pants. These should be washed often and not in the same wash as other clothes.

The site should be cleaned of dust every day, and when using power tools these should be tagged for use as required and be fitted with efficient and well maintained dust extraction devices. The ONE AAC Panel Installer on site has a responsibility to inform all employees of these Health and Safety requirements under the Occupational Health and Safety Act.

Personal Protective Equipment (PPE)

When working with AAC, ONE AAC recommends (as a minimum) that the following PPE is worn:

- ◆ P1 or P2 Dust masks – complying with AS/NZS1715 and AS/NZS1716
- ◆ Glasses / Goggles - complying with AS1336
- ◆ Ear Plugs / Ear Muffs – Class 5
- ◆ Gloves, long sleeve shirt and pants – to prevent possible skin irritation and skin cancer from working outdoors
- ◆ Steel Cap Boots

Cutting

ONE AAC Panels can be easily cut, drilled, or chased using power or hand tools. When working with ONE AAC Panels ensure that the PPE as previously described is worn. As an added measure of containing the dust when working with AAC products, ONE AAC recommends the use of dust extraction equipment.

ONE AAC Panel makes cutting easier for the installer, as they are delivered to site flat packed, essentially each pack of panel is its own cutting bench, simply adjust the depth of the saw blade to the thickness of the panel, and cut the required panels before removing it from the pack. Any exposed reinforcement during cutting must be coated with the ONE AAC Panel Corrosion Protection Touch Up Paint. For a copy of the full range of ONE AAC Panel MSDS sheets, visit the website; www.oneaac.com.au

Hazardous Materials

With reference to the BCA, regarding Hazardous Building Materials, AAC Panels are non-hazardous, provided that all safety precautions included in this literature are adhered to.

Warranty & Guarantee

ONE AAC Panels are quality building products, and come with the following Warranty and Guarantee:

Warranty

ONE AAC Panels and associated materials, when installed as exterior wall cladding, are warranted for a minimum of **15 years** (from the date of purchase), not only meeting, but exceeding the **7 year** requirement outlined in the BCA and the relevant Australian Standards. The ONE AAC Panel products are designed to have a life span significantly in excess of this minimum period.

Guaranteed


ONE AAC Panel Autoclaved Aerated Concrete products are guaranteed to be free of defect in material and manufacture.

The ONE AAC Panel Approved Coating products are guaranteed by the coating manufacturers, for weatherproofing against peeling, flaking, cracking or deterioration, provided the system has been properly maintained and subjected to normal conditions of exposure.


The Coating Manufacturers guarantee applies only where all material components of the ONE AAC Panel Approved Coating System have been prepared and installed in accordance with their written instructions and technical specifications.

For further details or information on the engineering, design and construction with the ONE AAC Panel System, please contact our sales or technical professionals on 1300 010 222 or visit our website: www.oneaac.com.au to obtain the latest Design & Installation Manuals.

Drawings & Details

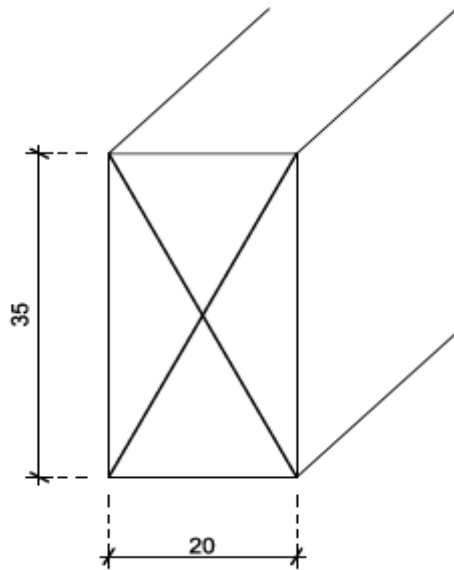


20mm TIMBER BATTEN
(H3. Treated)

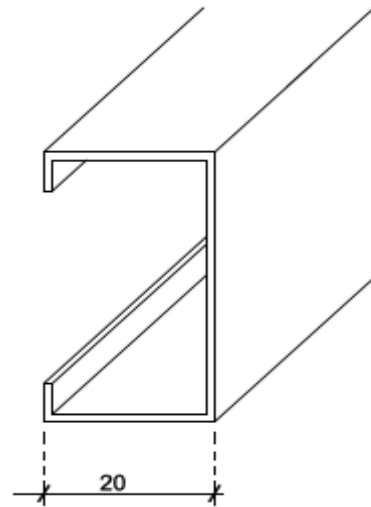


20mm METAL BATTEN

Note: The Loxo vermin control cavity closer is only required if the Loxo panel is not supported by a slab rebate (i.e. unenclosed sub-floor or overhanging the slab edge). It must be fixed continuously to the bottom plate of frame. The metal batten corners must be mitre-cut to maintain vermin proofing.

20mm CAVITY CLOSER

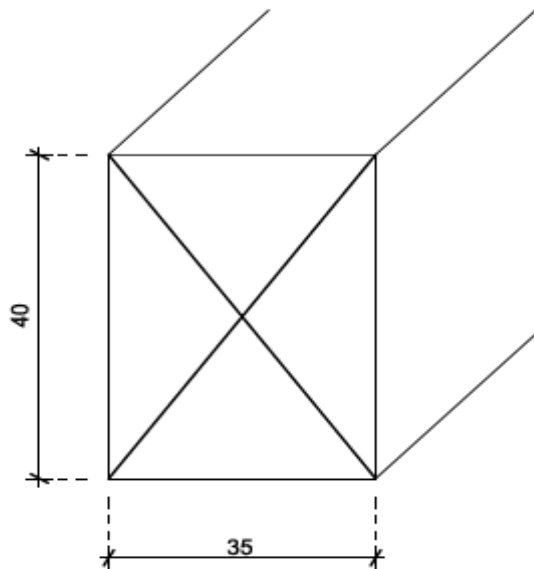


40mm TIMBER BATTEN
(H3. Treated)

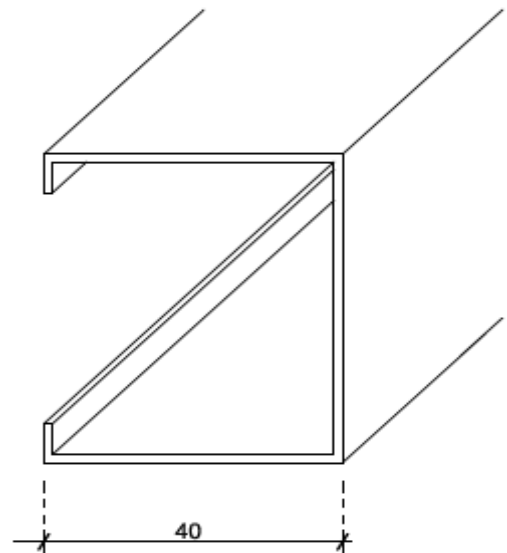

40mm METAL BATTEN

Note: The Loxo vermin control cavity closer is only required if the Loxo panel is not supported by a slab rebate (i.e. unenclosed sub-floor or overhanging the slab edge). It must be fixed continuously to the bottom plate of frame. The metal batten corners must be mitre-cut to maintain vermin proofing.

40mm CAVITY CLOSER

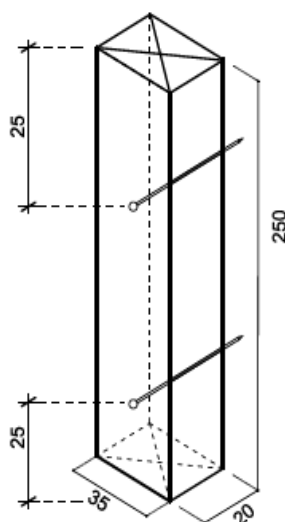

- H3 Treated timber
- 35 x 20 x (250mm or continuous)
- Battens fixed to timber frames using 2 x 50mm nails.


- Battens fixed to metal frames using 2 x 35mm drill point screws.

- Panels must be fixed into frame through timber battens using 100mm bugle batten screws.

Note:

It is good building practice to provide wall wrap (but not required)

20mm TIMBER BATTEN

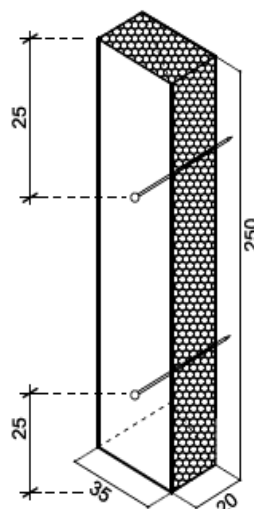

- VH EPS
- 35 x 20 x (250mm or continuous)

- Battens fixed to timber frames using 2 x 40mm galvanised clouts or fully glued over wall wrap using Loxo approved EPS adhesive.


- Battens fixed to metal frames using 2 x 40mm countersunk, drill point galvanised screws or fully glued over wall wrap using Loxo approved EPS adhesive.

- Panels must be fixed into frame through EPS battens using 100mm bugles.

Note:

When using EPS battens wall wrap is required.

20mm EPS BATTEN

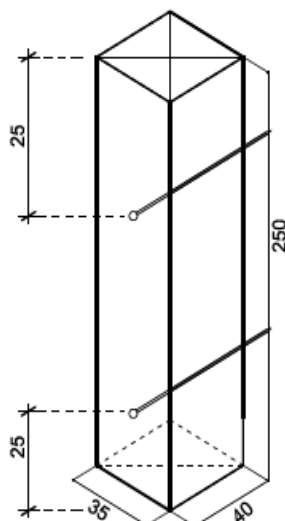

- H3 Treated timber
- 35 x 40 x (250mm or continuous)

- Battens fixed to timber frames using 2 x 75mm nails.


- Battens fixed to metal frames using 2 x 50mm drill point screws.

- Panels can be fixed onto timber battens (in low wind zones) using 75mm bugle screws or fixed onto the frame using 125mm bugle screws.

Note:

It is good building practice to provide wall wrap (but not required)

40mm TIMBER BATTEN

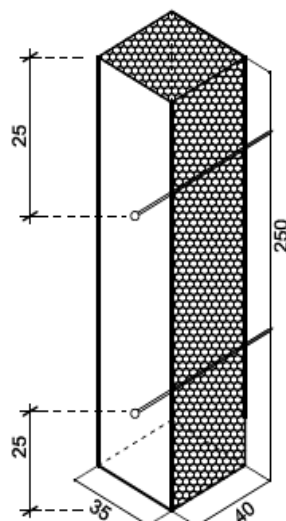

- VH EPS
- 35 x 40 x (250mm or continuous)

- Battens fixed to timber frames using 2 x 50mm galvanised clouts or fully glued over wall wrap using Loxo approved EPS adhesive.


- Battens fixed to metal frames using 2 x 50mm countersunk, drill point galvanised screws or fully glued over wall wrap using Loxo approved EPS adhesive.

- Panels must be fixed into frame through EPS battens using 125mm bugles.

Note:

When using EPS battens wall wrap is required.

40mm EPS BATTEN

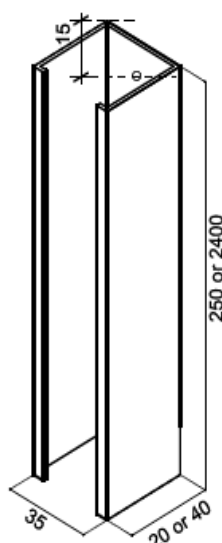

- 0.42mm Thick galvanised metal
- 35 x (20 or 40mm) x (250 or continuous)

- Battens fixed to timber frames using 25mm screws.

- Battens fixed to metal frames using 16mm drill point screws.

FOR TIMBER FRAME

- Panels must be fixed into timber frames through metal battens using 100mm bugle screws for the 20mm batten.

- Panels must be fixed into timber frames through metal battens using 125mm bugle screws for the 40mm batten.

Note:




It is good building practice to provide wall wrap (but not required)


20mm or 40mm METAL BATTEN

FOR STEEL FRAME

- Panels must be fixed into steel frames through metal battens using 75mm bugle screws for the 20mm batten.

- Panels must be fixed into steel frames through metal battens using 100mm bugle screws for the 40mm batten.

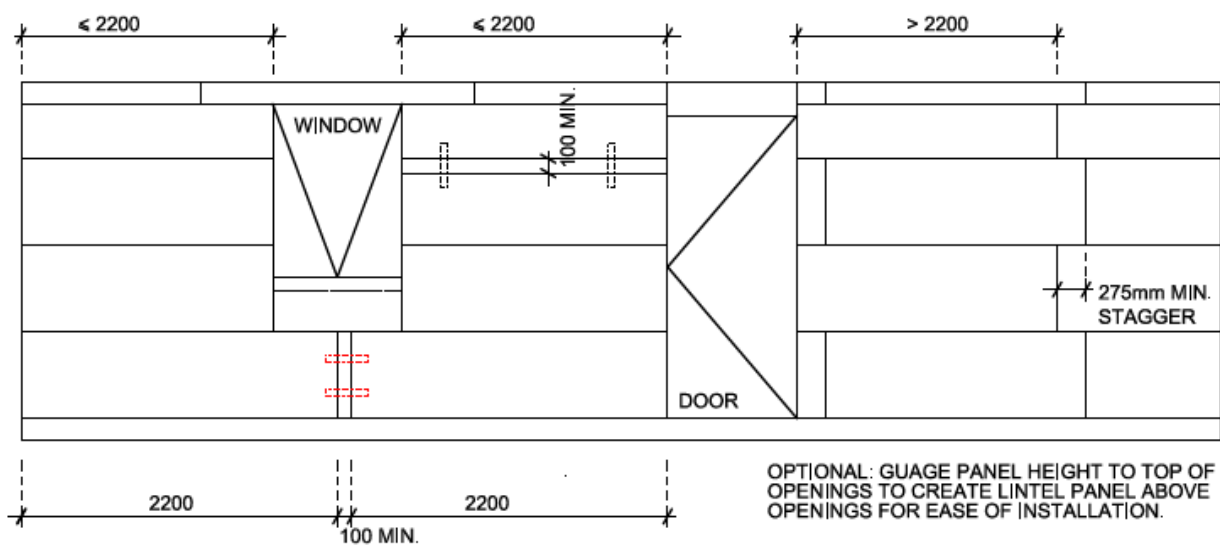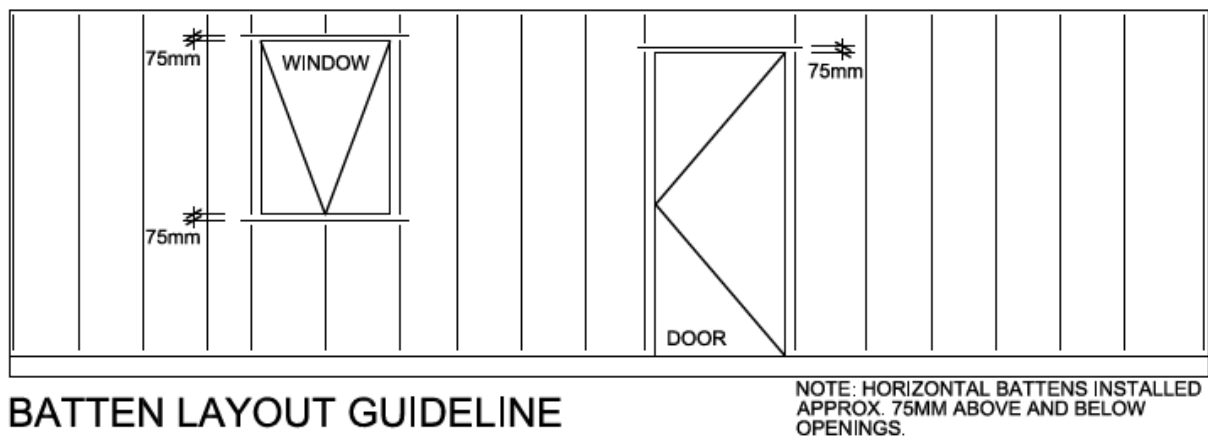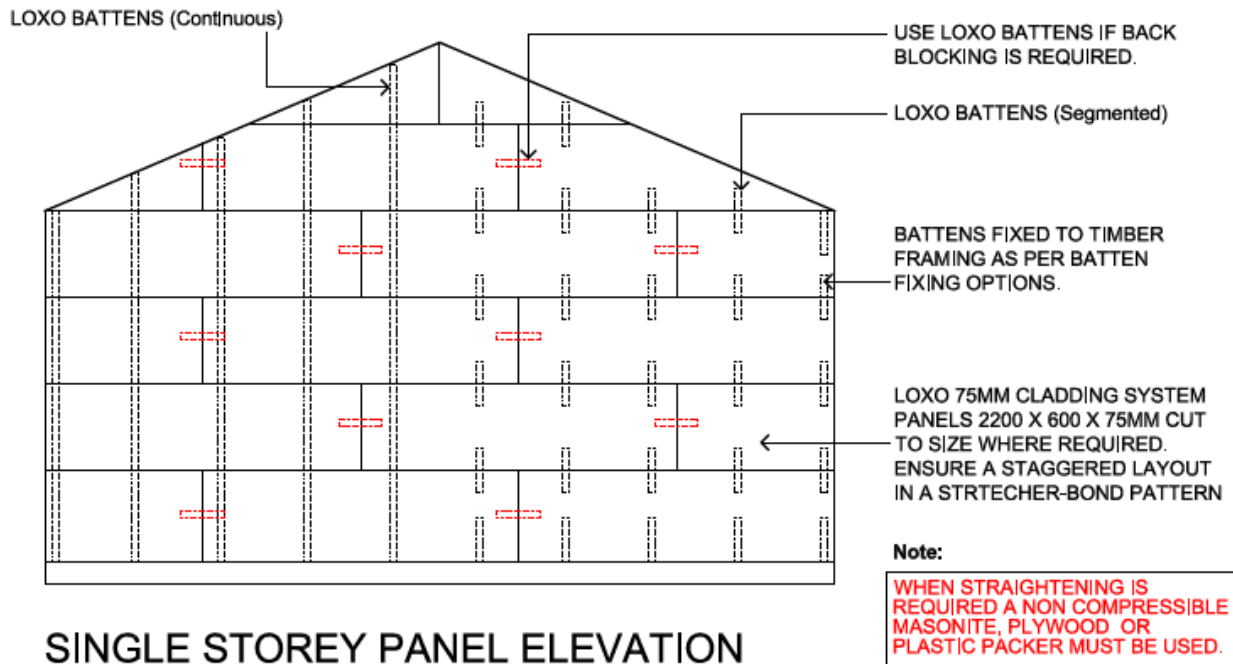


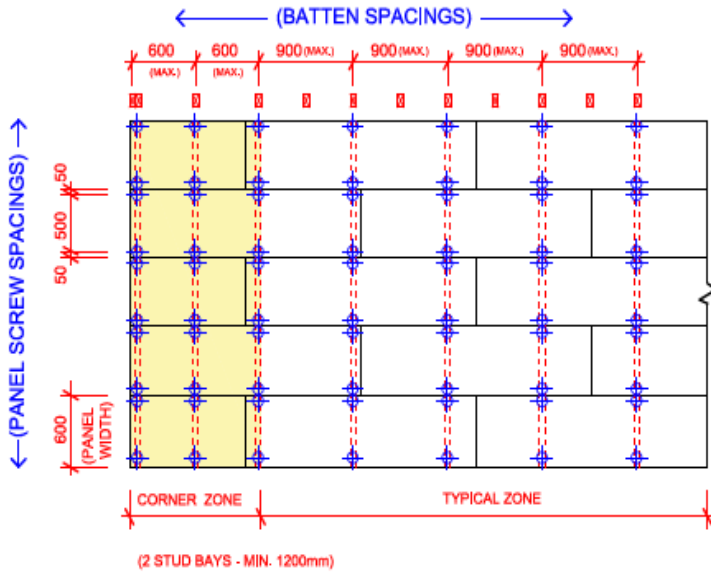

LEGEND

- DENOTES BATTENS
- ✦ DENOTES PANEL SCREWS (50mm MIN. FROM PANEL EDGE)


BATTEN & PANEL SCREW SPACINGS (WIND ZONE N2, N3, C1 DEPICTED)

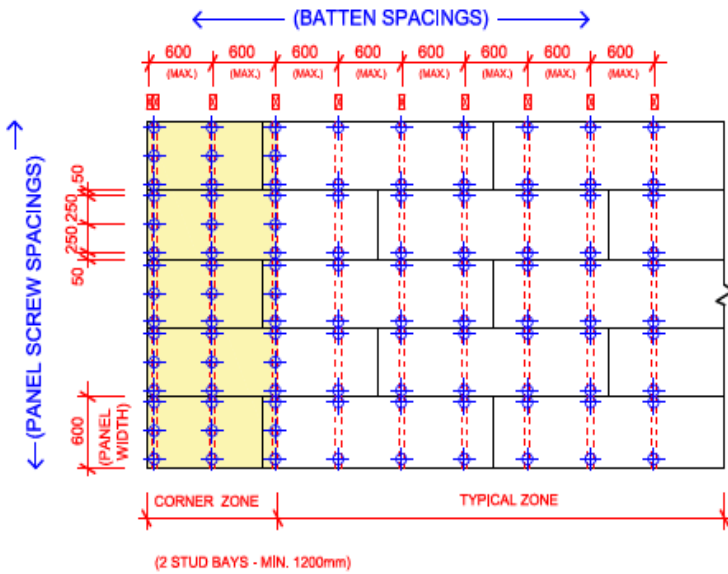

LEGEND

- DENOTES BATTENS
- ✦ DENOTES PANEL SCREWS (50mm MIN. FROM PANEL EDGE)


BATTEN & PANEL SCREW SPACINGS (WIND ZONE N4, C2 DEPICTED)

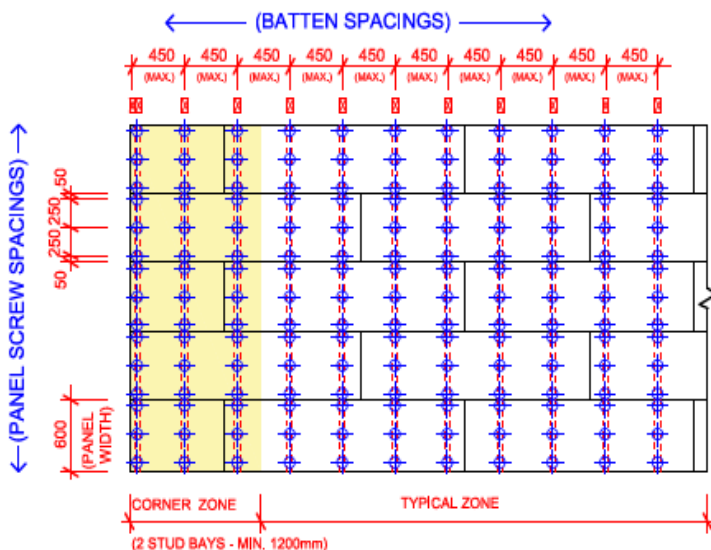


LEGEND

- DENOTES BATTENS
- ✦ DENOTES PANEL SCREWS (50mm MIN. FROM PANEL EDGE)

BATTEN & PANEL SCREW SPACINGS (WIND ZONE N5, C3 DEPICTED)

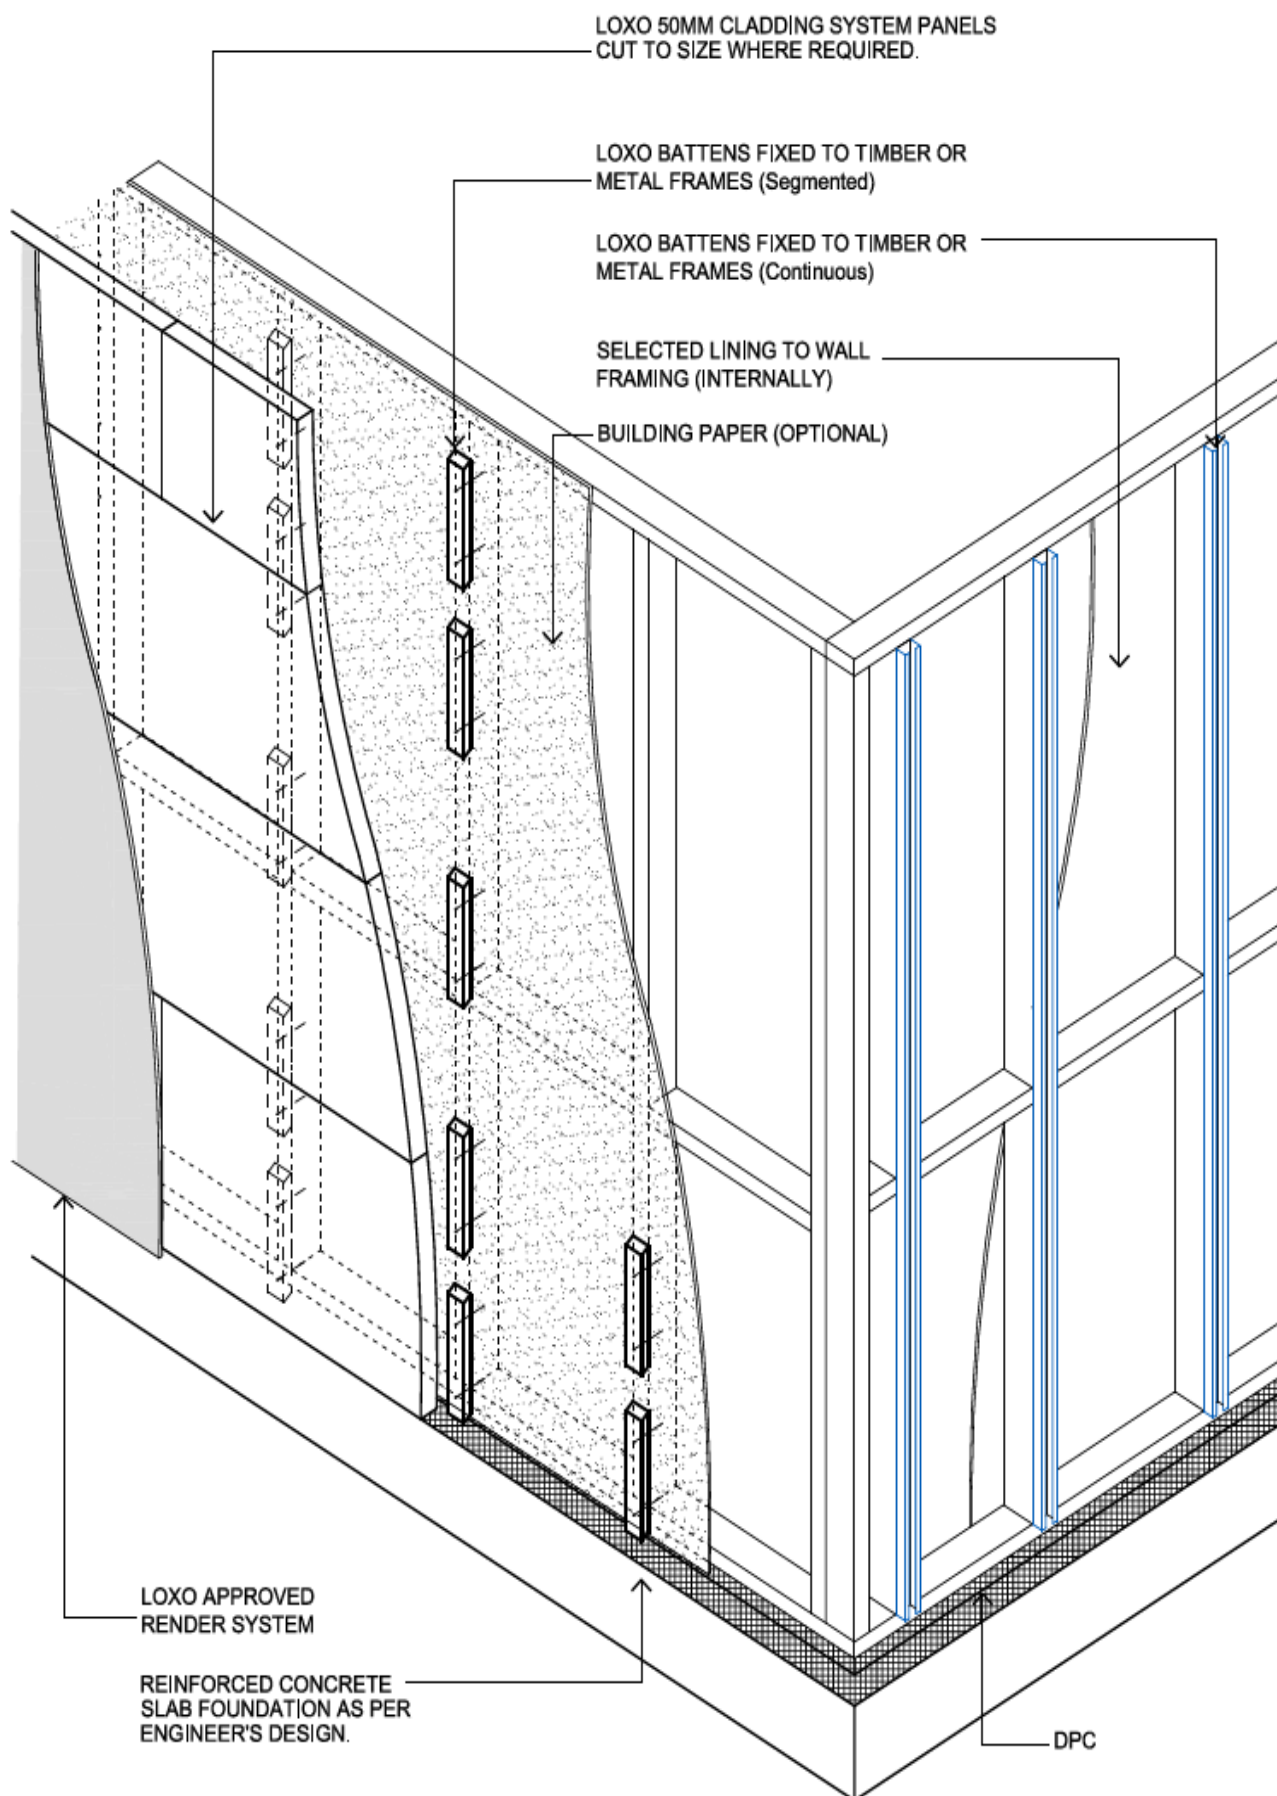


TIMBER OR METAL WALL FRAMING

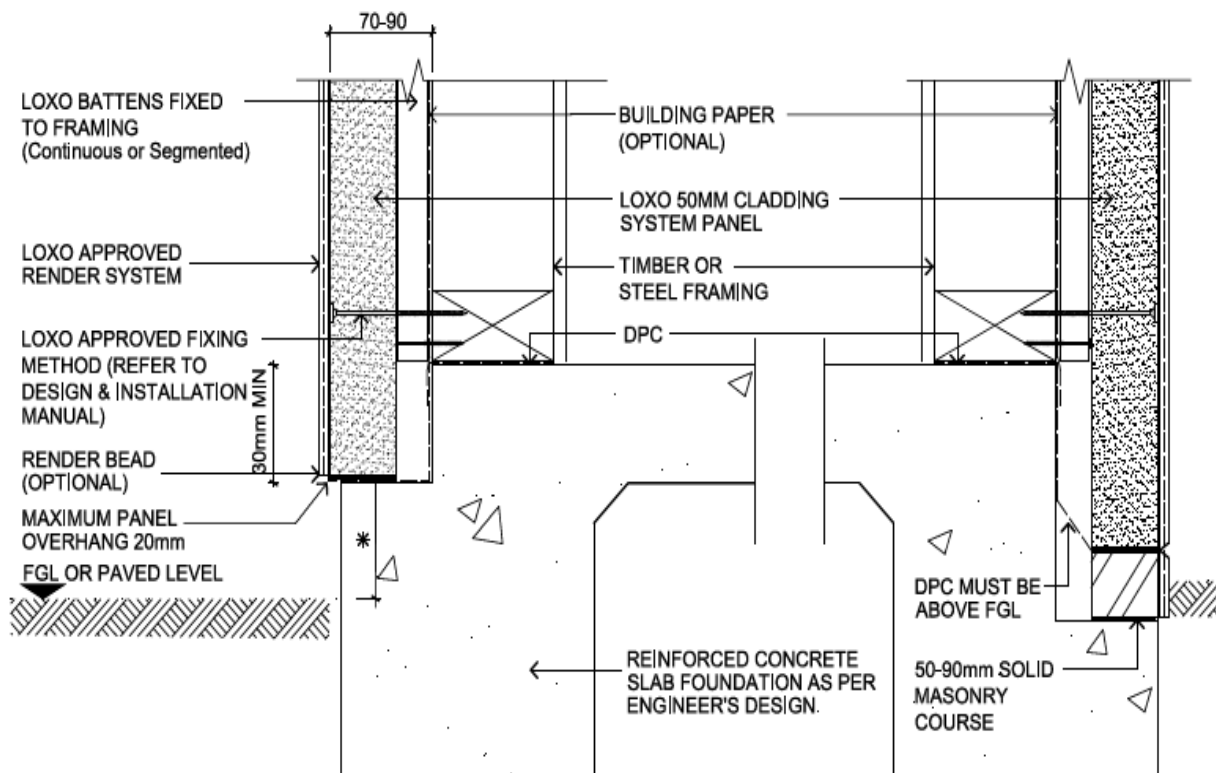



REBATED STEP-DOWN


REBATED STEP-DOWN WITH BRICK COURSE

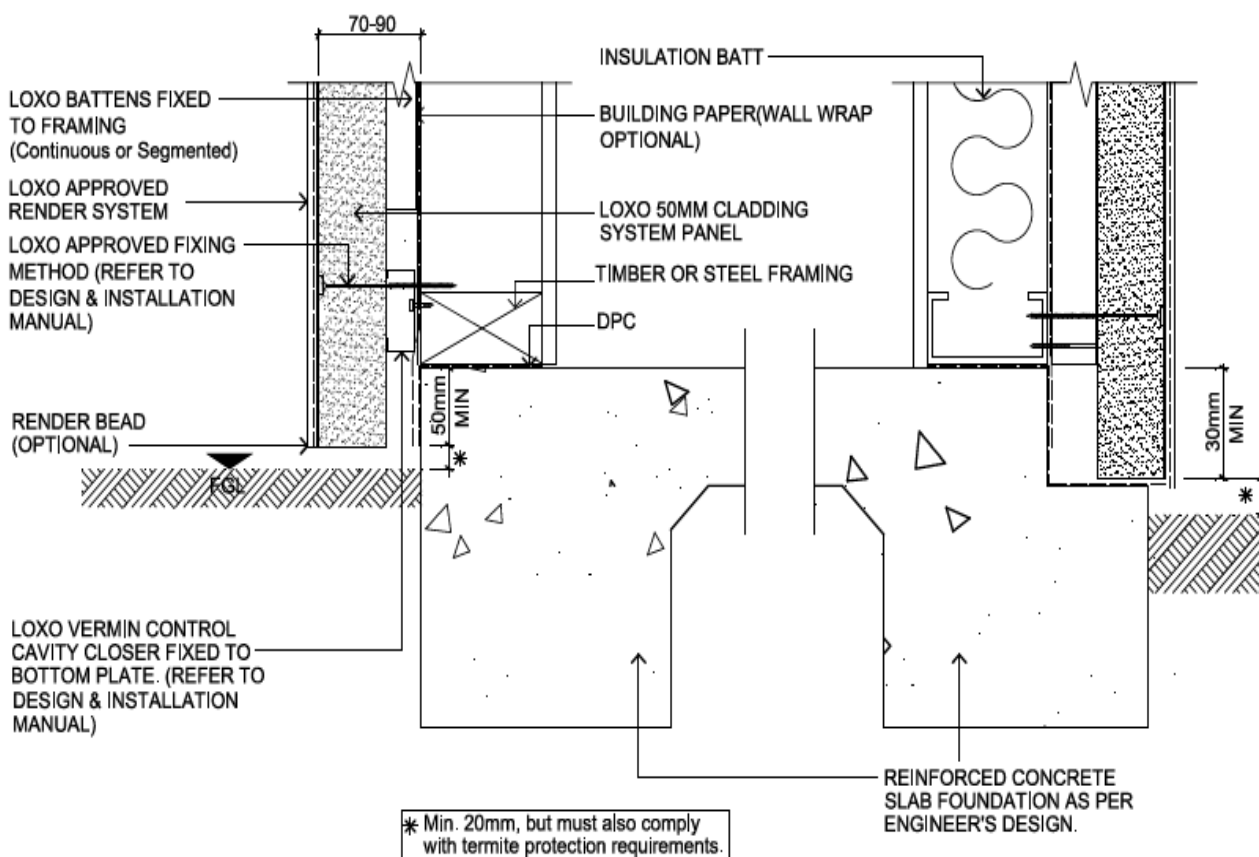

OVER-HANGING


REBATED FOUNDATION

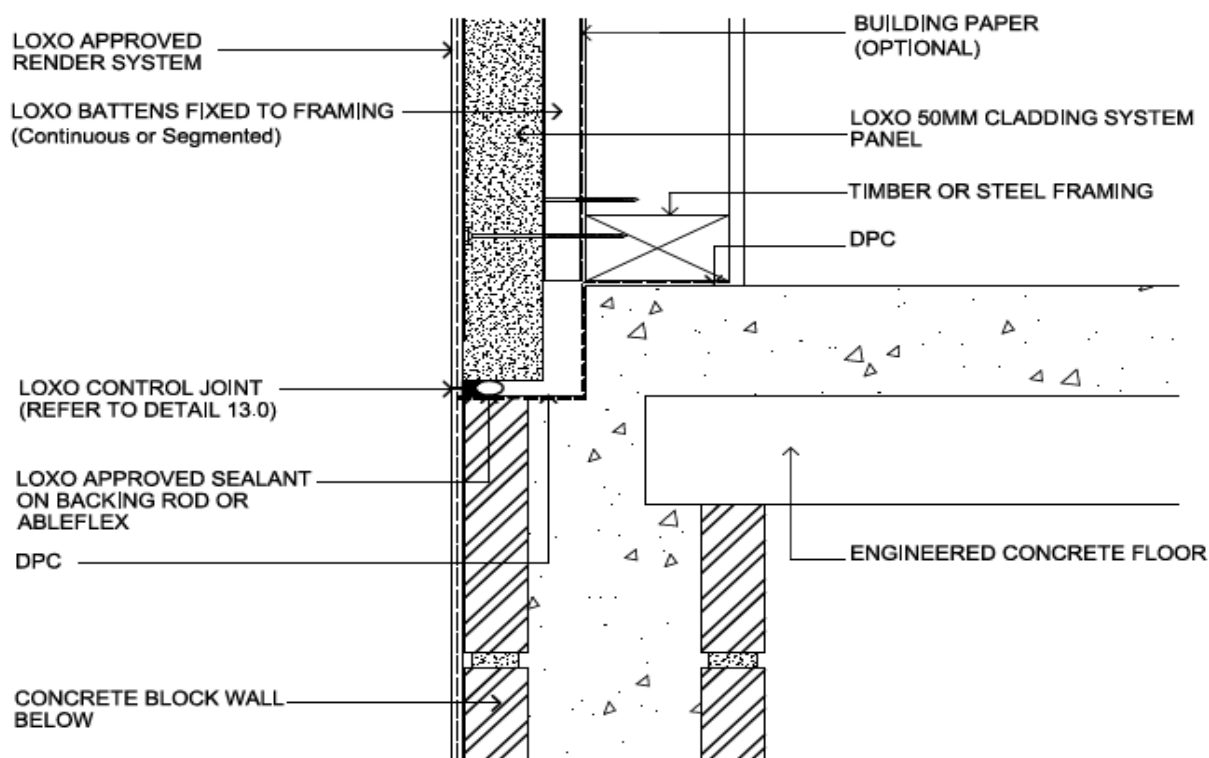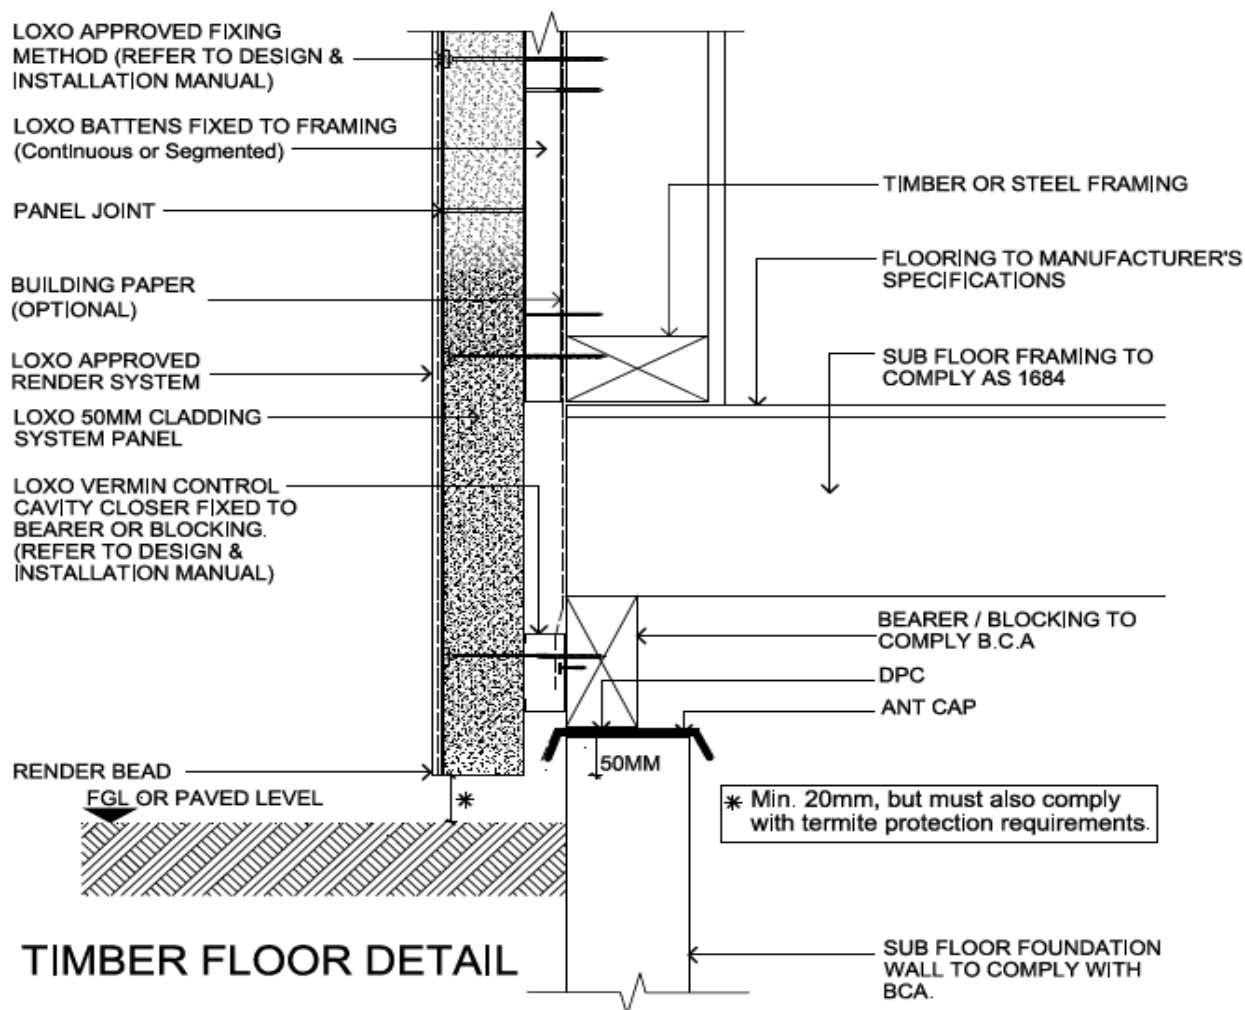

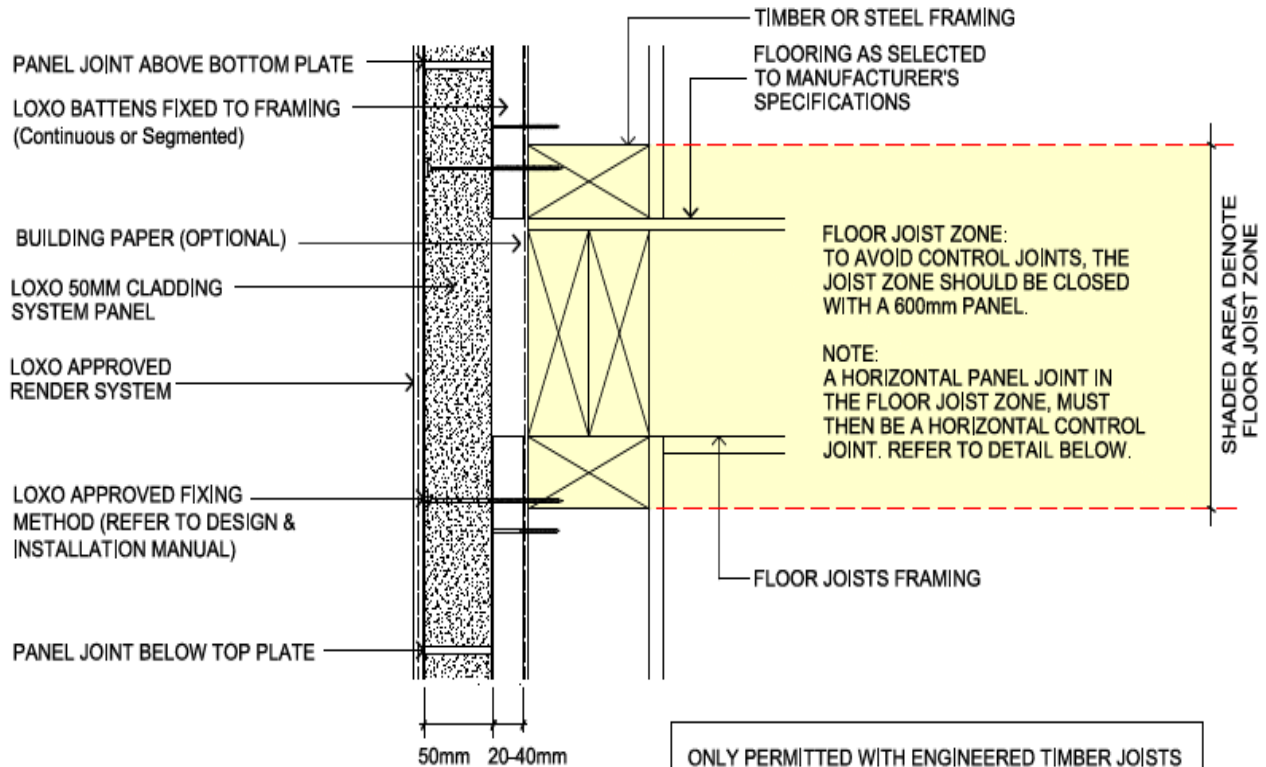

FLOOR JOIST ZONE DETAIL

(CONTINUOUS PANEL IN FLOOR JOIST ZONE)

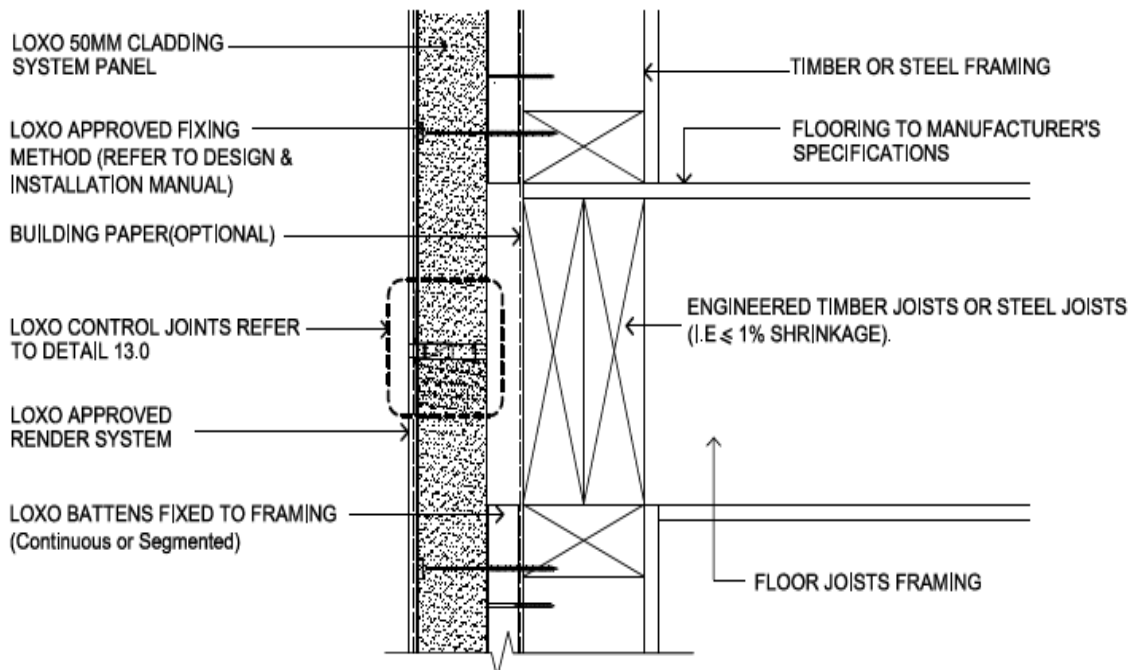


FLOOR JOIST ZONE DETAIL


(CONTROL JOINT IN FLOOR JOIST ZONE)


REQUIRED WHEN THE PANEL JOINT IS WITHIN THE FLOOR JOIST ZONE.

Detail A Exposed Edge Beam

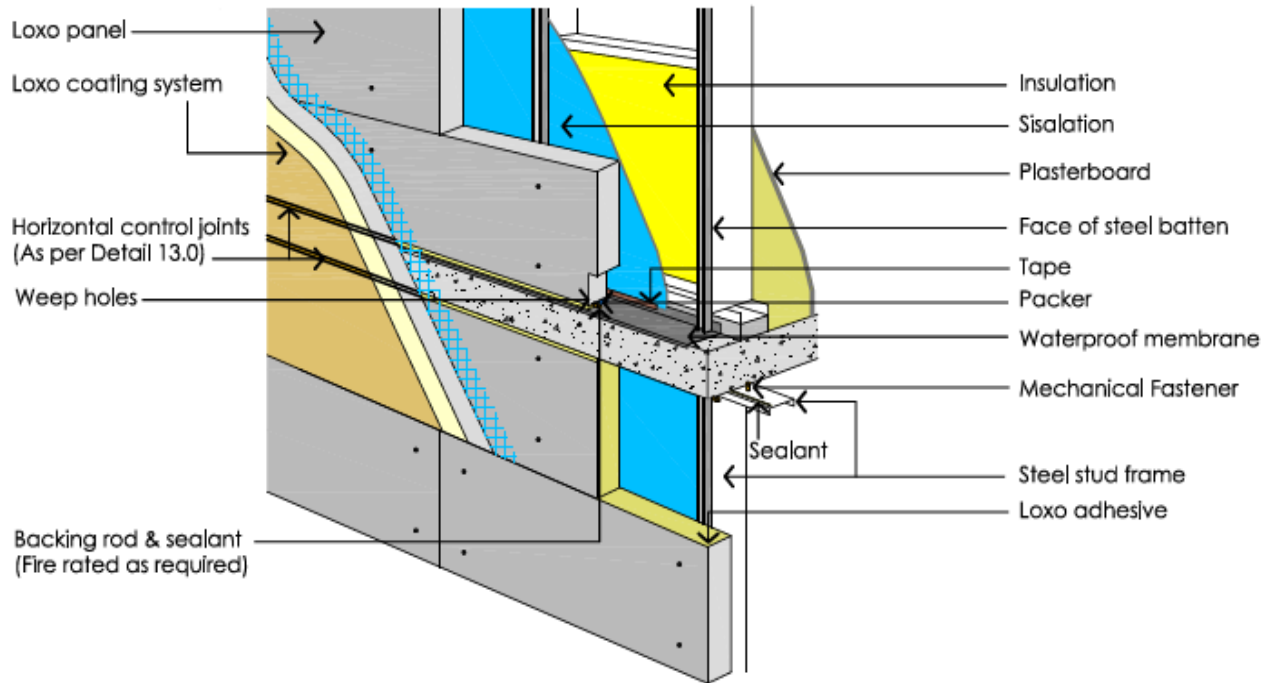


Detail B Concealed Edge Beam

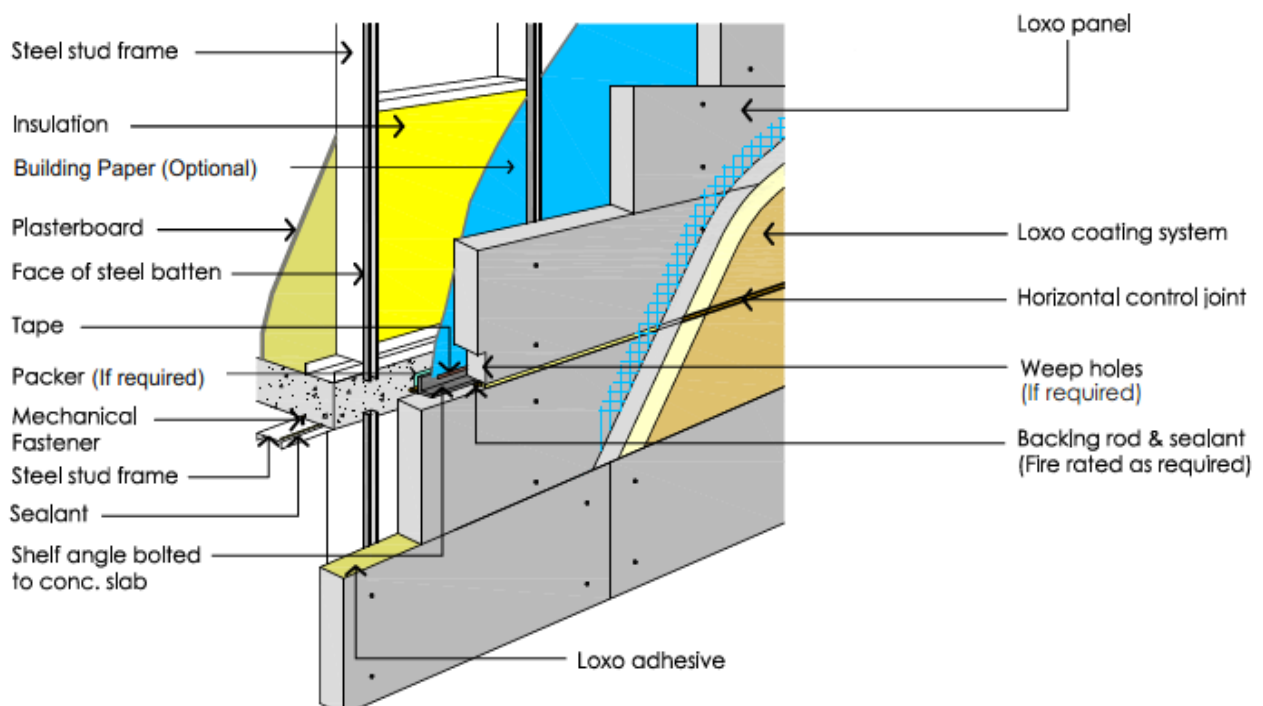


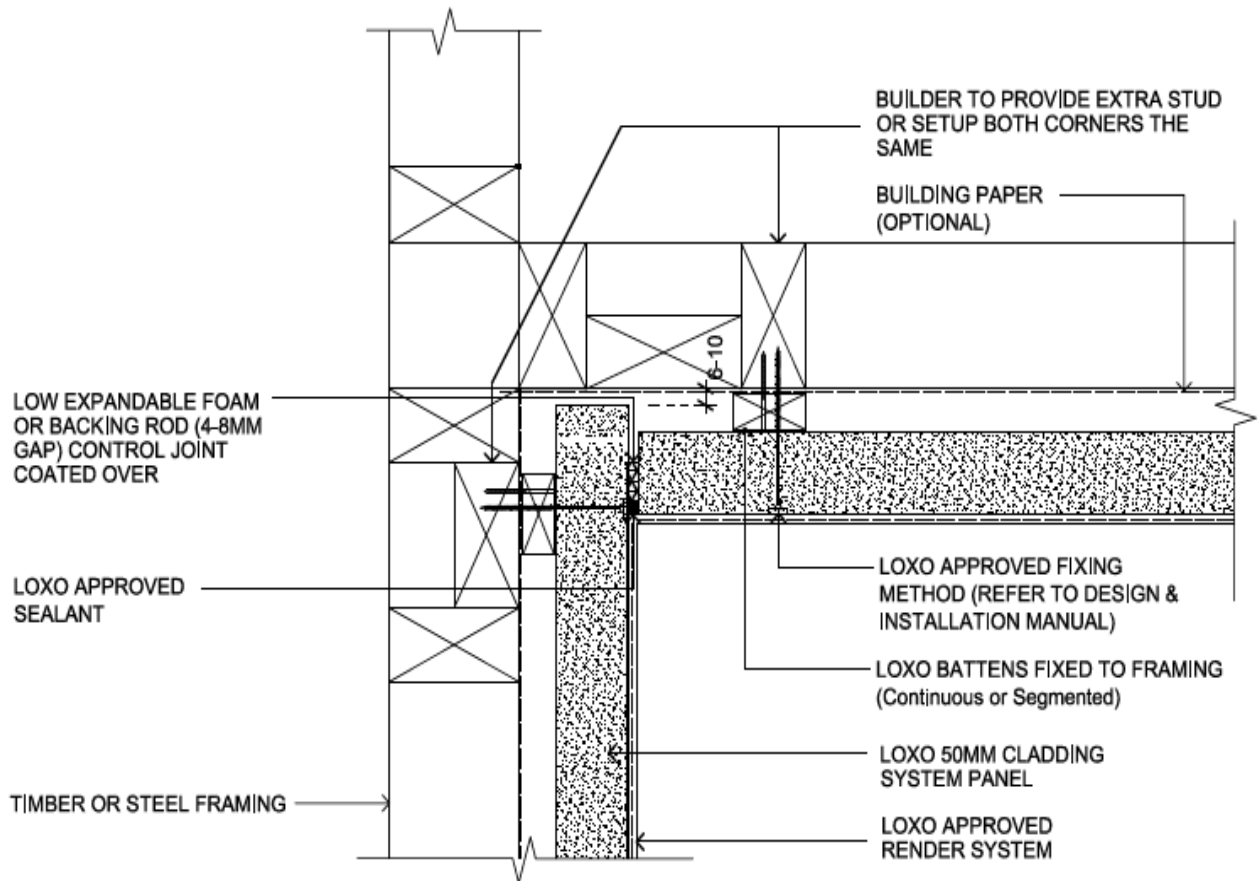


INTERNAL CORNER JUNCTION

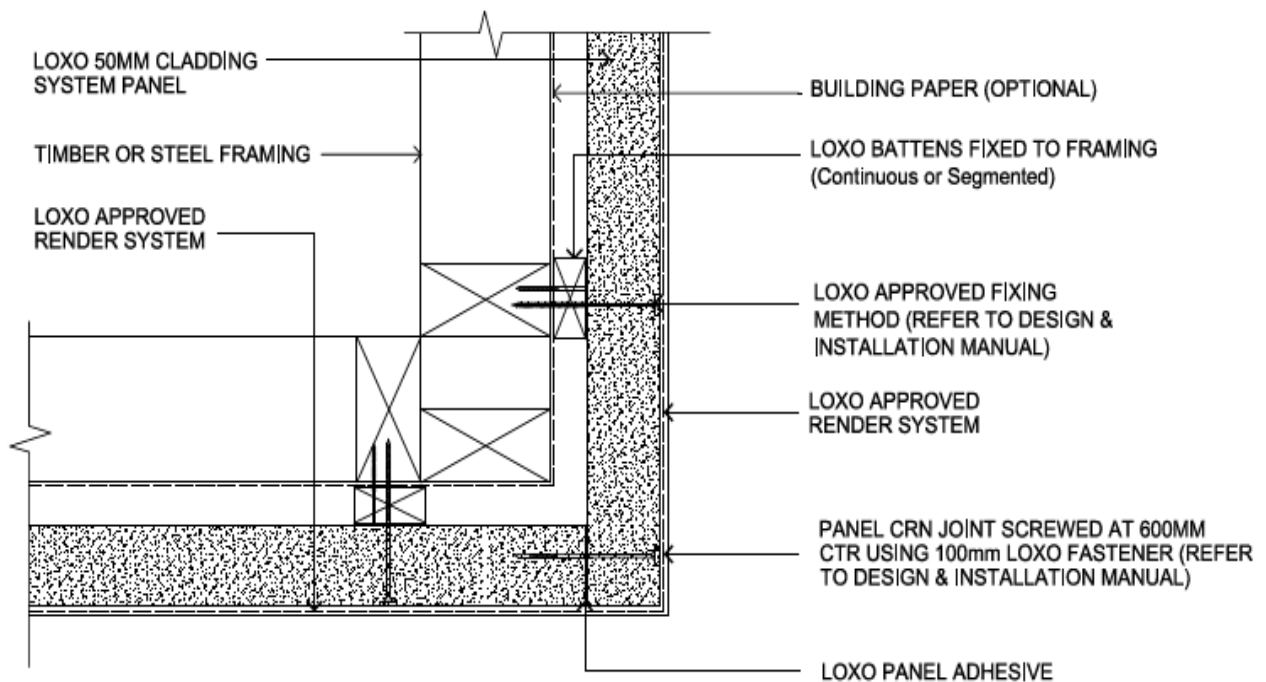


EXTERNAL CORNER JUNCTION

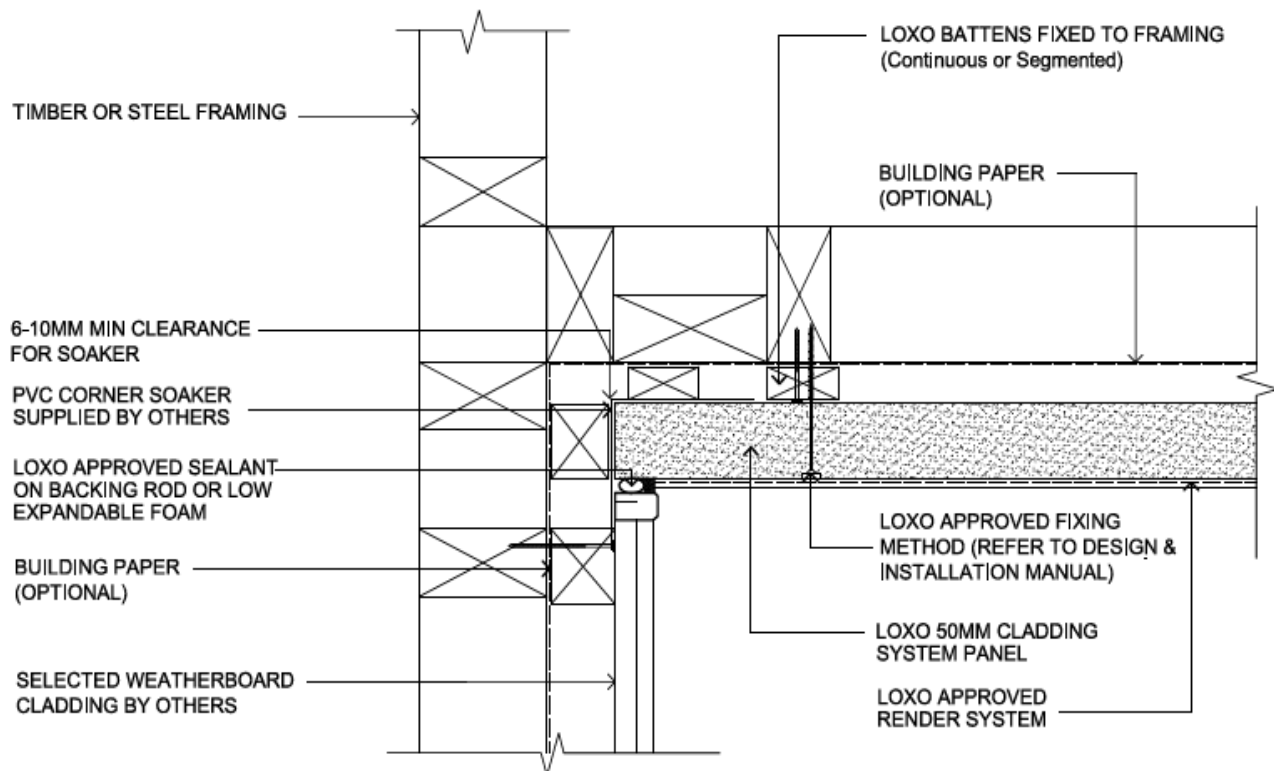


PANEL TO WEATHERBOARD INTERNAL CORNER JUNCTION

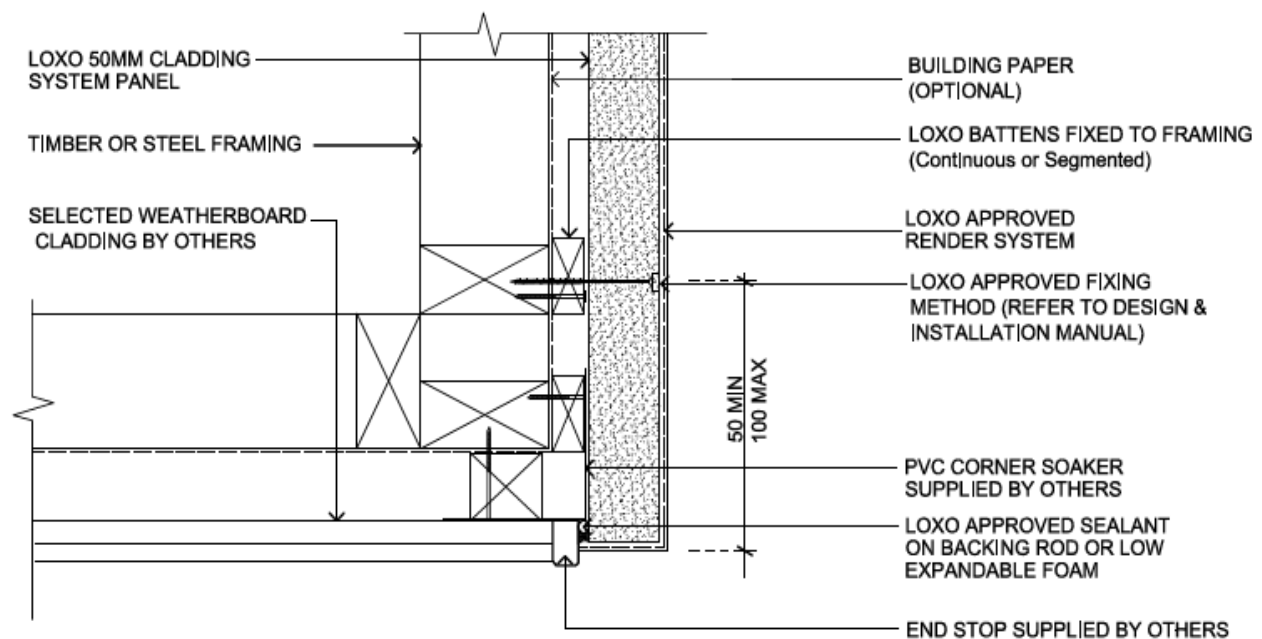


PANEL TO WEATHERBOARD EXTERNAL CORNER JUNCTION

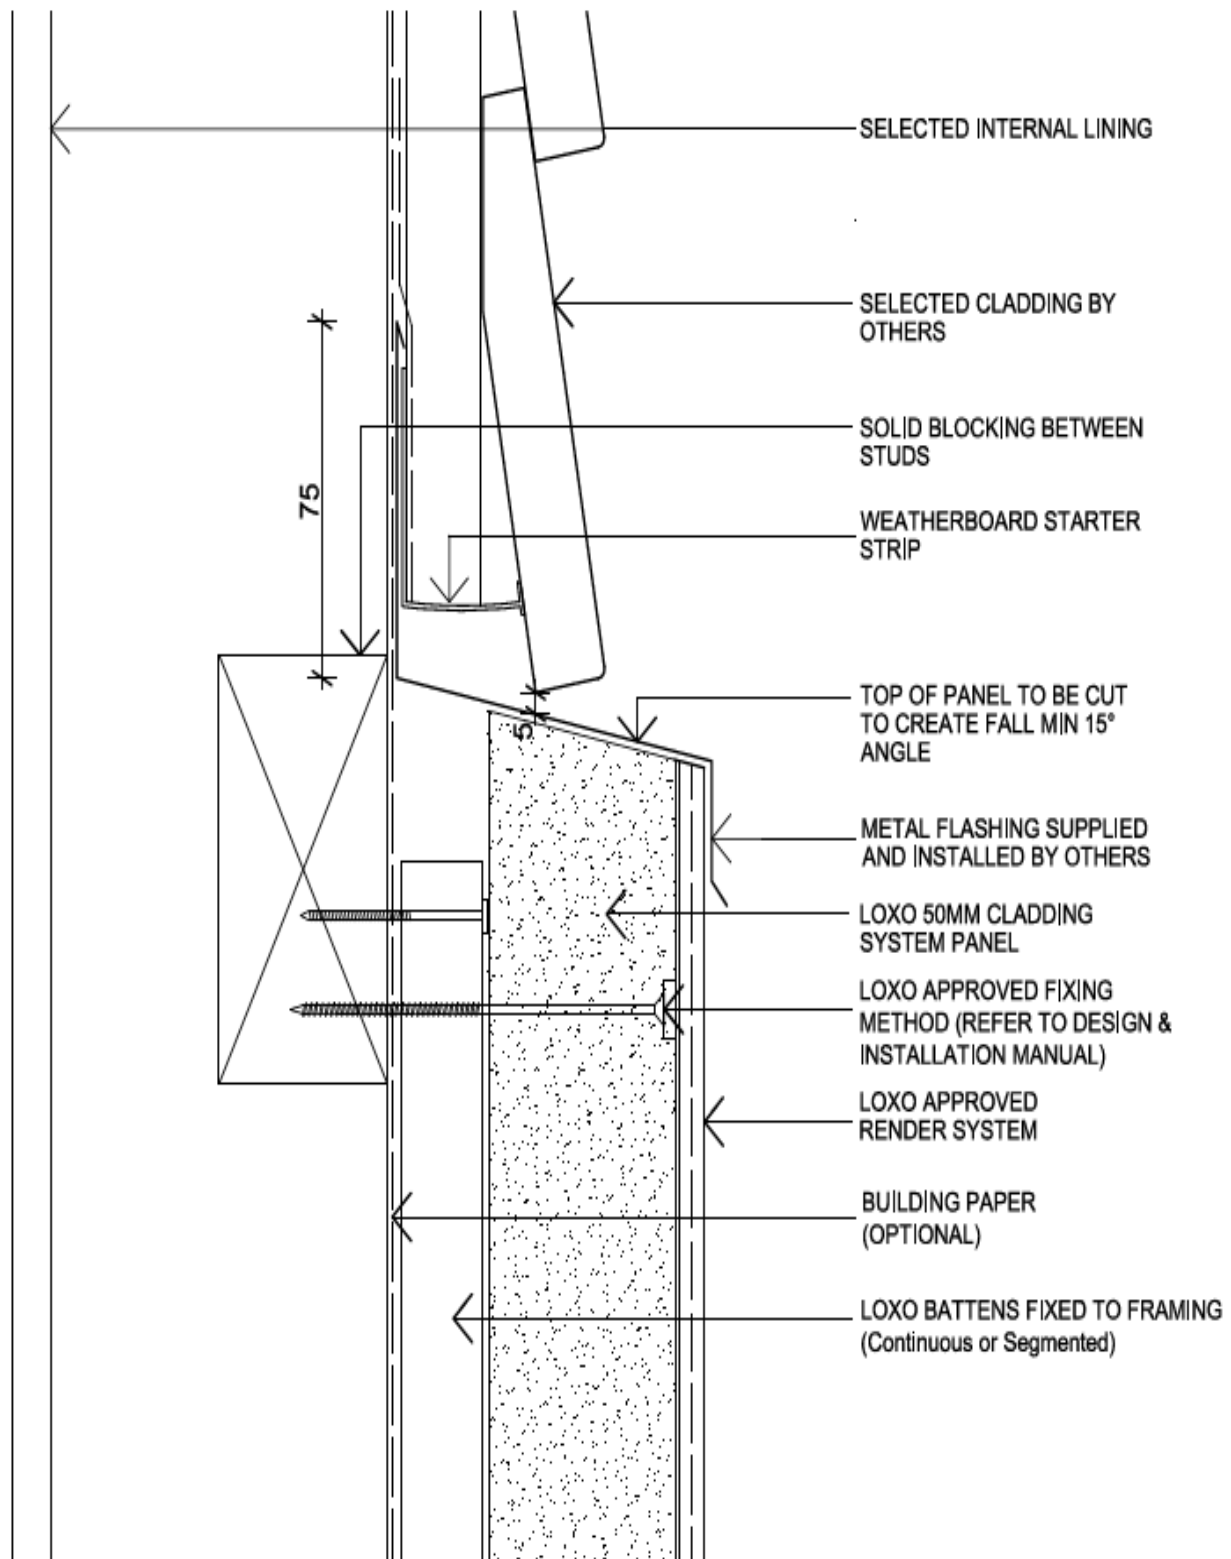


FIRST FLOOR CLADDING CHANGE DETAIL

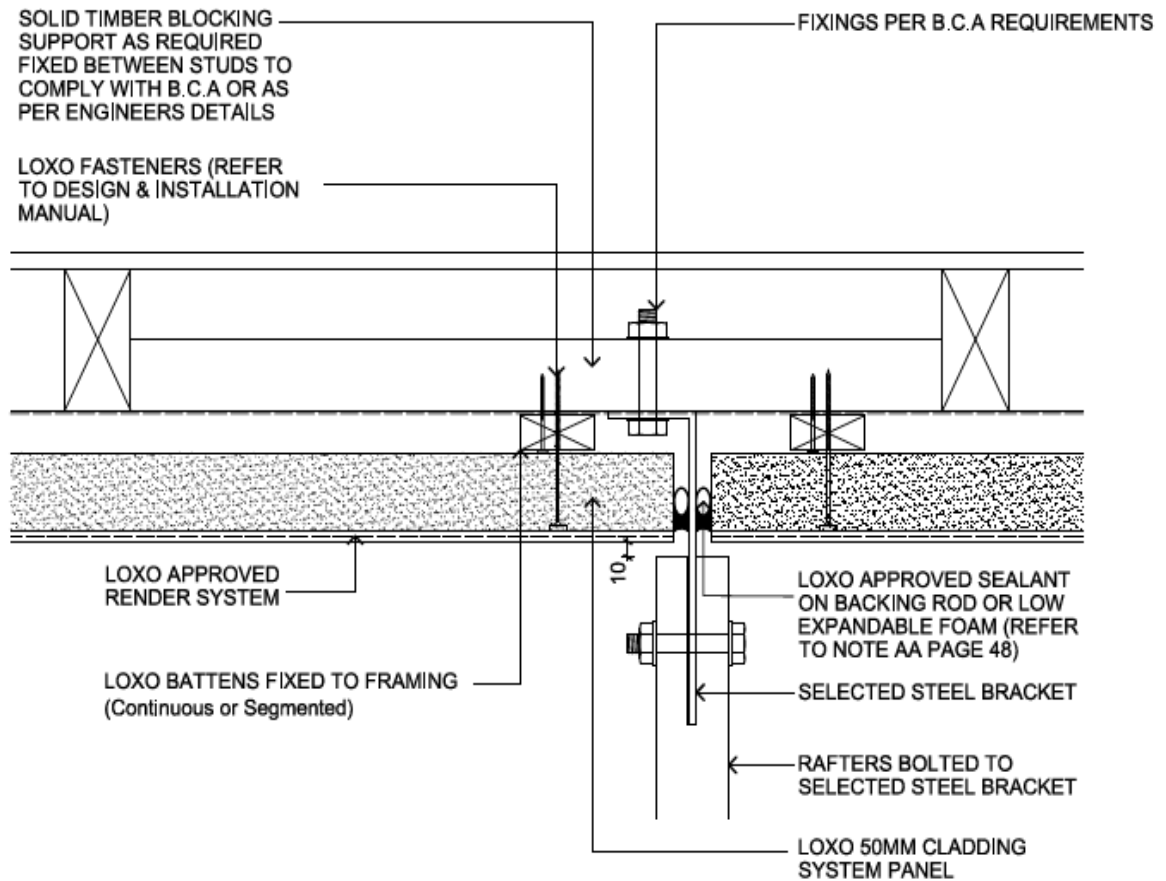


BRACKET / WALL JUNCTION PLAN

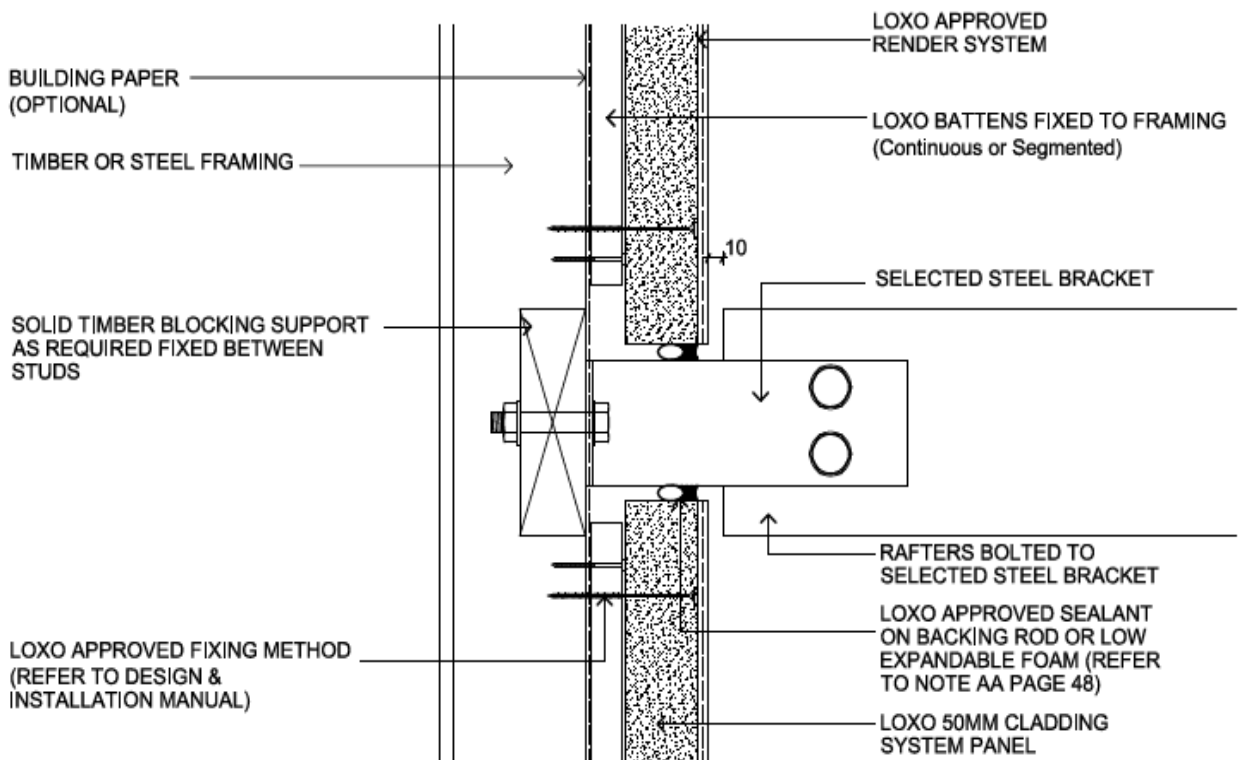




BRACKET / WALL JUNCTION SECTION

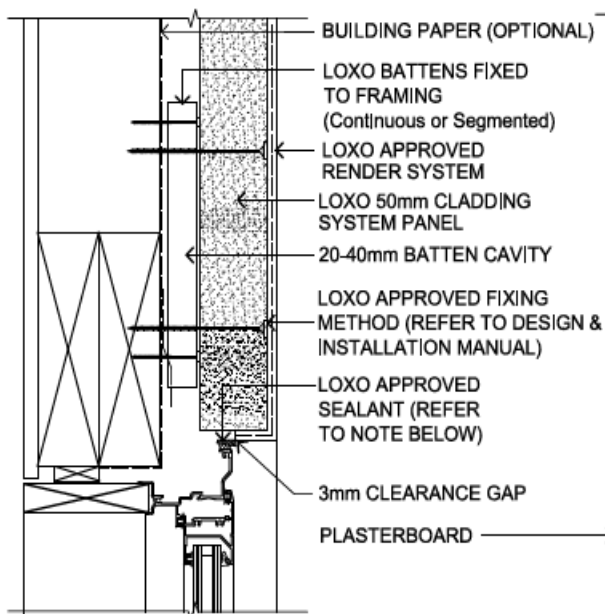


HEAD DETAIL

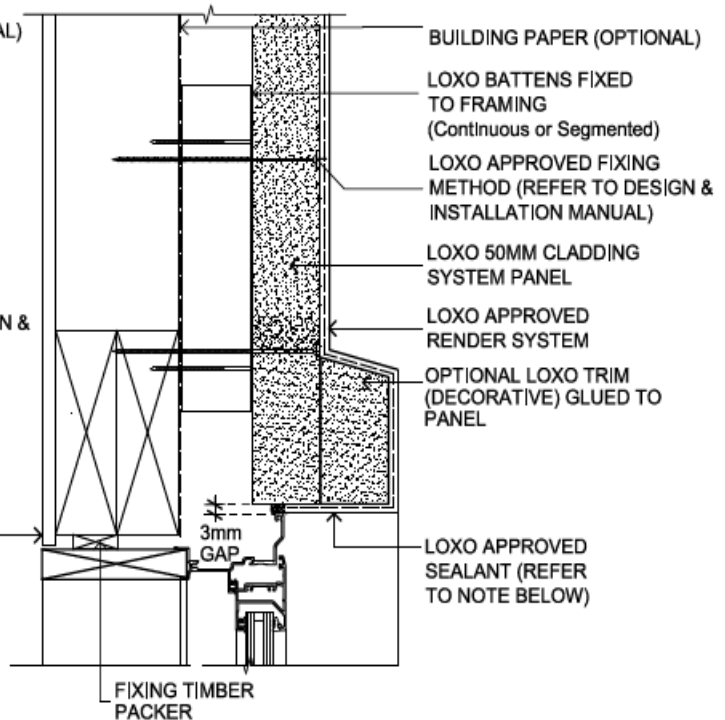

JAMB DETAIL

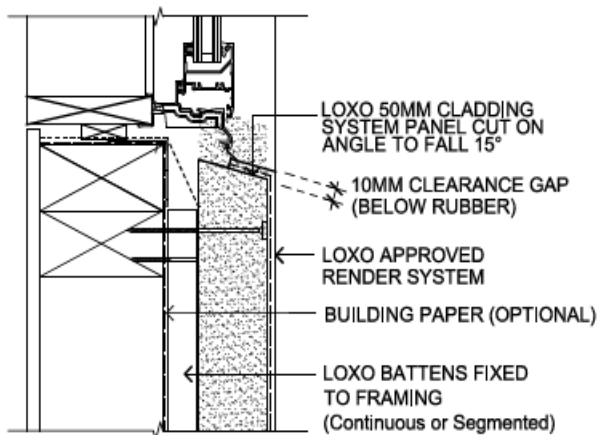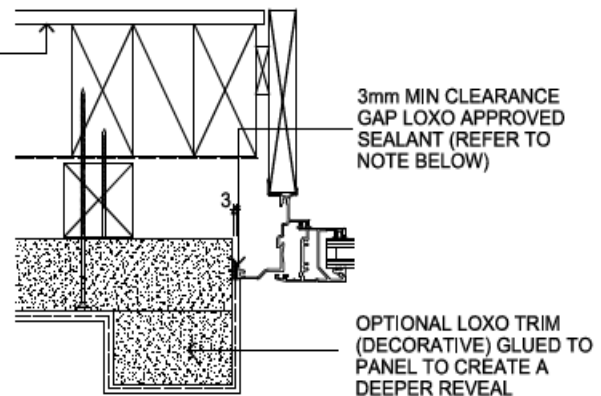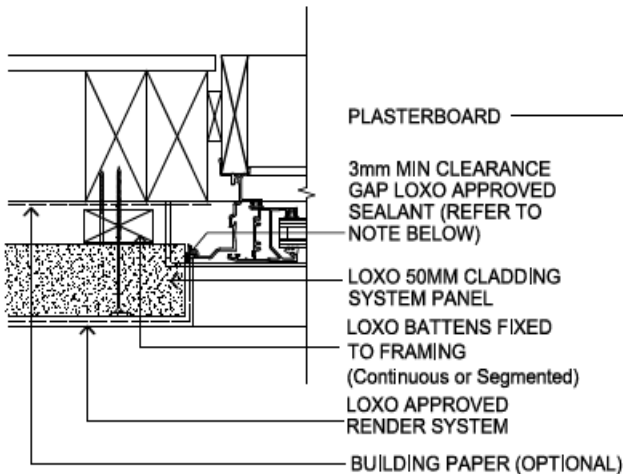


SILL DETAIL

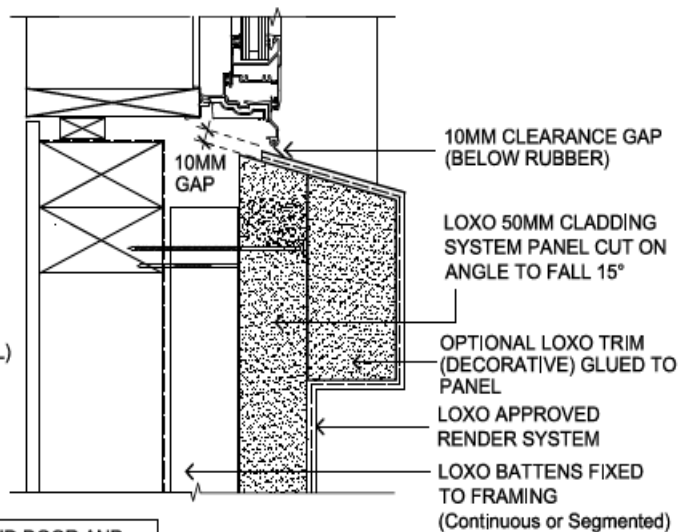


NOTE:


SEALANT REQUIRED AROUND DOOR AND WINDOWS IN COASTAL AREAS ($\leq 1000M$ FROM WATER AND IN WIND ZONE ($\geq N4, C2$))

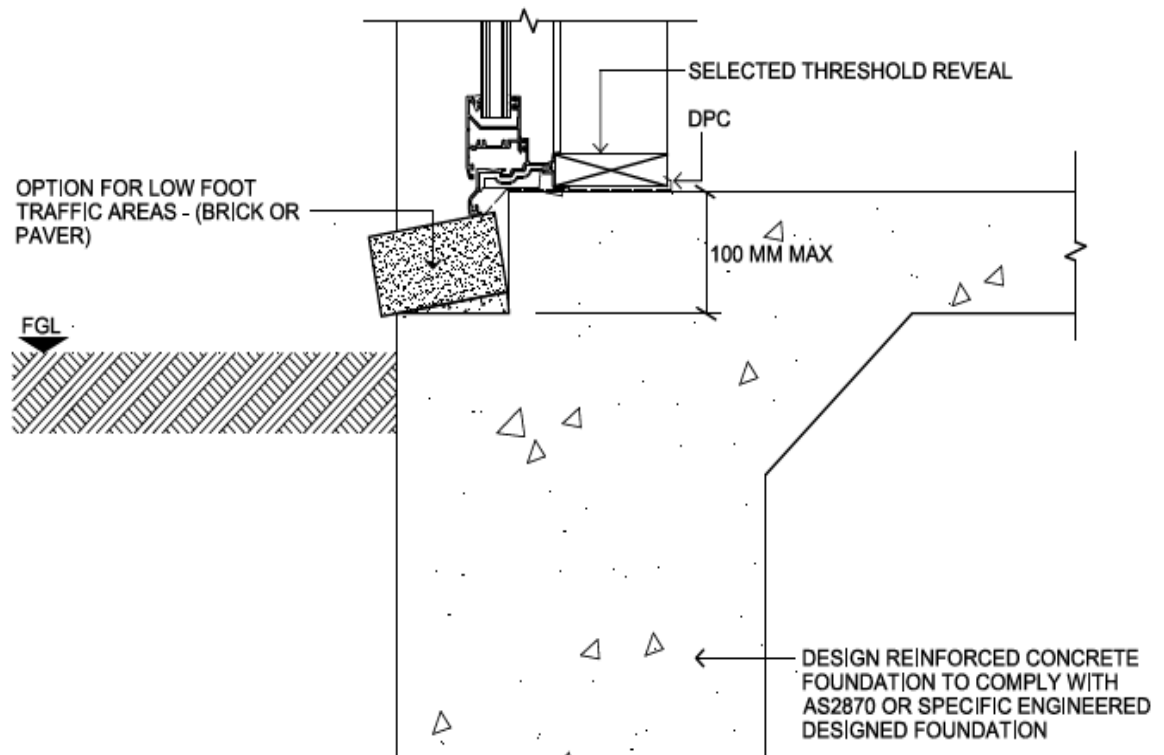

OPTION A

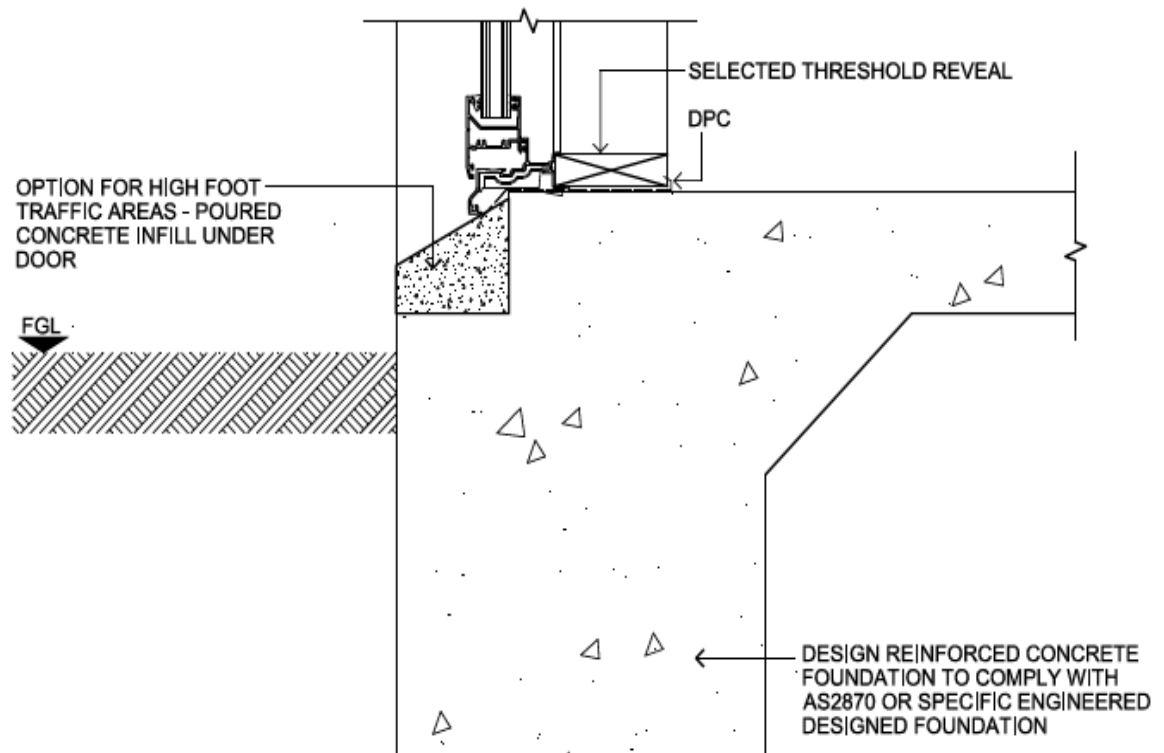


OPTION B

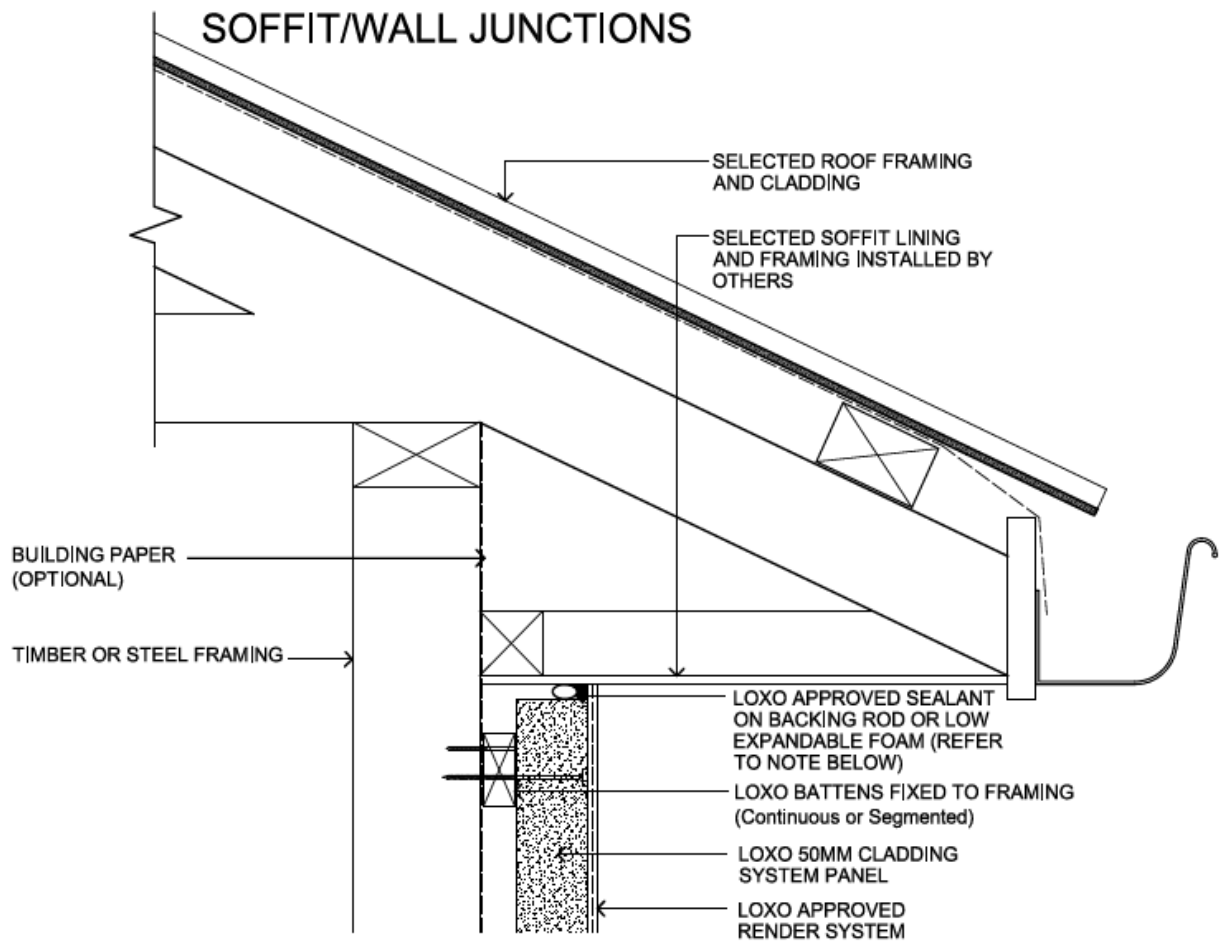


SOFFIT / WALL JUNCTION

NOTE:

SEALANT REQUIRED IN COASTAL AREAS
($\leq 1000\text{M}$ FROM WATER AND IN WIND
ZONE ($\geq \text{N4, C2}$))

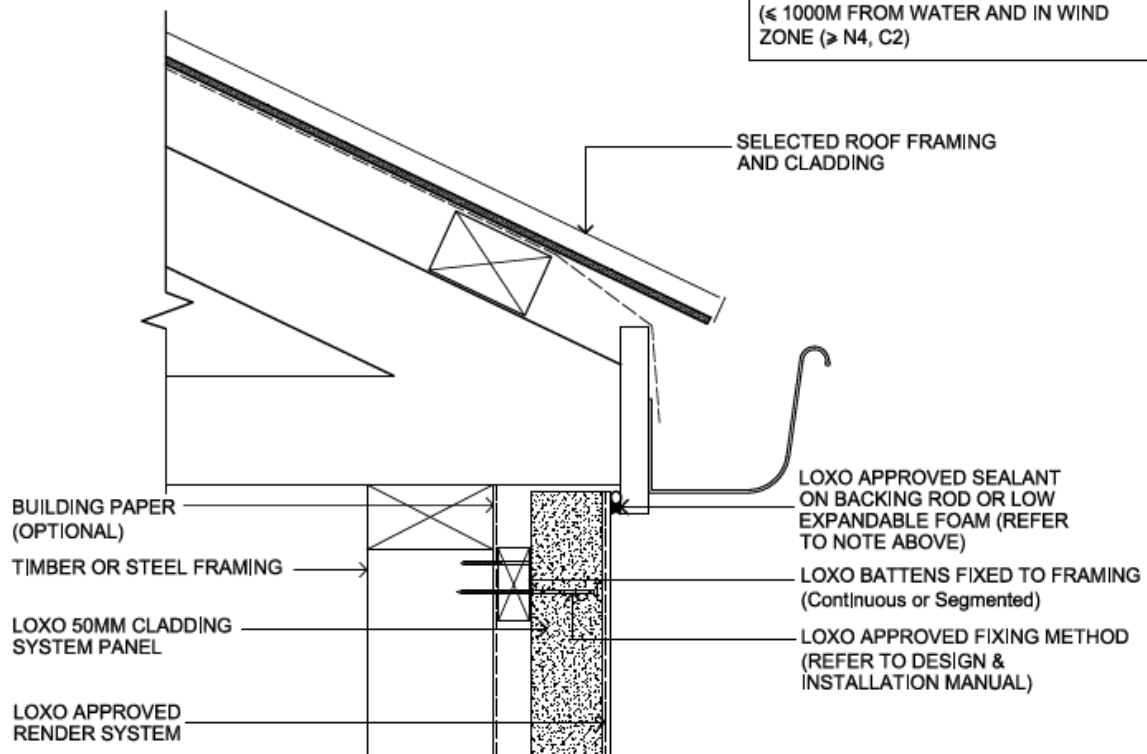


SOFFIT / WALL JUNCTION

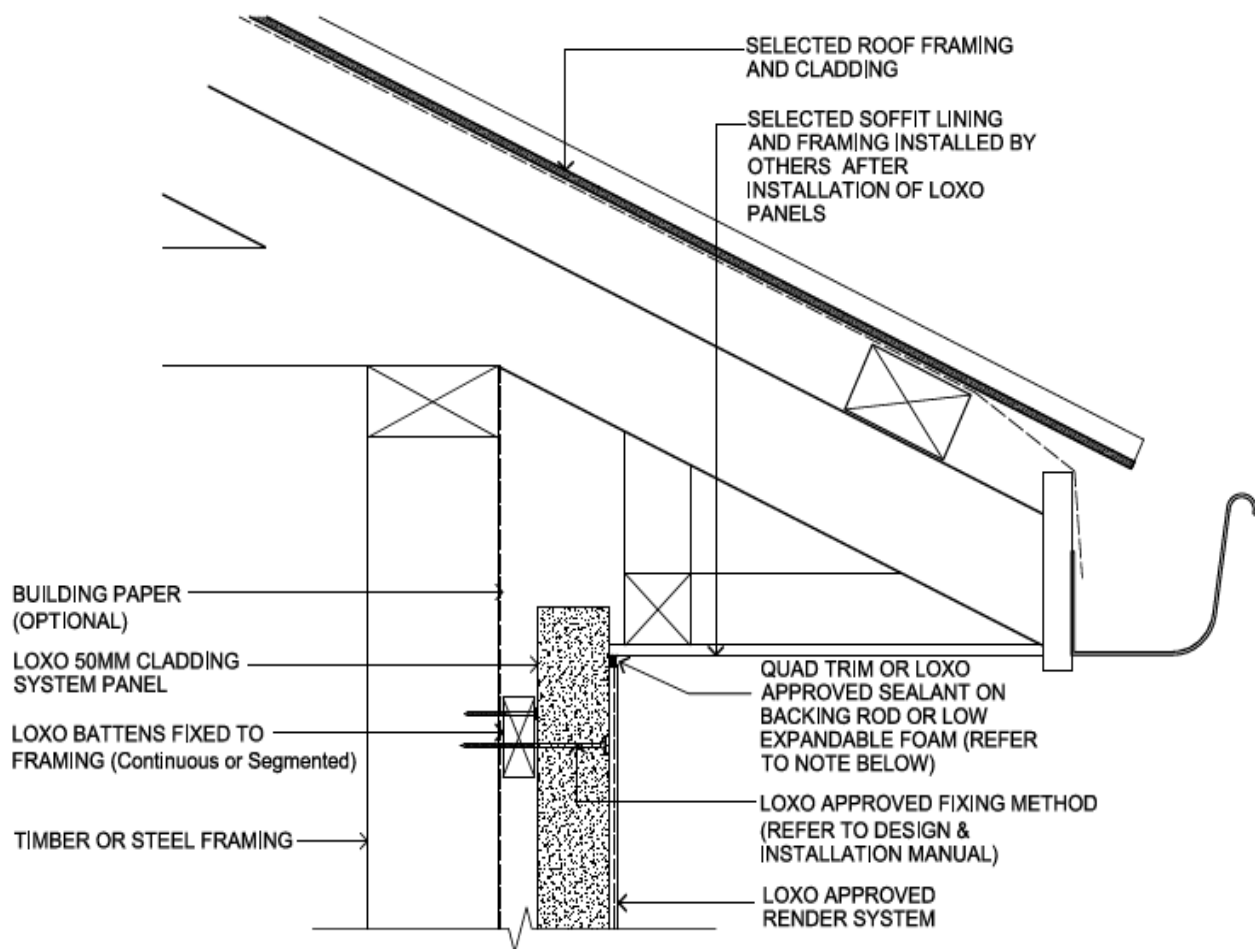


SOFFIT / WALL JUNCTION

NOTE:

SEALANT REQUIRED IN COASTAL AREAS
($\leq 1000\text{M}$ FROM WATER AND IN WIND
ZONE $\geq \text{N4, C2}$)

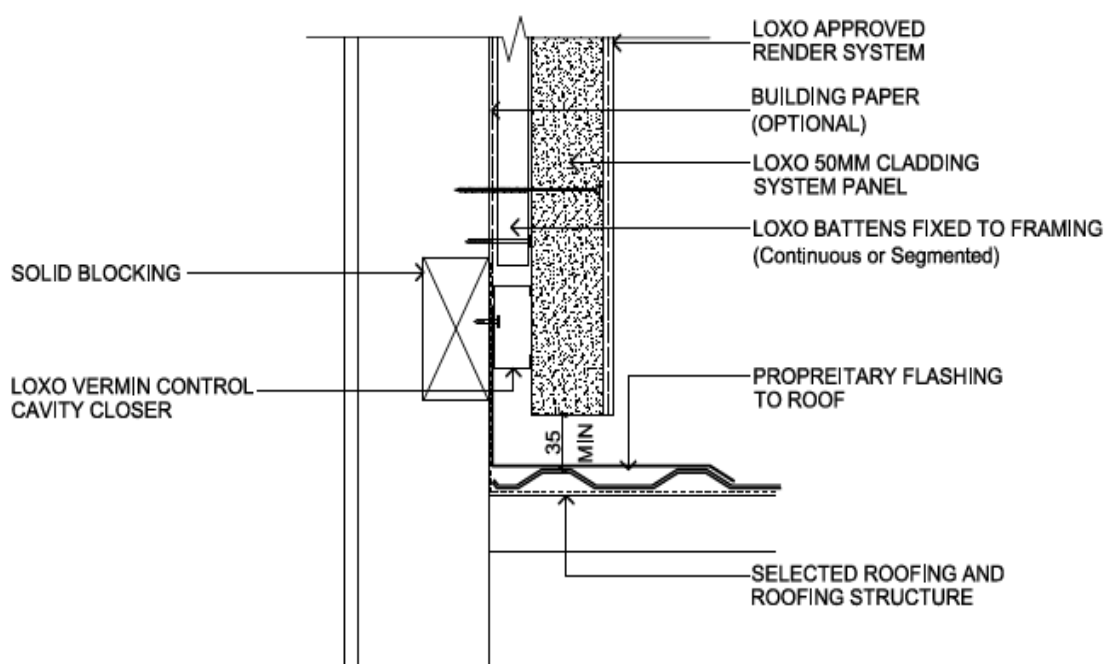


ROOF / WALL JUNCTION

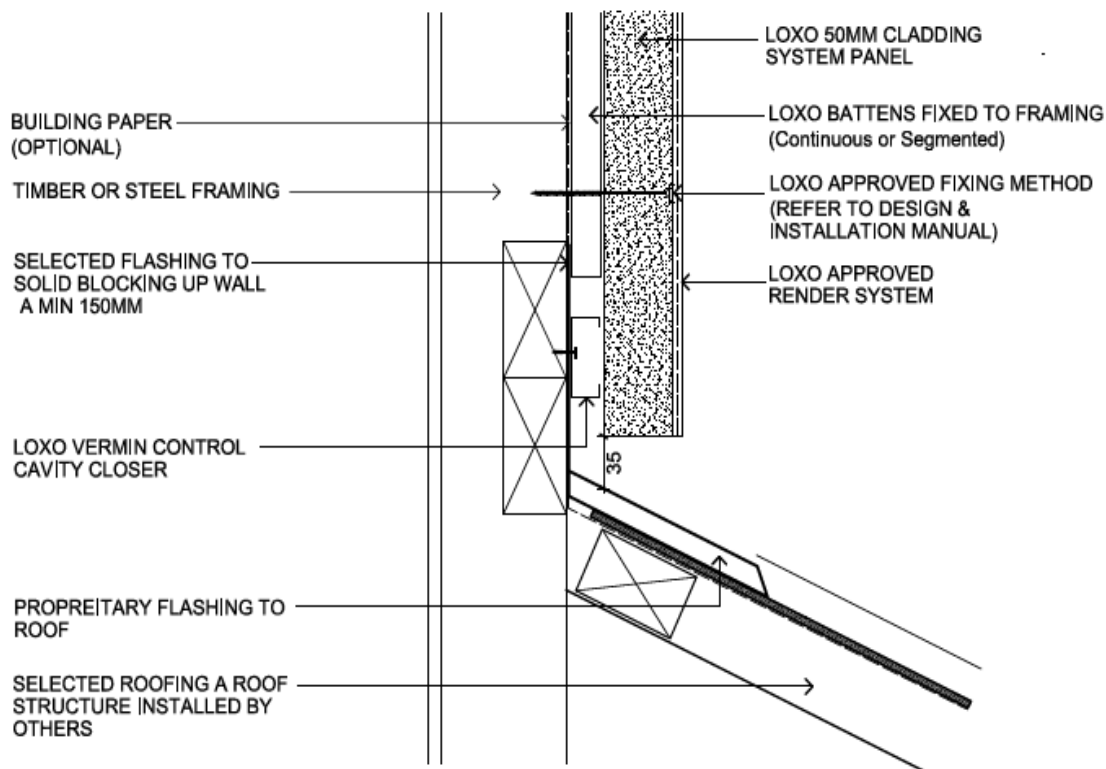


ROOF / WALL JUNCTION

NOTE:

SEALANT REQUIRED IN COASTAL AREAS
($\leq 1000\text{M}$ FROM WATER AND IN WIND
ZONE ($\geq \text{N4, C2}$))

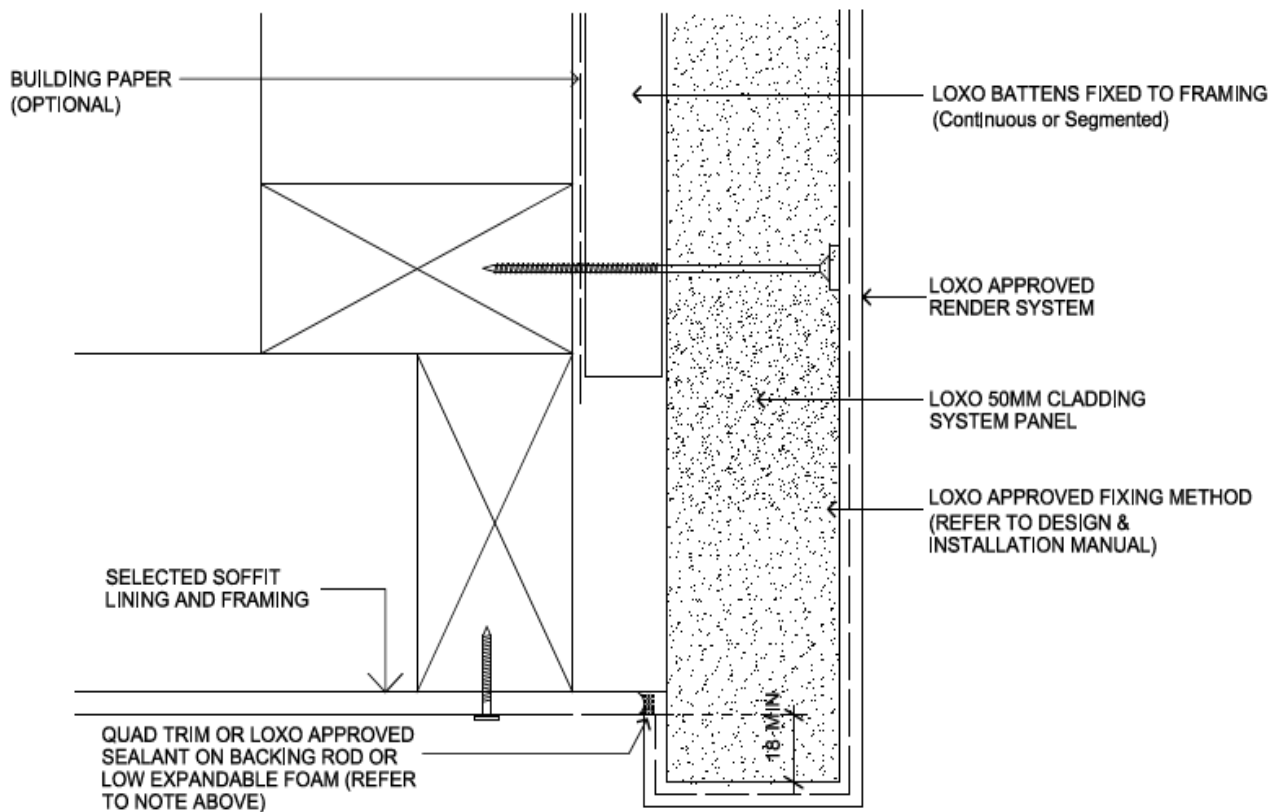


SOFFIT / WALL JUNCTION

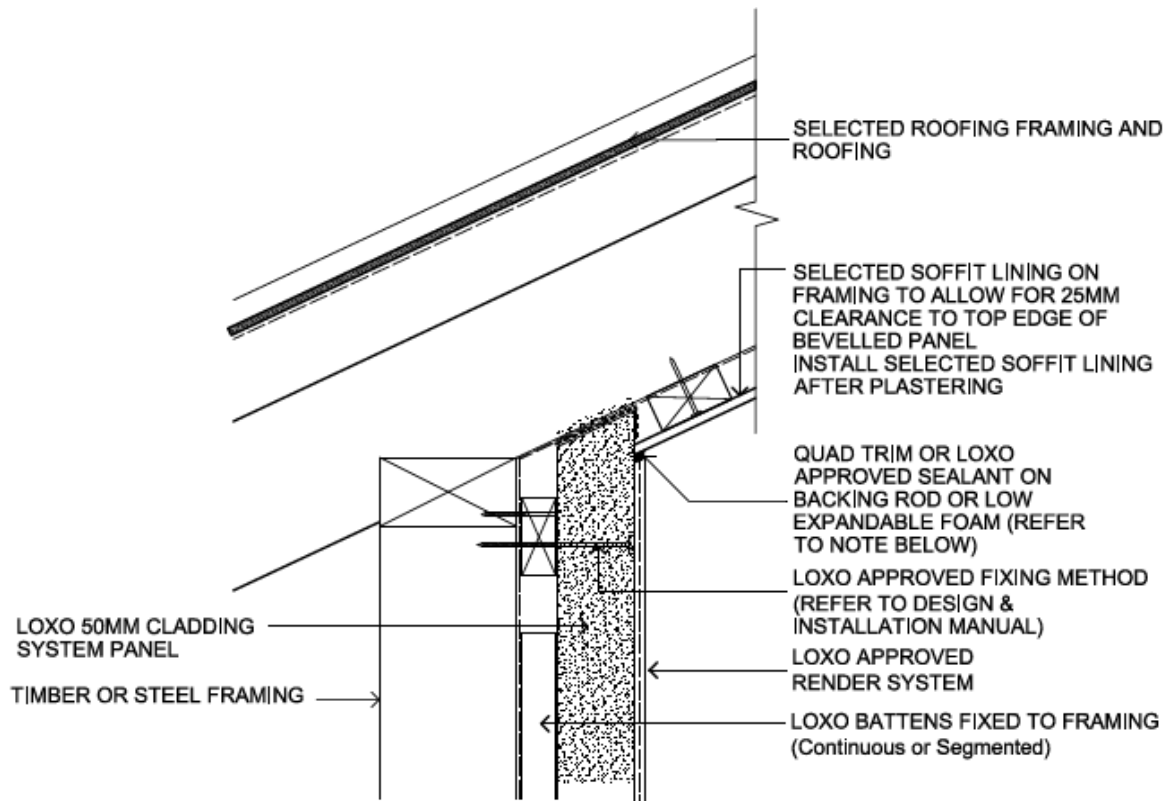



MONOPITCHED EXPOSED SOFFIT / WALL JUNCTION

NOTE:


SEALANT REQUIRED IN COASTAL AREAS
($\leq 1000\text{M}$ FROM WATER AND IN WIND
ZONE $\geq \text{N4, C2}$)

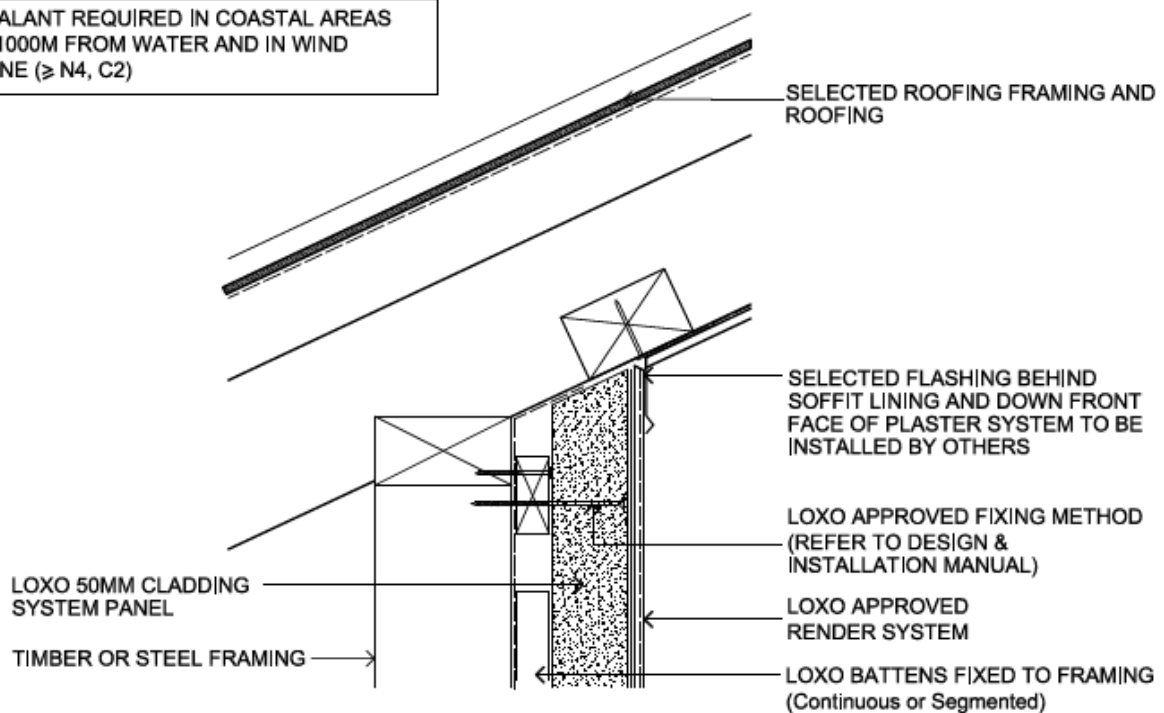

MONOPITCHED EXPOSED SOFFIT / WALL JUNCTION (Metal Flashing)

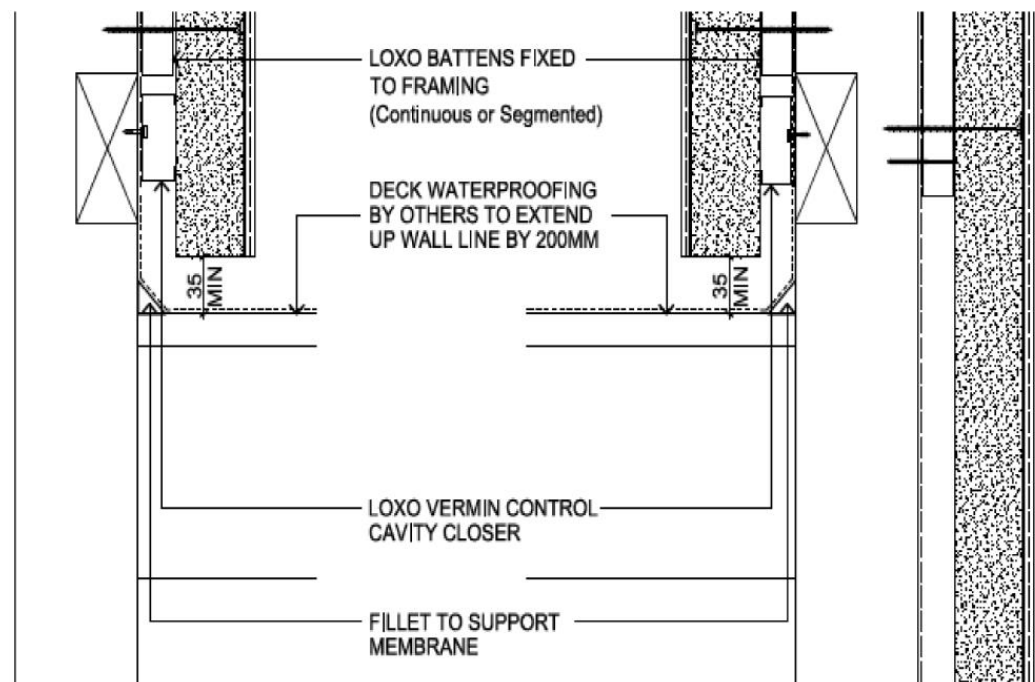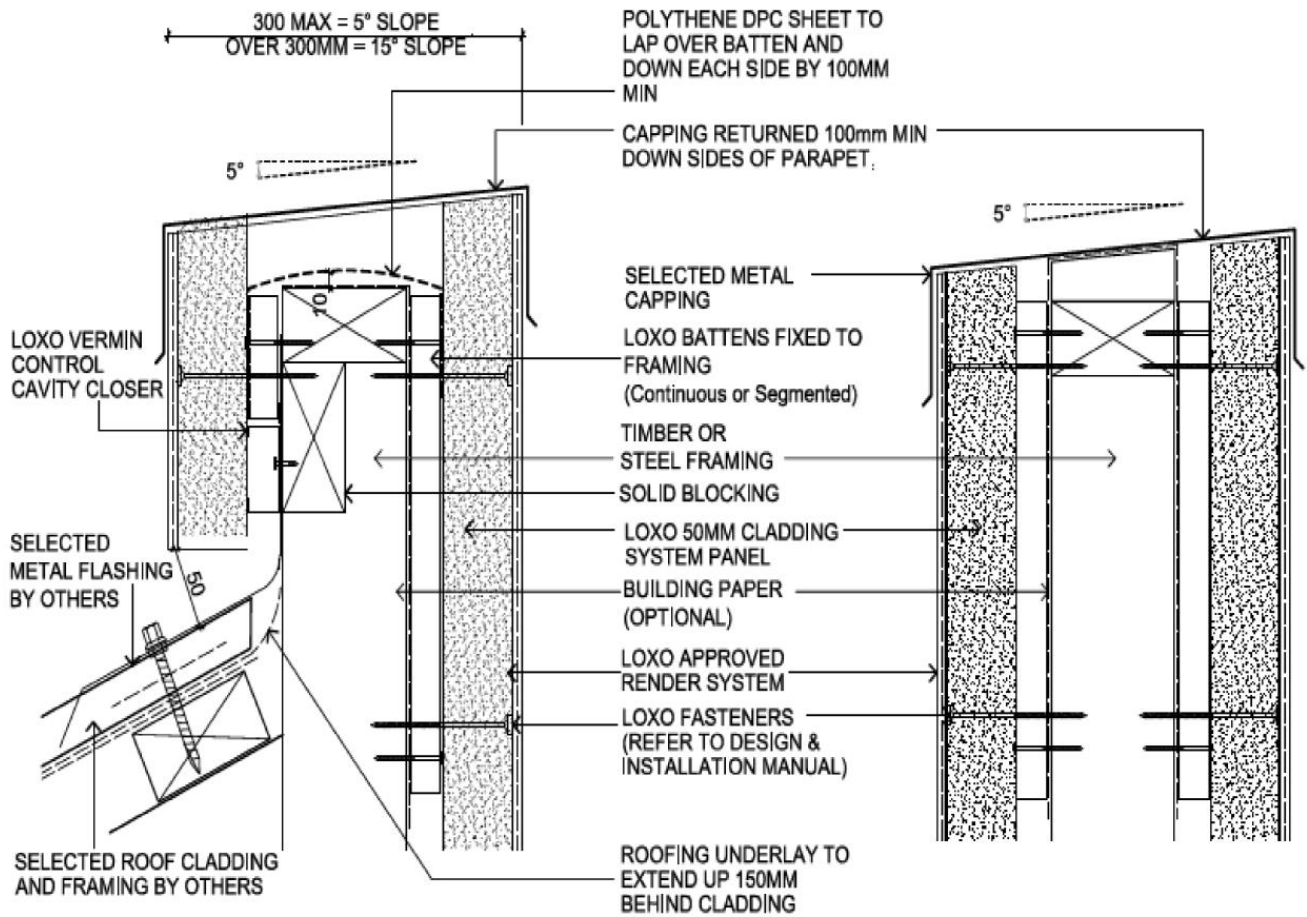


PARAPET / ROOF / BALCONY DETAIL METAL FLASHING/CAPPING

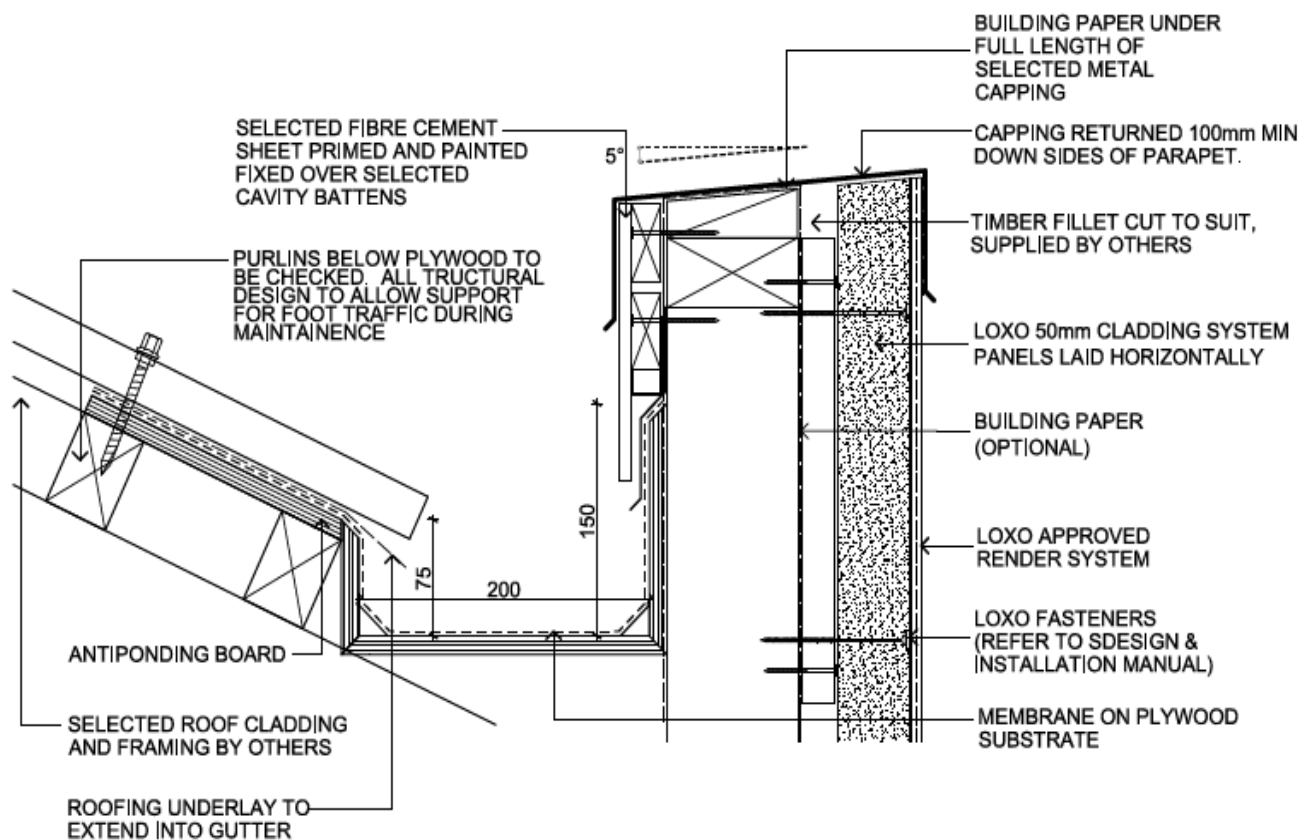

PARAPET / INTERNAL GUTTER DETAIL

NOTE:
ALL DIMENSIONS SHOWN
ARE INDICATIVE ONLY. ALL
ARE SPECIFIC TO DESIGN

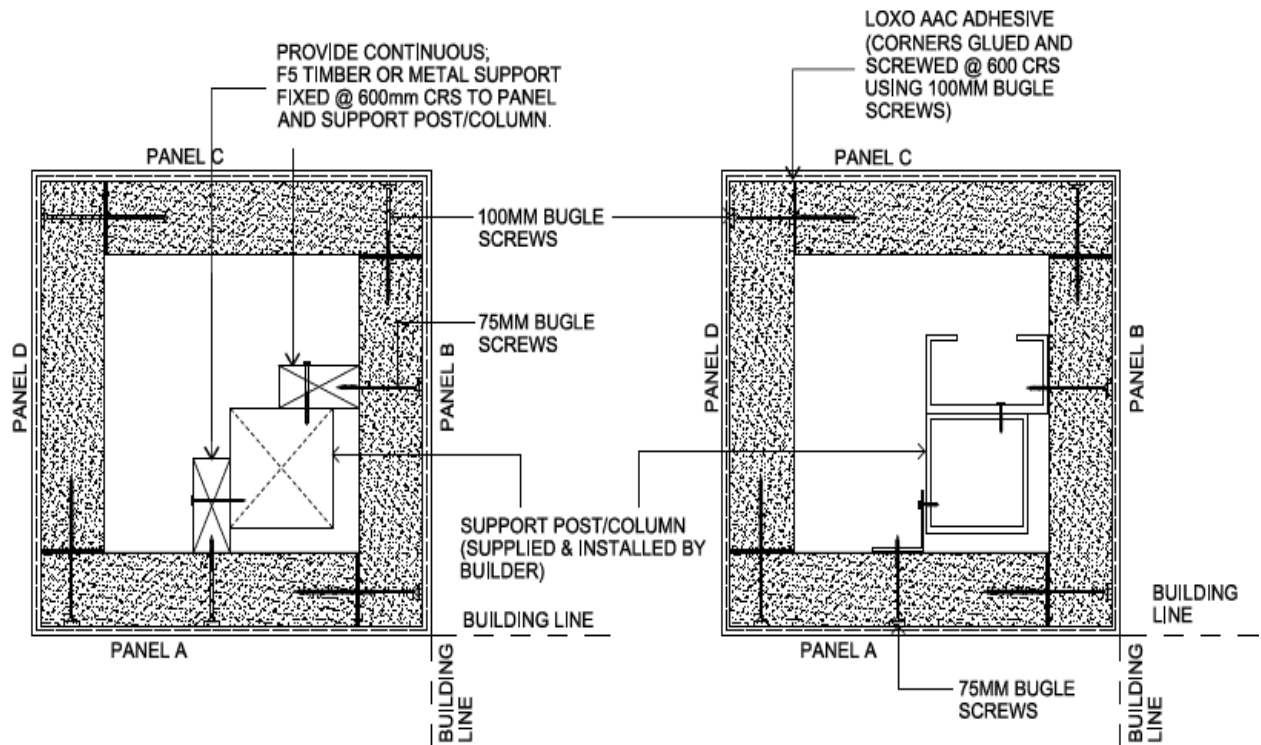

NOTE:
THIS DETAIL IS NOT SUITABLE FOR
SUSPENDED PANELS

CONSTRUCTION METHOD


- 1- FIX PANEL A TO PANEL B
- 2- ALIGN WITH BUILDING LINE IN BOTH DIRECTIONS
- 3- FIX PANEL A TO CONTINUOUS TIMBER OR METAL SUPPORT
- 4- PLUMB PANEL A AND FIX TO SUPPORT POST/COLUMN
- 5- REPEAT 3 & 4 FOR PANEL B
- 6- FIX PANEL C & D TO COMPLETE THE (AAC) LOXO COLUMN

MAXIMUM SQUARE COLUMN SIZE
650mm X 650mm

MAXIMUM RECTANGULAR COLUMN SIZE
700mm X 600mm


'X' DENOTES STAGGERED PANEL JOINT

* Min. 20mm, but must also comply
with termite protection requirements.

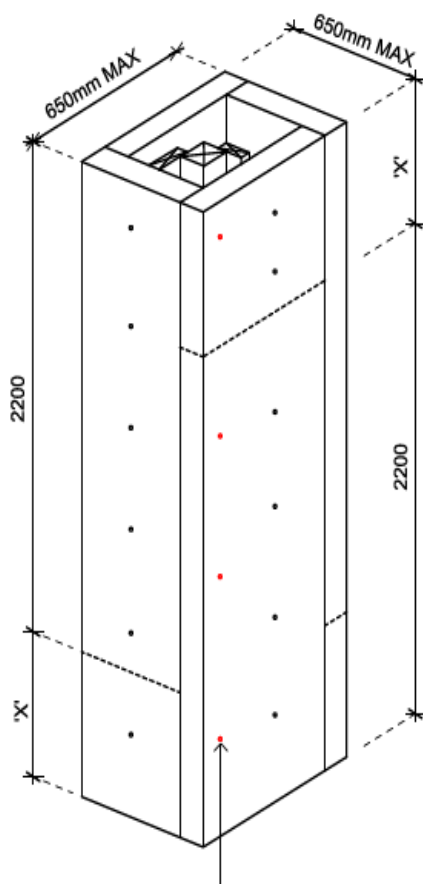


PROVIDE CONTINUOUS;
F5 TIMBER OR METAL SUPPORT
FIXED @ 600mm CRS TO PANEL
AND SUPPORT POST/COLUMN.

LOXO APPROVED FIXING METHOD
(REFER TO DESIGN & INSTALLATION
MANUAL)

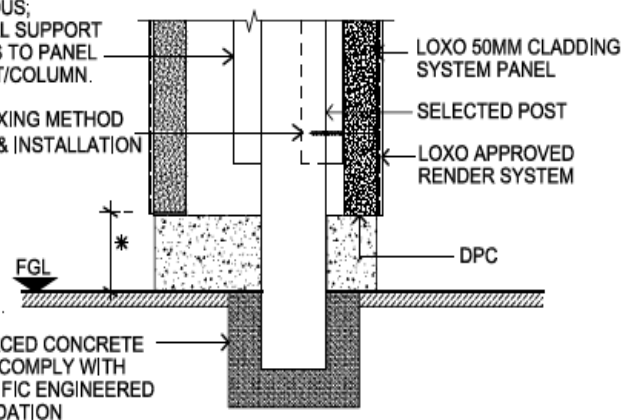


LOXO POST GROUND CONNECTION DETAIL

PANEL CRN JOINT GLUED & SCREWED AT
600MM CTR USING 100mm BUGLE SCREWS

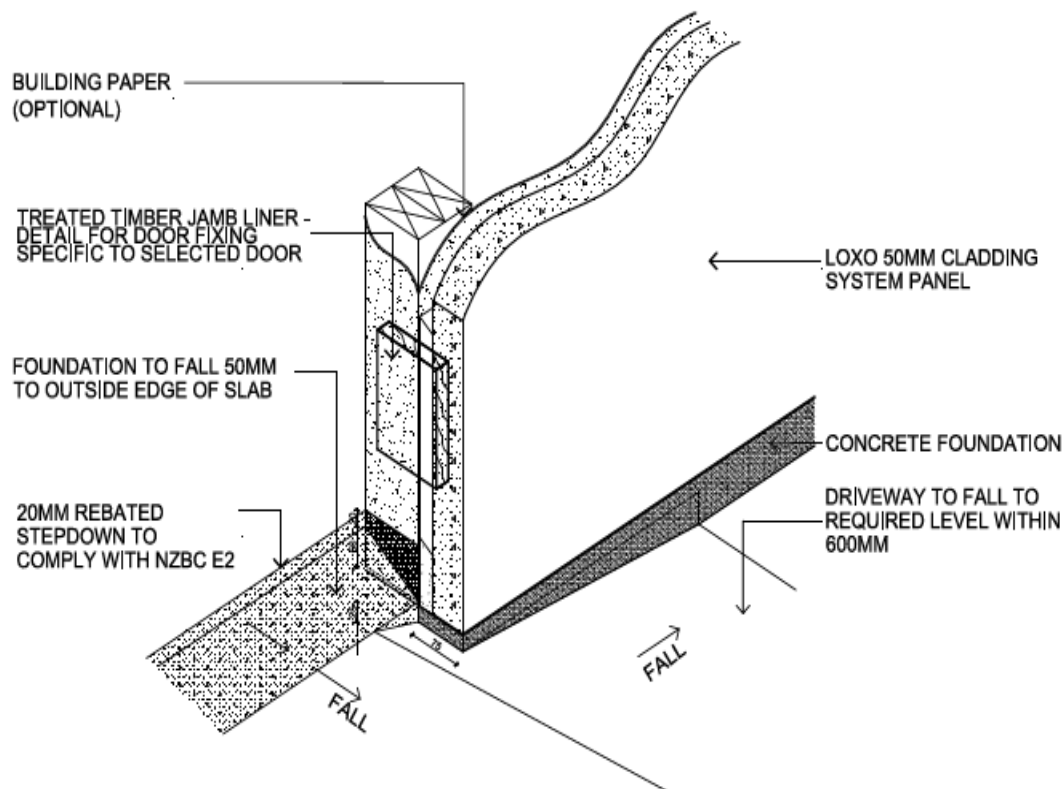


DOOR OPENING

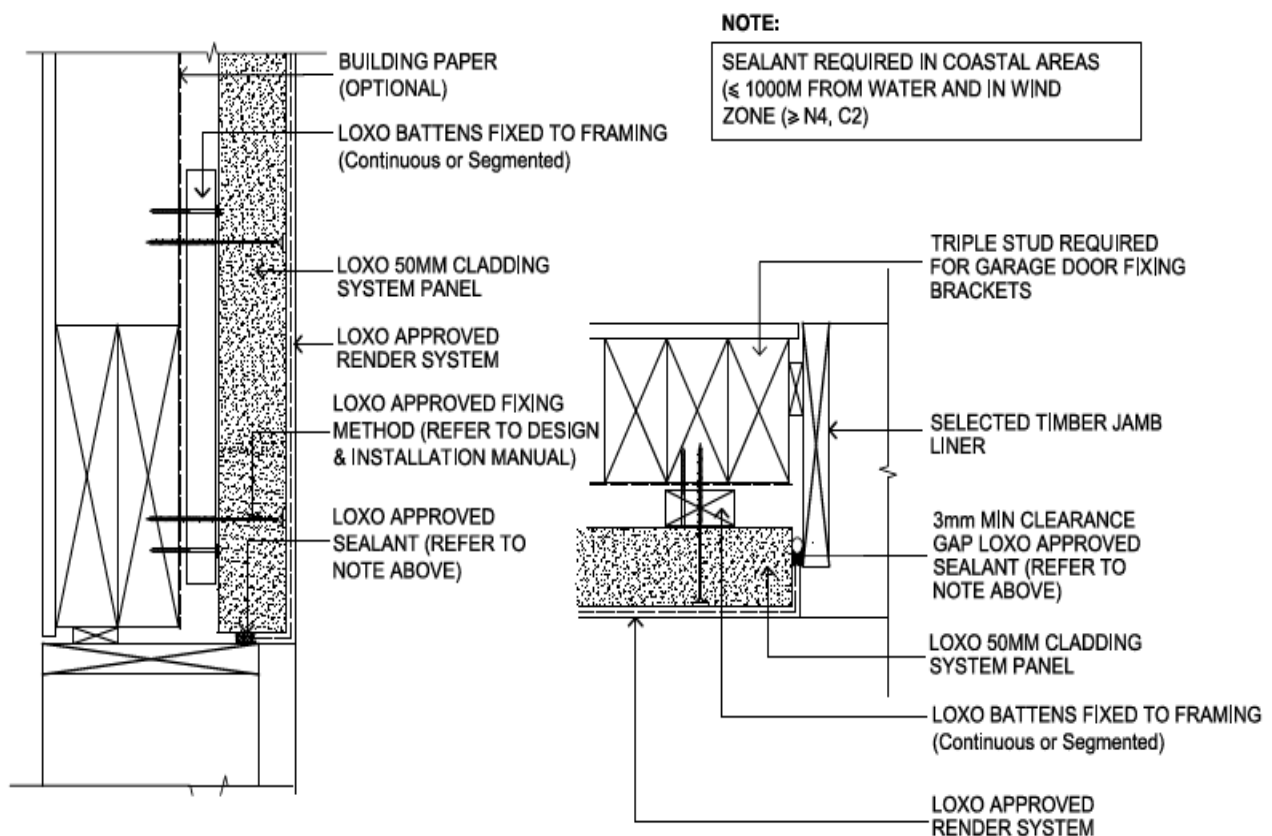


DOOR HEAD DETAIL


DOOR JAMB DETAIL

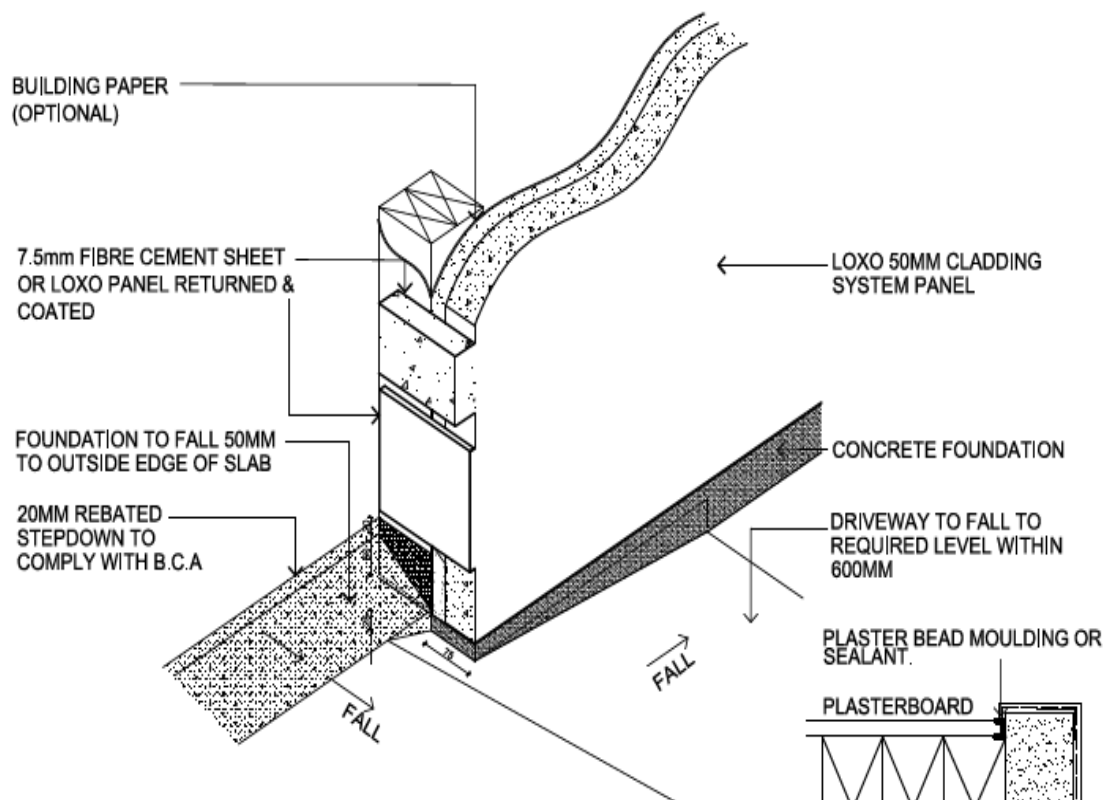


DOOR OPENING

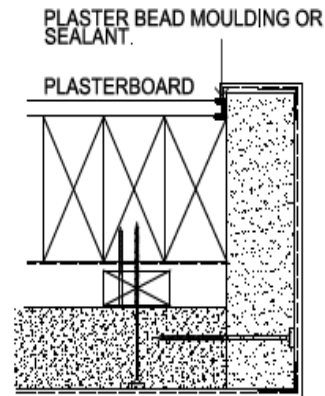


DOOR JAMB DETAIL

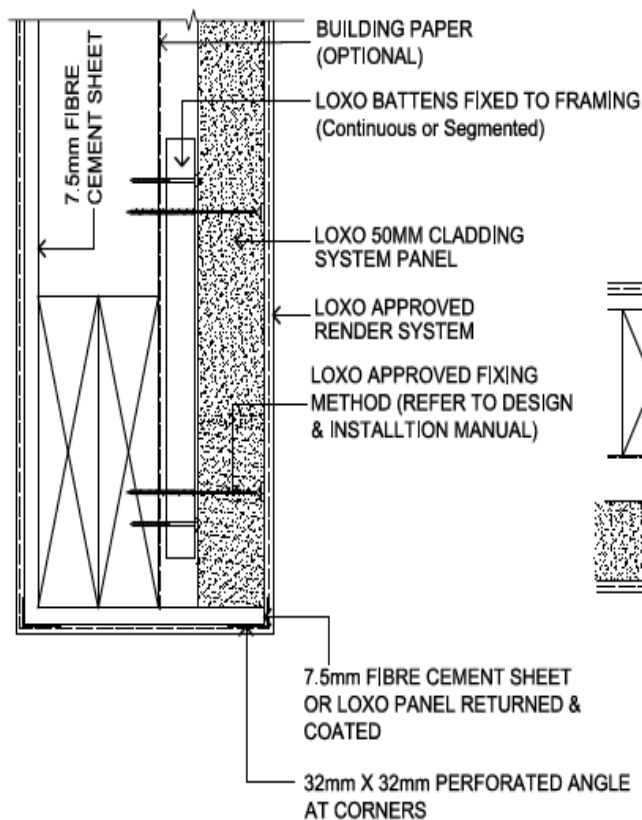

DOOR HEAD DETAIL

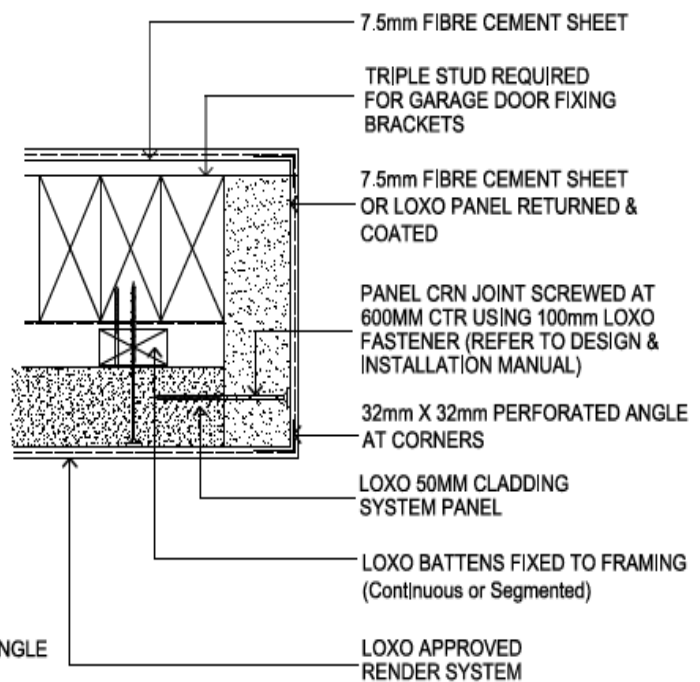

DOOR JAMB DETAIL

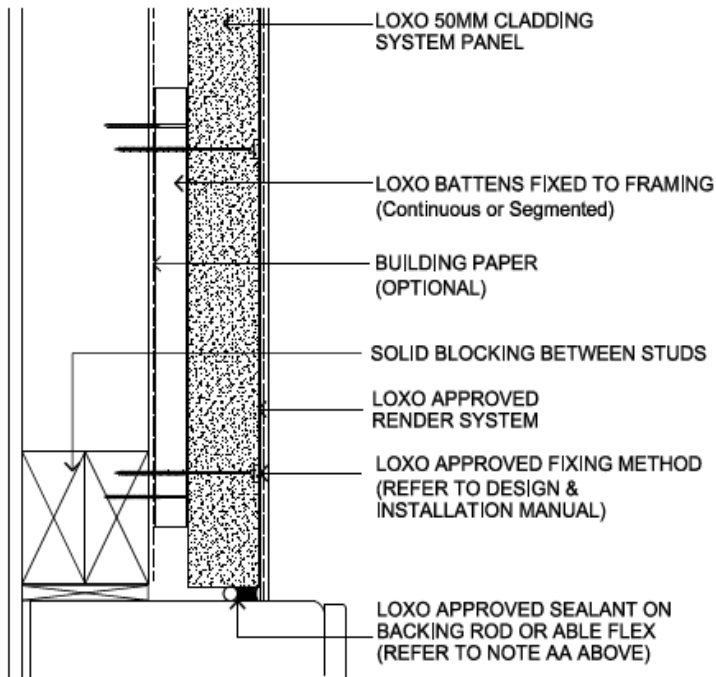


NOTE:
WHERE POSSIBLE, METERBOXES SHOULD BE LOCATED IN SHELTERED AREAS OF THE BUILDING.


NOTE AA:
ANY PENETRATION THAT IS PROUD OF THE SURFACE OF THE PANEL MUST BE SEALED.

METERBOX HEAD / JAMB / SILL DETAIL


WHERE ELECTRICAL CABLES PENETRATE EPS BATTEN, A SLEEVE OR CONDUIT SHALL BE PROVIDED AND SEALED INTO LOXO 50MM PANELS. ALL WIRES THAT PASS THROUGH A CONDUIT SHALL BE SEALED INTO POSITION INSIDE CONDUIT

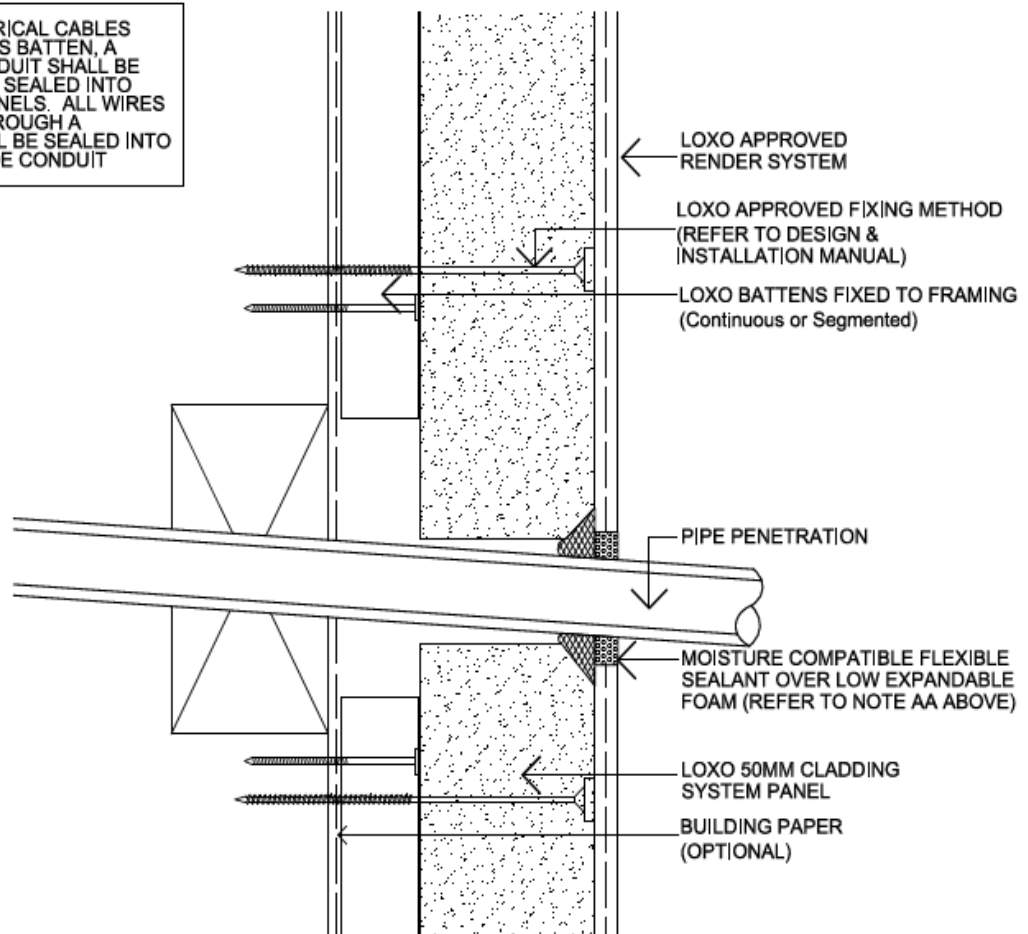


PIPE PENETRATION

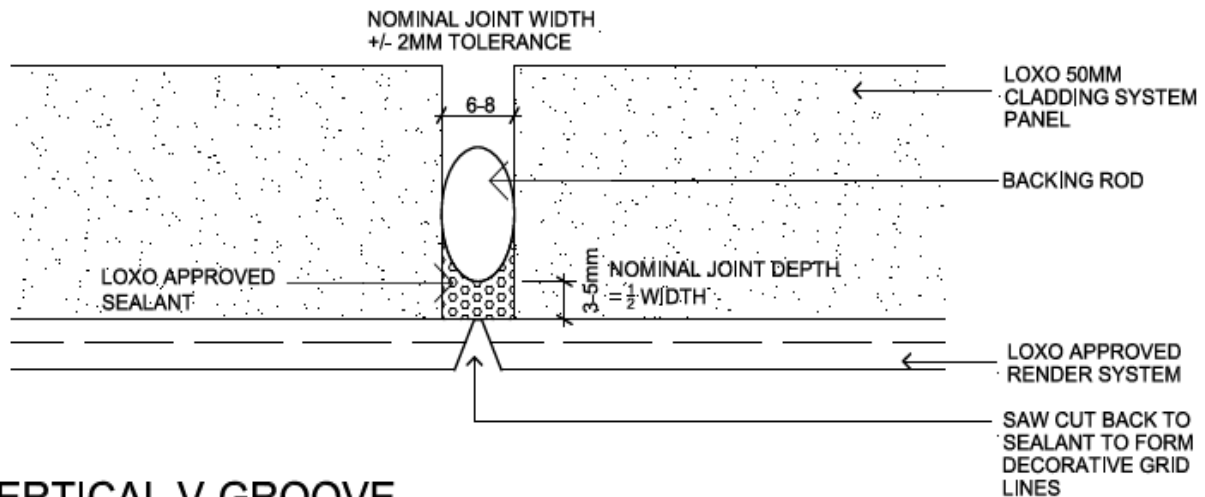

VERTICAL V-GROOVE


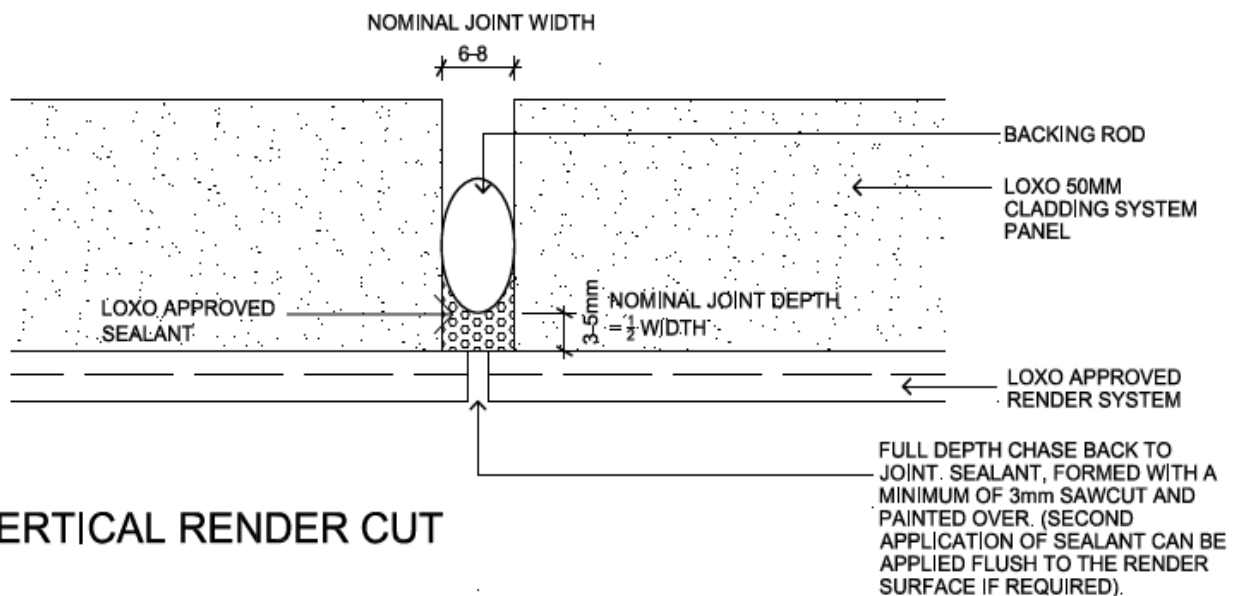


VERTICAL RENDER CUT

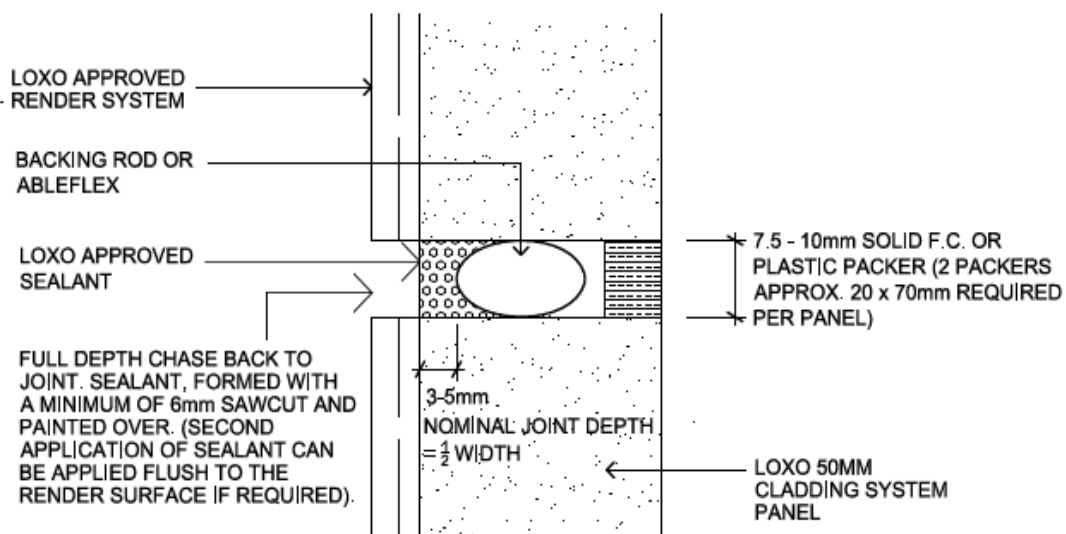

HORIZONTAL RENDER CUT


STEP 1.

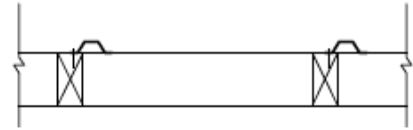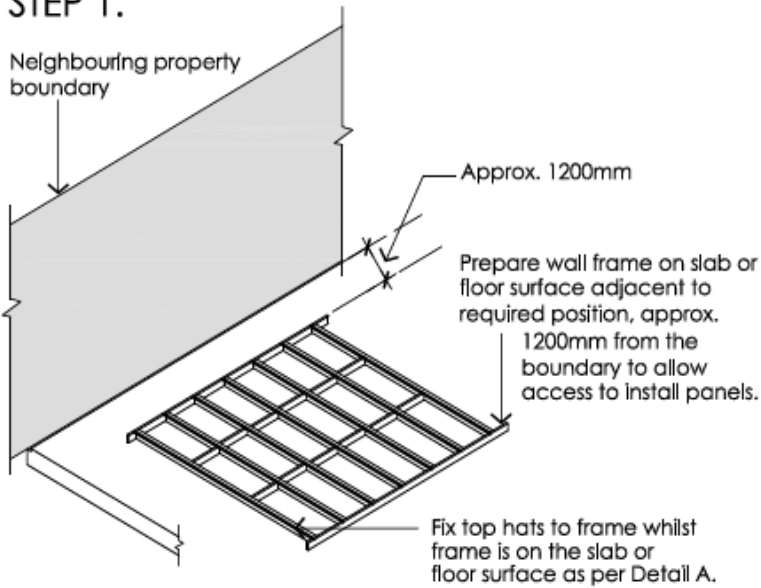

1 leg of top hats fixed at 600mm centres along studs, the second leg fixed to top plate, noggins and bottom plates.


DETAIL A

STEP 2

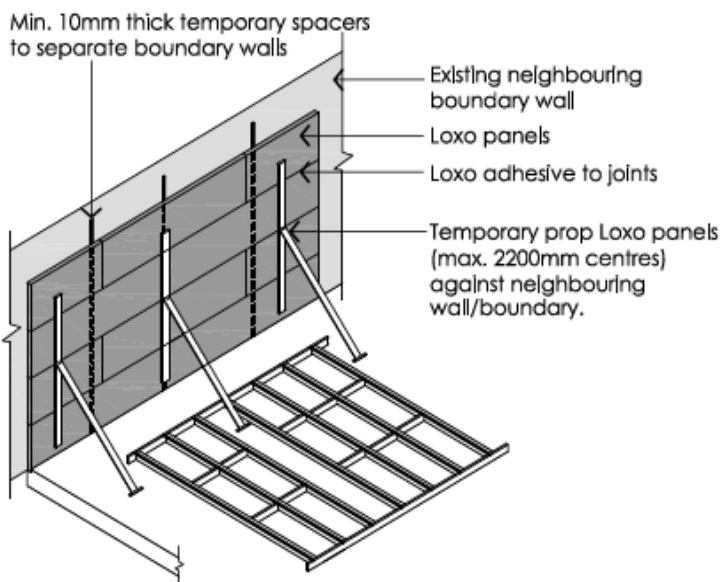


Note:
Remove or do not fix noggins in prop location until frame is stood up against Loxo panels.

STEP 3

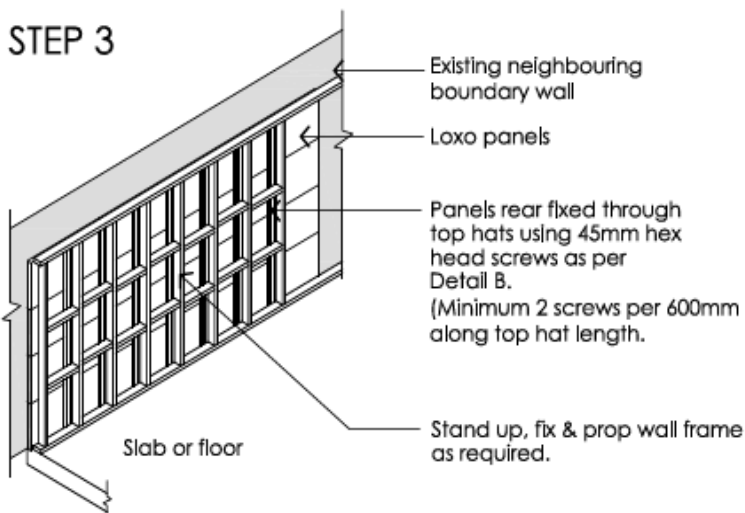

Panels rear fixed through top hats using 45mm hex head screws.

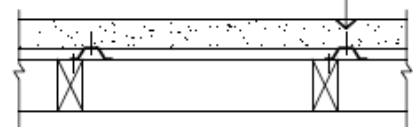

1 leg of top hats fixed at 600mm centres along studs, the second leg fixed to top plate, noggins and bottom plates.

DETAIL B



Certificate of Conformity

Certification Body:

Global-Mark Pty Ltd,
Suite 4.07,
32 Delhi Road,
North Ryde NSW
2113, Australia
Ph: +61 2 9886 0222
www.global-mark.com.au

Certificate Holder:

ONE AAC PANEL
485 Campbelltown Rd
Denham Court NSW
2565
Ph: 1300 010 222
www.oneaac.com.au

Certificate number: CM30031 Rev 4**THIS TO CERTIFY THAT****ONE AAC PANEL****Type and/or use of product:**

ONE AAC PANELS are 50mm and 75mm thick reinforced AAC (Autoclaved Aerated Concrete) Panels for use in all building types (BCA Volumes 1 & 2), in the following applications:

- Fire, thermal & acoustic rated cladding for load bearing, External Walls of timber or steel framed wall structures.
- Fire, thermal & acoustic rated cladding for load bearing, Dual Boundary External Walls of timber or steel framed wall structures.
- Fire, thermal & acoustic rated wall system for load bearing, Internal Separating Walls of timber or steel framing between separate occupancies in multi-unit buildings.
- Fire, thermal & acoustic rated Flooring systems for timber or steel framed floor structures.

Description of product:

Reinforced Autoclaved Aerated Concrete (AAC) Panels compliant with AS 5146, in the following sizes:

- 50mm thickness x 600mm width and lengths of 2,200mm, 2,400mm, 2,550mm, 2,700mm, 2,850mm & 3,000mm and
- 75mm thickness x 600mm width and lengths of 1,800mm, 2,200mm, 2,400mm, 2,700mm, 2,850mm, 3,000mm & 3,300mm, and
- Custom length panels (up to the above maximum lengths) are also available in the above thicknesses and widths

COMPLIES WITH THE FOLLOWING BCA PROVISIONS AND STATE OR TERRITORY VARIATION(S)**BCA 2022**

Performance Requirement(s)		Volume One		Volume Two including Housing Provisions	
	B1P1	Structural reliability		H1P1	Structural stability and resistance to actions
	B1P2	Structural resistance			

Scope of certification: The CodeMark Scheme is a building product certification scheme. The rules of the Scheme are available at the ABCB website www.abcb.gov.au. This Certificate of Conformity is to confirm that the relevant requirements of the Building Code of Australia (BCA) as claimed against have been met. The responsibility for the product performance and its fitness for the intended use remain with the certificate holder. The certification is not transferrable to a manufacturer not listed on Appendix A of this certificate.

Disclaimer: The Scheme Owner, Scheme Administrator and Scheme Accreditation Body do not make any representations, warranties or guarantees, and accept no legal liability whatsoever arising from or connected to, the accuracy, reliability, currency or completeness of any material contained within this certificate; and the Scheme Owner, Scheme Administrator and Scheme Accreditation Body disclaim to the extent permitted by law, all liability (including negligence) for claims of losses, expenses, damages and costs arising as a result of the use of the product(s) referred to in this certificate.

The purpose of Global-Mark construction site audits is to confirm the practicability of installing the product; and to confirm the appropriateness and accuracy of installation instructions. In placing the CodeMark mark on the product/system, the certificate holder makes a declaration of compliance with the certification standard(s) and confirms that the product is identical to the product certified herein. In issuing this Certificate of Approval Global-Mark has relied on the expertise of external bodies (laboratories, and technical experts).

Hervé Michoux
Global-Mark Managing Director

Peter Gardner
Unrestricted Building Certifier

Date of issue: 23/06/2025**Date of expiry: 17/05/2028**

Certificate number: CM30031 Rev 4

This certificate is only valid when reproduced in its entirety.

Page 1 of 13

Deemed-to-Satisfy Provision(s):	F3P1	Weatherproofing	H2P2	Weatherproofing
	B1D4 (b)(ii)	Determination of structural resistance of materials and forms of construction	H1D7 (4)(a)	Wall cladding
	C2D2	Fire resistance and stability – Type of construction required	H3D3	Fire Separation of external walls
	Specification 1	Fire-resistance of building elements	Specification 1	Fire-resistance of building elements
	Specification 5	Fire resisting construction	HP 9.2.3	Construction of external walls
	C2D10	Non-combustible material		
			HP 9.3.1	Fire Protection of separating walls
			HP 9.3.4	Fire Protection – Horizontal projections
			HP 9.4.1	Fire Protection of garage top dwellings - Walls
	F7D3	Determination of airborne sound insulation ratings	HP 10.7.1	Sound insulation requirements
	F7D4	Determination of impact sound insulation ratings	HP 10.7.2	Determination of airborne sound insulation ratings
	F7D5	Sound insulation rating of floors	HP 10.7.3	Construction of sound insulated walls
	F7D6	Sound insulation rating of walls		
	F8D3	Condensation management	H4D9	Condensation management
	G5D3	Construction in bushfire prone areas – Protection of residential buildings	H7D4 (2)	Construction in bushfire prone areas
	G5D4	Construction in bushfire prone areas – Protection of certain Class 9 buildings		
State or territory variation(s):	J3D8	External walls of a sole occupancy unit of a Class 2 building or Class 4 part of a building		
	J4D6	Building fabric – Walls and glazing	HP 13.2.5	Building fabric – External walls
	NT B1D4 (b)(ii)	Structural resistance		
	QLD B1D4 (b)(iii)	Structural resistance		
	WA B1D4 (b)(ii)	Structural resistance	WA H1D7 (4)(a)	Wall cladding
			HP NSW 9.4.1	Fire Protection of garage top dwellings – Walls
			HP NSW 9.4.3	Fire Protection of garage top dwellings – Separating floors

NT Part F7	Sound transmission & insulation	HP NT 10.7	Sound insulation
NSW G5D3	Construction in bushfire prone areas – Protection of residential buildings	TAS H4D9	Condensation management
NSW G5D4	Construction in bushfire prone areas – Protection of certain Class 9 buildings	NSW H7D4 (2)	Construction in bushfire prone areas
VIC G5D4	Construction in bushfire prone areas – Protection of certain Class 9 buildings		
NSW J3D8	External walls of a sole occupancy unit of a Class 2 building or Class 4 part of a building		
NSW J4D6	Building fabric – Walls and glazing	HP NSW 13.2.5	Energy efficiency – External walls
NSW Section J	Energy efficiency: Class 2 or Class 4 part of a building (up to V3 BASIX dwellings & BASIX Alterations and additions) – NCC 2019 A1 NSW Section J Class 2 or Class 4 part of a building (V4 or later BASIX dwellings) plus Class 3, 5, 6, 7, 8 & 9 buildings – NCC 2022 Section J	NSW Part H6	Energy efficiency: Up to V3 BASIX dwellings & BASIX Alterations and additions – NCC 2019 A1 NSW 2.6 V4 or later BASIX dwellings – NCC 2022 NSW Part H6
		NT Part H6	Energy efficiency
		HP NT 13.2.5	Energy efficiency building fabric – External walls
TAS Part J3	Elemental provisions for a sole-occupancy unit of a Class 2 building or a Class 4 part of a building	TAS Part H6	Energy efficiency – NCC 2019 (A1) 2.6
		HP TAS 13.2	Energy efficiency – NCC 2019 3.12

Certificate of Conformity

SUBJECT TO THE FOLLOWING LIMITATIONS AND CONDITIONS AND THE PRODUCT TECHNICAL DATA IN APPENDIX A AND EVALUATION STATEMENTS IN APPENDIX B		
Limitations and conditions:		Building classification/s:
Volume 1 – B1P1, B1P2, B1D4 & Volume 2 – H1P1, H1D7 Volume 1 – NT B1D4, QLD B1D4, WA B1D4 & Volume 2 – WA H1D7 External and Zero Boundary wall systems have maximum design wind pressure limits documented within the relevant ONE AAC Design & Installation Manuals (for External Walls and/or Dual Boundary Walls – refer Appendix B2). Wind pressures (as determined by AS4055 or AS/NZS1170.2), construction details and fixing methods must follow the relevant details contained within the engineering detail sections of the relevant ONE AAC Design & Installation Manuals for External Walls and/or Dual Boundary Walls, refer Appendix B2. Supporting stud frame design & certification shall be conducted by a suitably qualified engineer in accordance with AS 1684 “Timber Framing Code” for Timber framing and NASH Standard or AS/NZS 4600 “Cold-formed steel structures”, for Steel framing.		1, 2, 3, 4, 5, 6, 7, 8, 9 & 10
Volume 1 – B1P1 (2)(e), (f) & (i) & Volume 2 – H1P1 (2)(e), (f) & (i) Snow, liquid pressure and earth pressure actions are excluded.		1, 2, 3, 4, 5, 6, 7, 8, 9 & 10
Volume 1 – B1P4 Compliance for flood hazard areas is excluded.		1, 2, 3, 4, 5, 6, 7, 8, 9 & 10
Volume 1 – C2D2, Specification 1 & Specification 5 & Volume 2 – H3D3 & Specification 1 Housing Provisions – 9.2.3, 9.3.1, 9.3.4, 9.4.1 & HP NSW 9.4.1 & HP NSW 9.4.3 Refer to relevant construction options, details & conditions included in the relevant ONE AAC Design & Installation Manuals, refer Appendix B2: - ONE AAC External wall FRLs (for External and Internal fire sources) up to 120/120/120 are achievable (refer construction system options in the External Wall Manual) - ONE AAC Intertency wall FRLs of 60/60/60, 90/90/90 or 120/120/120 are achievable (refer construction system options in the Party Wall Manual) - ONE AAC Dual Boundary wall FRLs of 60/60/60 apply (refer construction system options in the Dual Boundary Wall Manual) - ONE AAC Floor Systems using 75mm thick AAC panels achieve FRLs up to 90/90/90 for fire sources above and below when a Ceiling system using 2 x 16mm or 3 x 13mm Gyprock Fyrchek plasterboard is directly fixed to joists or furring channels (minimum 28mm x 35mm x 0.5mm BMT) at spacing of 600mm max - For additional FRLs refer to construction system options in Appendix A3 & the relevant Wall or Floor System Manuals, refer Appendix B2.		1, 2, 3, 4, 5, 6, 7, 8, 9 & 10
Volume 1 – C2D10 Non-combustibility relates to AAC material only. Certification is based on the system being installed using components & accessories as detailed in the relevant ONE AAC Design & Installation Manuals, refer Appendix B2. Substitution of wall system components &/or accessories may be permitted, the general performance specifications of components &/or accessories must be maintained for this certificate to remain valid.		2, 3, 4, 5, 6, 7, 8 & 9
Volume 1 – C2D10 (1)(a) In a building required to be of Type A or B construction, construction elements and their components must be non-combustible for all external walls, common walls and non-loadbearing internal walls that are required to be fire-resisting, timber framing and components may not be used.		2, 3, 4, 5, 6, 7, 8 & 9

	Volume 1 – C2D10 (6) In external wall applications, flexible sarking membrane (wall wrap) materials shall be installed in accordance with the ONE AAC Design & Installation Manual for External Walls, refer Appendix B2.	2, 3, 4, 5, 6, 7, 8 & 9
	Volume 1 – F3P1 & Volume 2 – H2P2 ONE AAC External walls & Zero Boundary walls are considered to remain Weatherproof, when the external wall: 1. has a risk score of 20 or less, when the sum of all risk factor scores are determined in accordance with Tables F3V1a or H2V1a, and 2. is subject to Ultimate Limit State (ULS) wind pressures not exceeding ±2.5 kPa, and 3. deflections of the supporting structures are limited to Span/250 for the Serviceability Limit State (SLS) wind pressures, and 4. include only windows that comply with AS 2047, and 5. design & installation complies with the ONE AAC External wall or Zero Boundary wall design & installation manuals, refer Appendix B2.	1, 2, 3, 4, 5, 6, 7, 8, 9 & 10
	Volume 1 – G5D3 & Volume 2 – H7D4 In designated Bushfire prone areas, when the building is constructed in accordance with AS3959:2018 including Amendments 1 & 2, or NASH Standard – Steel Framed Construction in Bushfire Areas (where applicable), ONE AAC Panels are permitted for use as external wall cladding in buildings subject to Bushfire Attack Level in all zones up to and including BAL-FZ. In Queensland (per QLD G5D2 & QLD H7D4(3)), areas where the classified vegetation is Group F rainforest (excluding wet sclerophyll forest types), mangrove communities and grasslands under 300mm high, are excluded.	Class 1, 2 & 3 buildings & 10a buildings or decks immediately adjacent or connected to such buildings
	Volume 1 – G5D4 In designated Bushfire prone areas, when the building is constructed in accordance with Specification 43, ONE AAC Panels are permitted for use as external wall cladding in buildings subject to Bushfire Attack Level not exceeding BAL-12.5. Construction in BAL-19, BAL-29, BAL-40 & BAL-FZ are outside the scope of application of the clause.	Class 9a, 9b & 9c buildings & Class 10a buildings or decks immediately adjacent or connected to such buildings
	Volume 1 – J3D8 & Volume 1 – NSW J3D8 & TAS Part J3 The wall system contributes towards the Total wall system U or R value, which is to be determined in accordance with Volume 1 – J3D8 (2) & J3D9 or specific state variation. Insulation shall be included within the wall system, as outlined in the relevant Design & Installation Manual & according to project specifications.	Class 2 building or Class 4 part of a building
	Volume 1 – J4D6 & Volume 1 – NSW J4D6 & Housing Provisions – 13.2.5 The wall system contributes towards the Total wall system U or R value, which is to be determined in accordance with Volume 1 – J4D6 & Housing Provisions – 13.2.5 or specific state variation. Insulation shall be included within the wall system, as outlined in the relevant Design & Installation Manual & according to project specifications.	Class 1, 3, 5, 6, 7, 8, 9 & 10 buildings
	Volume 1 – NSW G5D3 & Volume 2 – NSW H7D4 ONE AAC Panels are permitted for use as external wall cladding in designated bushfire prone areas, subject to Bushfire Attack Level up to and including BAL-29, determined in accordance with Planning for Bush Fire Protection 2019 including addendum November 2022, when the building is constructed in accordance with: - AS3959: 2018 including Amendments 1 & 2, except as modified by Planning for Bush Fire Protection 2019 including addendum November 2022, or where applicable,	Class 1, 2 & 3 buildings, Class 4 part of a building & Class 10a buildings or decks immediately adjacent or connected to such buildings



Certificate of Conformity

	- NASH Standard – Steel Framed Construction in Bushfire Areas, except as modified by Planning for Bush Fire Protection 2019 including addendum November 2022. - Except as modified by Planning for Bush Fire Protection 2019 including addendum November 2022. - The compliance assessment of the certified system is limited to sections 7.5 and 8.3.2 of Planning for Bush Fire Protection 2019 including addendum November 2022. - Site specific conditions have not been considered for the compliance assessment, these may include: - the development consent following consultation with the NSW Rural Fire Service under section 4.14 of the Environmental Planning and Assessment Act 1979 if required, or - the development consent with a bushfire safety authority issued under section 100B of the Rural Fires Act 1997 for the purposes of integrated development - Planning for Bush Fire Protection 2019 including addendum November 2022 requires a performance-based application in bushfire prone areas subject to Bushfire Attack BAL-40 and BAL-FZ. Construction in NSW's bushfire prone areas subject to Bushfire Attack BAL-40 and BAL-FZ have not been considered in this assessment.	
	Volume 1 – NSW G5D4 In designated bushfire prone areas subject to Bushfire Attack Levels not exceeding BAL-12.5, determined in accordance with Planning for Bush Fire Protection including addendum November 2022, ONE AAC Panels are permitted for use as external wall cladding, when the building is constructed in accordance with: - For class 9 buildings, Specification 43 except as modified by Planning for Bush Fire Protection 2019 including addendum November 2022, or - For class 10a buildings or decks AS3959: 2018 including Amendment 1 & 2 except as modified by Planning for Bush Fire Protection 2019 including addendum November 2022 and S43C13 The compliance assessment of the certified system is limited to sections 7.5 and 8.3.2 of Planning for Bush Fire Protection 2019 including addendum November 2022. Site specific conditions arising from the development consent with a bushfire safety authority issued under section 100B of the Rural Fires Act 1997 for the purposes of integrated development are site specific and have not been considered for the compliance assessment. Construction in NSW in BAL-19, BAL-29, BAL-40 & BAL-FZ are outside the scope of application of the clause.	Class 9 buildings that have a special fire protection purpose & Class 10a buildings or decks immediately adjacent or connected to such buildings
	Volume 1 – VIC G5D4 In designated Bushfire prone areas subject to Bushfire Attack Level not exceeding BAL-12.5, ONE AAC Panels are permitted for use as external wall cladding, when the building is constructed in accordance with Specification 43. Construction in VIC in BAL-19, BAL-29, BAL-40 & BAL-FZ are outside the scope of application of the clause.	Class 9a, 9b & 9c buildings & Class 4 part of a building associated with such buildings, plus Class 10a buildings or decks immediately adjacent or connected to such buildings
	General The supporting structures including stud frame & cavity sub framing, plus internal linings shall be designed & specified by a suitably qualified design professional in accordance with manufacturer guidelines and installed by suitably qualified and trained building professionals, in accordance with manufacturer guidelines and the relevant ONE AAC Design and Installation Manuals, refer Appendix B2.	1, 2, 3, 4, 5, 6, 7, 8, 9 & 10



Certificate of Conformity

APPENDIX A – PRODUCT TECHNICAL DATA

A1 Type and intended use of product

Refer to page 1 of this certificate.

A2 Description of product

Refer to page 1 of this certificate.

A3 Product specification

Property	50MM PANELS		75MM XL PANELS	
	Value	Units	Value	Units
Ambient ¹ Density, ρ_{amb} (10% Moisture Content)	561	kg/m ³	440	kg/m ³
Dry ² Density, ρ_{dry}	510	kg/m ³	400	kg/m ³
Working ³ Density, ρ_{work} (10% Moisture Content)	689	kg/m ³	540	kg/m ³
Characteristic Compressive Strength of AAC f _m	2.8	MPa	2.38	MPa
Average Compressive Strength of AAC	3.2	MPa	2.8	MPa
Characteristic Modulus of Rupture, f _{ut}	0.6	MPa	0.4	MPa
Design Ultimate Limit State Bending Capacity, ϕM	0.12	kNm	0.25	kNm
Design Serviceability Limit State Deflection Limit, δ_{lim}	9mm/100	mm/100	9mm/100	mm/100
Coefficient of contraction	0.4	mm/m	0.4	mm/m
Coefficient of thermal expansion	10	x10 ⁻⁶ /°C	10	x10 ⁻⁶ /°C

ONE AAC External Walls & Intertency Walls achieve various FRL's and Acoustic ratings as per the following extracts from the Technical Literature:

ONE AAC – External Wall FRLs					ONE AAC – Intertency Wall FRLs and Acoustic Performance				
EXTERNAL PANEL	INTERNAL PLASTERBOARD LINING	FRL OUTSIDE	FRL INSIDE	IMAGE	SYSTEM	PANEL	CONSTRUCTION TYPE	FRL	Rw+Ctr
50mm Or 75mm	10mm – 13mm Standard Plasterboard	120/120/90	-/-/-		1 – 60 LB Stack Bond & Vertical H-Stud	50mm	Framed: Timber or Steel Frame	60/60/60	53
50mm Or 75mm	1 X 13mm Fire Rated Plasterboard	120/120/120	-/60/60		1S – 60 NLB Stack Bond & Vertical H-Stud	50mm	Slab to Slab: Timber or Steel frame infill	-/60/60	53
50mm Or 75mm	1 X 16mm Fire Rated Plasterboard	120/120/120	60/60/60		2 – 90 LB (H-Stud Not Permitted) Stretcher & Vertical	50mm	Framed: Timber or Steel Frame	90/90/90	53
50mm Or 75mm	2 X 13mm Fire Rated Plasterboard	120/120/120	90/90/90		2S – 90 NLB (H-Stud Not Permitted) Stretcher & Vertical	50mm	Slab to Slab: Timber or Steel frame infill	-/90/90	53
50mm Or 75mm	2 X 16mm Fire Rated Plasterboard	120/120/120	120/120/120		3 – 120 LB Vertical Panel	75mm	Framed: Timber or Steel Frame	120/120/120	55
50mm Or 75mm	2 X 16mm Fire Rated Plasterboard	120/120/120	120/120/120		3S – 120 NLB Vertical Panel	75mm	Slab to Slab: Timber or Steel frame infill	-/120/120	55

ONE AAC External Walls achieve Thermal Performance (R values) as per the following extracts from the Technical Literature:

ONE AAC External Walls on 70mm (nom) Stud Frames

ONE AAC SYSTEM	System details – 70mm Frames The following Systems are all based on 50mm/75mm ONE AAC Panel, 20-40mm Cavity, 70mm Frame Thickness, and 10mm Plasterboard internal linings	Total R Value m2K/W	
		Summer 50mm/75mm	Winter 50mm/75mm
NS-1-70	Panel + Cavity + No Sarking + Frame + No Insulation + Plasterboard	0.72/0.89	0.74/0.91
SS-1-70	Panel + Cavity + SS Sarking + Frame + No Insulation + Plasterboard	1.33/1.50	1.46/1.63
NS-2-70	Panel + Cavity + No Sarking + Frame + R2.0 Insulation + Plasterboard	2.63/2.80	2.84/3.01
SS-2-70	Panel + Cavity + SS Sarking + Frame + R2.0 Insulation + Plasterboard	2.63/2.80	2.84/3.01

ONE AAC External Walls on 90mm (nom) Stud Frames

ONE AAC SYSTEM	System details – 90mm Frames The following Systems are all based on 50mm/75mm ONE AAC Panel, 20-40mm Cavity, 90mm Frame Thickness, and 10mm Plasterboard internal linings	Total R Value m2K/W	
		Summer 50mm/75mm	Winter 50mm/75mm
NS-1-90	Panel + Cavity + No Sarking + Frame + No Insulation + Plasterboard	0.72/0.89	0.74/0.91
SS-1-90	Panel + Cavity + SS Sarking + Frame + No Insulation + Plasterboard	1.34/1.51	1.50/1.67
NS-2-90	Panel + Cavity + No Sarking + Frame + R2.0 Insulation + Plasterboard	2.63/2.80(min)	2.84/3.01(min)
NS-3-90	Panel + Cavity + No Sarking + Frame + R2.5 Insulation + Plasterboard	3.11/3.28(min)	3.24/3.41(min)
SS-2-90	Panel + Cavity + No Sarking + Frame + R2.5 Insulation + Plasterboard	3.11/3.28(min)	3.24/3.41(min)
DS-1-90	Panel + 40mm Cavity + DS Sarking + Frame + R2.5 Insulation + Plasterboard	3.49/3.66	3.83/4.00
FS-1-90	Panel + Cavity + FS Sarking + Frame + R2.0 Insulation + Plasterboard	5.00/5.17	5.20/5.37


ONE AAC Flooring Systems achieve various FRLs as per the following extracts from the Technical Literature:

ONE AAC Floor System – Fire Performance for Fire from Above

FIRE RATING PERFORMANCE - FIRE FROM ABOVE -TABLE 'A'

RATING - Fire from Above (Minutes)	Maximum Joist Spacing (mm)	ONE AAC PANEL Material Above Joists	Fire Rated Plasterboard Material Below Joists
120	600	75mm Panel	Nil

Typical arrangement of ONE AAC Floor system

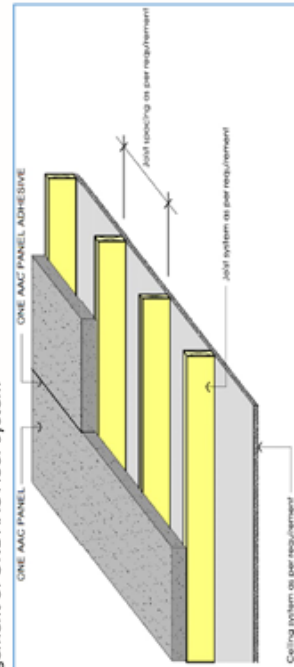

ONE AAC Floor System with Fire Resistant Ceiling Systems – Fire Performance for Fire from Below

FIRE RATING PERFORMANCE - FIRE FROM BELOW - FLOOR / CEILING SYSTEM -TABLE 'B'

RATING - Fire From Below (FRL)	Maximum Joist Spacing (mm)	ONE AAC PANEL Material Above Joists	Fire Rated Plasterboard Material Below Joists
120/120/120	600	75mm Panel	3 layers of 16mm FR PB
90/90/90	600	75mm Panel	2 Layers of 16mm FR PB or 3 layers of 13mm FR PB
60/60/60	600	75mm Panel	2 Layers of 13mm FR PB
30/30/30	450	75mm Panel	1 Layer of 13mm FR PB or 1 layer of 16mm FR PB

KEY:

FRPB Fire Rated Plasterboard

Joists Timber or Steel Joists as per Engineer's requirements



Certificate of Conformity

For system component details & specifications refer to the Product Technical Literature listed as items 1, 2, 3, 4 & 5 in Appendix B2:

- ONE AAC PANEL External Wall System Design and Installation Manual, May 2025.
- ONE AAC PANEL Floor System Design and Installation Manual, May 2025.
- ONE AAC PANEL Party Wall System Design and Installation Manual, May 2025.
- ONE AAC PANEL Dual Boundary Wall System Design and Installation Manual, May 2025.
- ONE AAC PANEL Dual Boundary Wall Construction Guide (DWG & Photos), September 2019.

A4 Manufacturer and manufacturing plant(s)

ONE AAC PANEL
485 Campbelltown Rd
Denham Court NSW 2565
Ph: 1300 010 222
www.oneaac.com.au

A5 Installation requirements

For external walls using ONE AAC panels in Horizontal orientation, refer to the following span table (from ONE AAC PANEL External Wall System Design and Installation Manual, May 2025):

ONE AAC External Walls - Horizontal Panels Spanning and Fixing Guide (50mm & 75mm panels)				
TABLE	Max Horizontal Spacing	Max Panel Screw Spacing Vertically		
Wind Zone	For Battens and Panel Screws	Typical Zone		
	Corner Zone	Typical Zone	Corner Zone	Typical Zone
N2, N3, C1	600	900	500 (2 screws/600mm)	500 (2 screws/600mm)
M4, C2	600	600	250 (3 screws/600mm)	500 (2 screws/600mm)
N5, C3	450	450	250 (3 screws/600mm)	250 (3 screws/600mm)

Alternately refer to AS 5146.3:2018 – Tables 3.3 A, B, C, D, E, F, G, H & L.

Refer to the Product Technical Literature listed as items 1, 2, 3, 4 & 5 in Appendix B2:

- ONE AAC PANEL External Wall System Design and Installation Manual, May 2025.
- ONE AAC PANEL Floor System Design and Installation Manual, May 2025.
- ONE AAC PANEL Party Wall System Design and Installation Manual, May 2025.
- ONE AAC PANEL Dual Boundary Wall System Design and Installation Manual, May 2025.
- ONE AAC PANEL Dual Boundary Wall Construction Guide (DWG & Photos), September 2019.

Additional construction details not included in the above Technical Literature may be found in AS 5146.3:2018 – Sections 4.4, 5.4 & 6.3.

A6 Other relevant technical data

Refer to the Product Technical Literature listed as items 1, 2, 3, 4 & 5 in Appendix B2:

- ONE AAC PANEL External Wall System Design and Installation Manual, May 2025.
- ONE AAC PANEL Floor System Design and Installation Manual, May 2025.
- ONE AAC PANEL Party Wall System Design and Installation Manual, May 2025.
- ONE AAC PANEL Dual Boundary Wall System Design and Installation Manual, May 2025.
- ONE AAC PANEL Dual Boundary Wall Construction Guide (DWG & Photos), September 2019.

And any referenced documents within the technical literature identified in Appendices A3 & A5.

Certificate number: CM30031 Rev 4

This certificate is only valid when reproduced in its entirety.

Page 9 of 13

B1 Evaluation methods

The following assessment methods have been used to determine compliance with BCA 2022:

Code Clause	Assessment Method(s)	Evidence of suitability	Evidence reference in B2
BCA Volume One B1P1	A2G2 (2) (a) & (c)	A5G3 (1) (e) & (f) – Expert judgement & Other documentary evidence	Items 1, 2, 3, 4, 5, 6, 7, 8, 9, 10, 11, 12, 13, 14, 15, 16, 17, 18, 19, 20, 21, 22, 23, 41 & 42
BCA Volume Two H1P1	A2G2 (2) (a) & (c)	A5G3 (1) (e) & (f) – Expert judgement & Other documentary evidence	Items 1, 2, 3, 4, 5, 6, 7, 8, 9, 10, 11, 12, 13, 14, 15, 16, 17, 18, 19, 20, 21, 22, 23, 41 & 42
BCA Volume One B1P2	A2G2 (2) (a) & (c)	A5G3 (1) (e) & (f) – Expert judgement & Other documentary evidence	Items 1, 2, 3, 4, 5, 6, 7, 8, 9, 10, 11, 12, 13, 14, 15, 16, 17, 18, 19, 20, 21, 22, 23, 41 & 42
BCA Volume One F3P1	A2G2 (2) (a), (c) & (d)	A5G3 (1) (e) & (f) – Expert judgement & Other documentary evidence	Items 1, 4, 40, 41 & 42
BCA Volume Two H2P2	A2G2 (2) (a), (c) & (d)	A5G3 (1) (e) & (f) – Expert judgement & Other documentary evidence	Items 1, 4, 40, 41 & 42
BCA Volume One B1D4 (b)(ii)	A2G3 (2) (a) & (b)	A5G3 (1) (e) & (f) – Expert judgement & Other documentary evidence	Items 1, 2, 3, 4, 5, 6, 7, 8, 9, 10, 11, 12, 13, 14, 15, 16, 17, 18, 19, 20, 21, 41 & 42
BCA Volume Two H1D7 (4)(a)	A2G3 (2) (a) & (b)	A5G3 (1) (e) & (f) – Expert judgement & Other documentary evidence	Items 1, 2, 3, 4, 5, 6, 7, 8, 9, 10, 11, 12, 13, 14, 15, 16, 17, 18, 19, 20, 21, 41 & 42
BCA Volume One C2D2	A2G3 (2) (a) & (b)	A5G3 (1) (d) & (e) – Test report & Expert judgement	Items 24, 25, 26, 27, 28, 29, 30, 31, 32, 33, 34, 35, 36, 37, 38 & 39
BCA Volume One Specification 1	A2G3 (2) (a) & (b)	A5G3 (1) (d) & (e) – Test report & Expert judgement	Items 24, 25, 26, 27, 28, 29, 30, 31, 32, 33, 34, 35, 36, 37, 38 & 39
BCA Volume One Specification 5	A2G3 (2) (a) & (b)	A5G3 (1) (d) & (e) – Test report & Expert judgement	Items 24, 25, 26, 27, 28, 29, 30, 31, 32, 33, 34, 35, 36, 37, 38 & 39
BCA Volume Two H3D3	A2G3 (2) (a) & (b)	A5G3 (1) (d) & (e) – Test report & Expert judgement	Items 24, 25, 26, 27, 28, 29, 30, 31, 32, 33, 34, 35, 36, 37, 38 & 39
BCA Volume Two Specification 1	A2G3 (2) (a) & (b)	A5G3 (1) (d) & (e) – Test report & Expert judgement	Items 24, 25, 26, 27, 28, 29, 30, 31, 32, 33, 34, 35, 36, 37, 38 & 39
Housing Provisions 9.2.3	A2G3 (2) (a) & (b)	A5G3 (1) (d) & (e) – Test report & Expert judgement	Items 24, 25, 26, 27, 28, 29, 30, 31, 32, 33, 34, 35, 36, 37, 38 & 39
BCA Volume One C2D10	A2G3 (2) (a)	A5.2 (2) (d) – Test report	Items 24, 25, 26, 27, 28, 29, 30, 31, 32, 33, 34, 35, 36, 37, 38 & 39
Housing Provisions 9.3.1	A2G3 (2) (a) & (b)	A5G3 (1) (d) & (e) – Test report & Expert judgement	Items 24, 25, 26, 27, 28, 29, 30, 31, 32, 33, 34, 35, 36, 37, 38 & 39
Housing Provisions 9.3.4	A2G3 (2) (a) & (b)	A5G3 (1) (d) & (e) – Test report & Expert judgement	Items 24, 25, 26, 27, 28, 29, 30, 31, 32, 33, 34, 35, 36, 37, 38 & 39
Housing Provisions 9.4.1	A2G3 (2) (a) & (b)	A5G3 (1) (d) & (e) – Test report & Expert judgement	Items 24, 25, 26, 27, 28, 29, 30, 31, 32, 33, 34, 35, 36, 37, 38 & 39
BCA Volume One F7D3	A2G3 (2) (a) & (b)	A5G3 (1) (d) & (e) – Test report & Expert judgement	Items 1, 2, 3, 4, 5, 6, 7, 43, 44, 45, 46, 47, 48, 49, 50, 51, 52 & 53
BCA Volume One F7D4	A2G3 (2) (a) & (b)	A5G3 (1) (d) & (e) – Test report & Expert judgement	Items 1, 2, 3, 4, 5, 6, 7, 43, 44, 45, 46, 47, 48, 49, 50, 51, 52 & 53
BCA Volume One F7D5	A2G3 (2) (a) & (b)	A5G3 (1) (d) & (e) – Test report & Expert judgement	Items 1, 2, 3, 4, 5, 6, 7, 43, 44, 45, 46, 47, 48, 49, 50, 51, 52 & 53
BCA Volume One F7D6	A2G3 (2) (a) & (b)	A5G3 (1) (d) & (e) – Test report & Expert judgement	Items 1, 2, 3, 4, 5, 6, 7, 43, 44, 45, 46, 47, 48, 49, 50, 51, 52 & 53
Housing Provisions 10.7.1	A2G3 (2) (a) & (b)	A5G3 (1) (d) & (e) – Test report & Expert judgement	Items 1, 2, 3, 4, 5, 6, 7, 43, 44, 45, 46, 47, 48, 49, 50, 51, 52 & 53
Housing Provisions 10.7.2	A2G3 (2) (a) & (b)	A5G3 (1) (d) & (e) – Test report & Expert judgement	Items 1, 2, 3, 4, 5, 6, 7, 43, 44, 45, 46, 47, 48, 49, 50, 51, 52 & 53
Housing Provisions 10.7.3	A2G3 (2) (a) & (b)	A5G3 (1) (d) & (e) – Test report & Expert judgement	Items 1, 2, 3, 4, 5, 6, 7, 43, 44, 45, 46, 47, 48, 49, 50, 51, 52 & 53
BCA Volume One F8D3	A2G3 (2) (a) & (b)	A5G3 (1) (f) – Other documentary evidence	Item 1
BCA Volume Two H4D9	A2G3 (2) (a) & (b)	A5G3 (1) (f) – Other documentary evidence	Item 1
BCA Volume One G5D3	A2G3 (2) (a) & (b)	A5G3 (1) (d) & (e) – Test report & Expert judgement	Items 24, 25, 26, 27, 28, 30 & 31
BCA Volume One G5D4	A2G3 (2) (a) & (b)	A5G3 (1) (d) & (e) – Test report & Expert judgement	Items 24, 25, 26, 27, 28, 30 & 31
BCA Volume Two H7D4 (2)	A2G3 (2) (a) & (b)	A5G3 (1) (d) & (e) – Test report & Expert judgement	Items 24, 25, 26, 27, 28, 30 & 31
BCA Volume One J3D8	A2G3 (2) (a) & (b)	A5G3 (1) (e) – Expert judgement	Items 1, 2, 3, 4, 5, 6, 7, 54, 55, 56, 57, 58, 59, 60, 61 & 62

Code Clause	Assessment Method(s)	Evidence of suitability	Evidence reference in B2
BCA Volume One J4D6	A2G3 (2) (a) & (b)	A5G3 (1) (e) – Expert judgement	Items 1, 2, 3, 4, 5, 6, 7, 54, 55, 56, 57, 58, 59, 60, 61 & 62
Housing Provisions 13.2.5	A2G3 (2) (a) & (b)	A5G3 (1) (e) – Expert judgement	Items 1, 2, 3, 4, 5, 6, 7, 54, 55, 56, 57, 58, 59, 60, 61 & 62
BCA Volume One NT B1D4 (b)(iii)	A2G3 (2) (a) & (b)	A5G3 (1) (e) & (f) – Expert judgement & Other documentary evidence	Items 1, 2, 3, 4, 5, 6, 7, 8, 9, 10, 11, 12, 13, 14, 15, 16, 17, 18, 19, 20, 21, 41 & 42
BCA Volume One QLD B1D4 (b)(iii)	A2G3 (2) (a) & (b)	A5G3 (1) (e) & (f) – Expert judgement & Other documentary evidence	Items 1, 2, 3, 4, 5, 6, 7, 8, 9, 10, 11, 12, 13, 14, 15, 16, 17, 18, 19, 20, 21, 41 & 42
BCA Volume One WA B1D4 (b)(iii)	A2G3 (2) (a) & (b)	A5G3 (1) (e) & (f) – Expert judgement & Other documentary evidence	Items 1, 2, 3, 4, 5, 6, 7, 8, 9, 10, 11, 12, 13, 14, 15, 16, 17, 18, 19, 20, 21, 41 & 42
BCA Volume Two WA H1D7 (4)(a)	A2G3 (2) (a) & (b)	A5G3 (1) (e) & (f) – Expert judgement & Other documentary evidence	Items 1, 2, 3, 4, 5, 6, 7, 8, 9, 10, 11, 12, 13, 14, 15, 16, 17, 18, 19, 20, 21, 41 & 42
Housing Provisions NSW 9.4.1	A2G3 (2) (a) & (b)	A5G3 (1) (d) & (e) – Test report & Expert judgement	Items 24, 25, 26, 27, 28, 29, 30, 31, 32, 33, 34, 35, 36, 37, 38 & 39
Housing Provisions NSW 9.4.3	A2G3 (2) (a) & (b)	A5G3 (1) (d) & (e) – Test report & Expert judgement	Items 24, 25, 26, 27, 28, 29, 30, 31, 32, 33, 34, 35, 36, 37, 38 & 39
BCA Volume One NT F7	A2G3 (2) (a) & (b)	A5G3 (1) (d) & (e) – Test report & Expert judgement	Items 1, 2, 3, 4, 5, 6, 7, 43, 44, 45, 46, 47, 48, 49, 50, 51, 52 & 53
Housing Provisions NT 10.7	A2G3 (2) (a) & (b)	A5G3 (1) (d) & (e) – Test report & Expert judgement	Items 1, 2, 3, 4, 5, 6, 7, 43, 44, 45, 46, 47, 48, 49, 50, 51, 52 & 53
BCA Volume Two TAS H4D9	A2G3 (2) (a) & (b)	A5G3 (1) (f) – Other documentary evidence	Item 1
BCA Volume One NSW G5D3	A2G3 (2) (a) & (b)	A5G3 (1) (d) & (e) – Test report & Expert judgement	Items 24, 25, 26, 27, 28, 30 & 31
BCA Volume Two NSW H7D4 (2)	A2G3 (2) (a) & (b)	A5G3 (1) (d) & (e) – Test report & Expert judgement	Items 24, 25, 26, 27, 28, 30 & 31
BCA Volume One NSW G5D4	A2G3 (2) (a) & (b)	A5G3 (1) (d) & (e) – Test report & Expert judgement	Items 24, 25, 26, 27, 28, 30 & 31
BCA Volume One VIC G5D4	A2G3 (2) (a) & (b)	A5G3 (1) (d) & (e) – Test report & Expert judgement	Items 24, 25, 26, 27, 28, 30 & 31
BCA Volume One NSW J3D8	A2G3 (2) (a) & (b)	A5G3 (1) (e) – Expert judgement	Items 1, 2, 3, 4, 5, 6, 7, 54, 55, 56, 57, 58, 59, 60, 61 & 62
BCA Volume One NSW J4D6	A2G3 (2) (a) & (b)	A5G3 (1) (e) – Expert judgement	Items 1, 2, 3, 4, 5, 6, 7, 54, 55, 56, 57, 58, 59, 60, 61 & 62
BCA Volume One NSW Section J	A2G3 (2) (a) & (b)	A5G3 (1) (e) – Expert judgement	Items 1, 2, 3, 4, 5, 6, 7, 54, 55, 56, 57, 58, 59, 60, 61 & 62
Housing Provisions NSW 13.2.5	A2G3 (2) (a) & (b)	A5G3 (1) (e) – Expert judgement	Items 1, 2, 3, 4, 5, 6, 7, 54, 55, 56, 57, 58, 59, 60, 61 & 62
BCA Volume Two NSW Part H6	A2G3 (2) (a) & (b)	A5G3 (1) (e) – Expert judgement	Items 1, 2, 3, 4, 5, 6, 7, 54, 55, 56, 57, 58, 59, 60, 61 & 62
BCA Volume Two NT Part H6	A2G3 (2) (a) & (b)	A5G3 (1) (e) – Expert judgement	Items 1, 2, 3, 4, 5, 6, 7, 54, 55, 56, 57, 58, 59, 60, 61 & 62
Housing Provisions NT 13.2.5	A2G3 (2) (a) & (b)	A5G3 (1) (e) – Expert judgement	Items 1, 2, 3, 4, 5, 6, 7, 54, 55, 56, 57, 58, 59, 60, 61 & 62
BCA Volume One TAS Part J3	A2G3 (2) (a) & (b)	A5G3 (1) (e) – Expert judgement	Items 1, 2, 3, 4, 5, 6, 7, 54, 55, 56, 57, 58, 59, 60, 61 & 62
BCA Volume Two TAS Part H6	A2G3 (2) (a) & (b)	A5G3 (1) (e) – Expert judgement	Items 1, 2, 3, 4, 5, 6, 7, 54, 55, 56, 57, 58, 59, 60, 61 & 62
Housing Provisions TAS 13.2	A2G3 (2) (a) & (b)	A5G3 (1) (e) – Expert judgement	Items 1, 2, 3, 4, 5, 6, 7, 54, 55, 56, 57, 58, 59, 60, 61 & 62

APPENDIX B cont'd


B2 Reports

The following reports have been used as evidence to determine compliance with BCA 2022

Ref	Author	Reference	Date	Description	NATA Registration
1	ONE AAC PANEL	External Wall Design & Installation Manual	May 2025	Client published design & installation manual	-
2	ONE AAC PANEL	Flooring Design & Installation Manual	May 2025	Client published design & installation manual	-
3	ONE AAC PANEL	Party Wall Design & Installation Manual	May 2025	Client published design & installation manual	-
4	ONE AAC PANEL	Dual Zero Boundary Wall Design & Installation Manual	May 2025	Client published design & installation manual	-
5	ONE AAC PANEL	Dual Zero Boundary Wall Construction Details	Sep 2019	Client published drawings and details	-
6*	Enertrén	ONE-007 V.4	10 Feb 2022	Compliance review of ONE AAC systems against NCC	-
7*	Enertrén	ONE-013 V.3	10 Feb 2022	Compliance review of ONE AAC systems against NCC	-
8*	ONE AAC PANEL	Batch Testing 50mm Panel	15 Mar 2018	Quality control structural test document	-
9*	Enertrén	AS4055-2006 Connection Design	9 Apr 2013	Structural calculation report	-
10*	Enertrén	ONE-011 V.1	10 Feb 2022	Structural Design Certification	-
11*	Enertrén	ONE-012 V.3	10 Feb 2022	Structural Design Certification	-
12*	BEMAC Laboratories	10953 – 50mm x 2.7m mesh panel	6 Mar 2017	Structural test report	1393
13*	BEMAC Laboratories	10953 – 50mm x 3.0m mesh panel	4 May 2017	Structural test report	1393
14*	Pace Structural	PS 18013 – 50mm AAC Zero Boundary Walls	22 Jan 2025	Structural Design Certification	-
15*	Pace Structural	PS 18022 – 50mm AAC Party Walls	22 Jan 2025	Structural Design Certification	-
16*	Pace Structural	PS 20116 – 75mm AAC Flooring	23 Jan 2025	Structural Design Certification	-
17*	Pace Structural	PS 20123 – 75mm AAC External Walls	23 Jan 2025	Structural Design Certification	-
18*	Pace Structural	PS 18153 – 75mm AAC Vert External Walls	23 Jan 2025	Structural Design Certification	-
19*	Pace Structural	PS 18158 – 75mm AAC Party Walls	20 Mar 2025	Structural Design Certification	-
20*	Pace Structural	PS 19167 – 75mm AAC Flooring	11 Apr 2021	Structural Design Certification	-
21*	Pace Structural	PS 20145 – 50mm AAC External Walls	22 Jan 2025	Structural Design Certification	-
22*	Mahaffey Associates	BAS/25/L01/9830	26 Feb 2025	Durability assessment report	-
23*	The Coatings Consultancy	TCC18025-B-20231018	18 Oct 2023	Durability assessment report	-
24*	CSIRO	FNC12427A	2 Sep 2019	Fire Test Report	165
25*	CSIRO	FNC12490	22 Nov 2019	Fire Test Report	165
26*	CSIRO	FCO-2532 Rev G	20 Aug 2024	Fire Assessment Report	165
27*	CSIRO	FCO-3003 Rev F	3 Dec 2024	Fire Assessment Report	165
28*	CSIRO	FCO-3241 Rev D	3 Dec 2024	Fire Assessment Report	165
29*	CSIRO	FCO-3255 Rev G	1 Sep 2021	Fire Assessment Report	165
30*	CSIRO	FCO-3451 Rev D	30 Aug 2024	Fire Assessment Report	165
31*	WarringtonFire Australia	FAS200114 – 24917 R3.1	26 May 2022	Fire Assessment Report	3277
32*	WarringtonFire Australia	FAS190160 – 45771 R21.0	23 Feb 2023	Fire Assessment Report	3277
33*	WarringtonFire Australia	FAS200249 – 27915 RIIR 28.3	25 Sep 2024	Fire Assessment Report	3277

Ref	Author	Reference	Date	Description	NATA Registration
34*	BRANZ	FC12946-02-05	23 Dec 2024	Fire Assessment Report	IANZ 37
35*	BRANZ	FC12969-02-02	23 Dec 2024	Fire Assessment Report	IANZ 37
36*	SGA Fire	115620-FAR2-r2	1 Mar 2023	Fire Assessment Report	-
37*	Warrington Fire Australia	FAS190160 RIR21.0	27 Feb 2023	Fire Assessment Report	3277
38*	Jensen Hughes	115620-FAR10-r2	27 Apr 2023	Fire Assessment Report	-
39*	Jensen Hughes	FAS200088 – 26162 RIR3.7	27 Nov 2024	Fire Assessment Report	3277
40*	Enertren	ONE-009 V.1	5 Sep 2019	Weatherproofing Assessment Report	-
41*	AECOM	2021.04.08_FV1.1_HEB	8 Apr 2021	Weatherproofing Assessment Report	-
42*	Xavier Knight	220912 Rev 06	8 Aug 2024	Weatherproofing Assessment Report	-
43*	Koikas Acoustics	2679C20150827NK v1	3 Jun 2015	Acoustic Test Report	-
44*	Koikas Acoustics	2878C20151112MFC v1	12 Nov 2015	Acoustic Test Report	-
45*	Koikas Acoustics	2878C20181031NK v2	9 Nov 2016	Acoustic Assessment Report	-
46*	Renzo Tonin & Assoc	TG553-01F02 (rev 0)	6 Feb 2014	Acoustic Assessment Report	-
47*	AcousticLogic	201307861.1/0209A/R0/GW	2 Sep 2013	Acoustic Assessment Report	-
48*	AcousticLogic	20140366.35/0202A/R6/GW	2 Feb 2018	Acoustic Assessment Report	-
49*	AcousticLogic	20171728.13/0507A/R6/GW	1 May 2019	Acoustic Assessment Report	-
50*	AcousticLogic	20171728.18/1302A/R1/GW	13 Feb 2020	Acoustic Assessment Report	-
51*	AcousticLogic	20210103.13/1105A/R0/TB	11 May 2023	Acoustic Assessment Report	-
52*	AcousticLogic	2010861.19/0508A/R3/GW	5 Aug 2016	Acoustic Assessment Report	-
53*	PKA Acoustic Consulting	PKA-A071	18 Apr 2023	Acoustic Assessment Report	-
54*	Enertren	75mm AAC Panel R-Value	27 Nov 2015	Thermal Assessment Report	-
55*	Enertren	ONE-AAC Cladding Wall 75mm R Values	9 Apr 2013	Thermal Calculation Report	-
56*	CSR Insulation	NR-12140	10 Oct 2012	Thermal Test Report	993
57*	James M Fricker	107w2509p-w26111p	15 Apr 2024	Thermal Calculation Report	-
58*	James M Fricker	107w25011n-w2520	29 Apr 2024	Thermal Calculation Report	-
59*	James M Fricker	107w25011n-w2520	29 Apr 2024	Thermal Calculation Report	-
60*	James M Fricker	107w26011n-w2720	8 Mar 2024	Thermal Calculation Report	-
61*	James M Fricker	107.23i – 107.29ii	1 Sep 2020	Thermal Calculation Report (timber frame)	-
62*	James M Fricker	107.23i – 107.29ii	1 Sep 2020	Thermal Calculation Report (steel frame)	-

* The Certificate Holder has chosen not to make the above identified evidence of compliance publicly available, due to the documents being considered commercial in confidence.

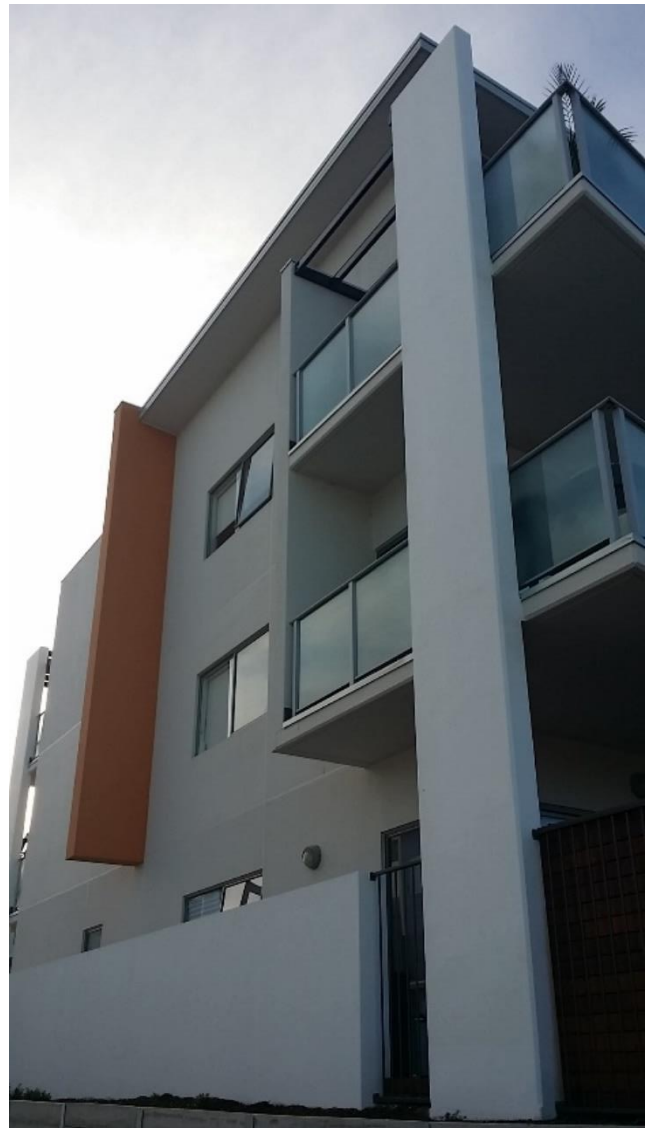

ONE AAC PANEL

Head Office:

485 Campbelltown Rd

Denham Court NSW 2565

Tel: **1300 010 222 (AAC) or 02 9756 5029**

Mobile: 0439 28 30 30

Email: info@oneaac.com.au

Web: www.oneaac.com.au